PAD MOUNTED FD. PT. CABINET 120/240 VOLT

DIRECT BURIED CABLE 4 CONDUCTOR NO. 4

-|| PERMANENT GROUND ROD (25 OHMS OR LESS)

 $\equiv$   $\equiv$  3" CONTINUOUS NMC BORED (UNLESS NOTED OTHERWISE)

-O- INPLACE POWER POLE


-OHP---- OVERHEAD POWER LINES

UTILITY OWNERSHIP					
BURIED FIBER -F/O -BUR-	ACCESS COMMUNICATIONS CENTURYLILNK FRONTIER				
OVERHEAD ELECTRIC -OHP-	XCEL ENERGY				
BURIED TELEPHONE  T-BUR	HICKORYTECH				

FEEDPOINT R19N LIGHTING STANDARDS AND FOUNDATIONS


=======================================							
NO.	ST	ATION	LT.	RT.	LOCATION	TYPE	
1	AS	SHOWN		Х	NB TH169	9-40 LED	
2	A\$	SHOWN		Х	SB TH169	9-40 LED	

B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR
FO.PT.R19N 120/240 VOLT





SCALE IN FEET

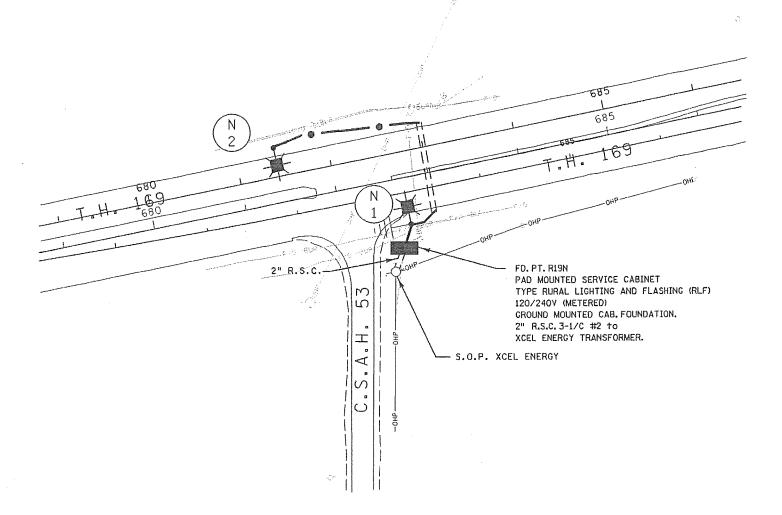

BY DATE	REVISIONS	FEEDPOINT: R19N LOCATION: T.H. 169 dt C.S.A.H. 53 METER ADDRESS: 23975 JOHNSON MEMORIAL DR, BELLE PLAINE 56011.	LIGHTING PLAN	
DRAWN BY: PE	3 CKD BY: GB DATE: 10/2013	CERTIFIED BY Wichou P. Glorensky LIC. NO. 19863 DATE: 3/13/2014	STATE PROJ.NO.8825-389	SHEET NO. 12 OF 13 SHEETS