

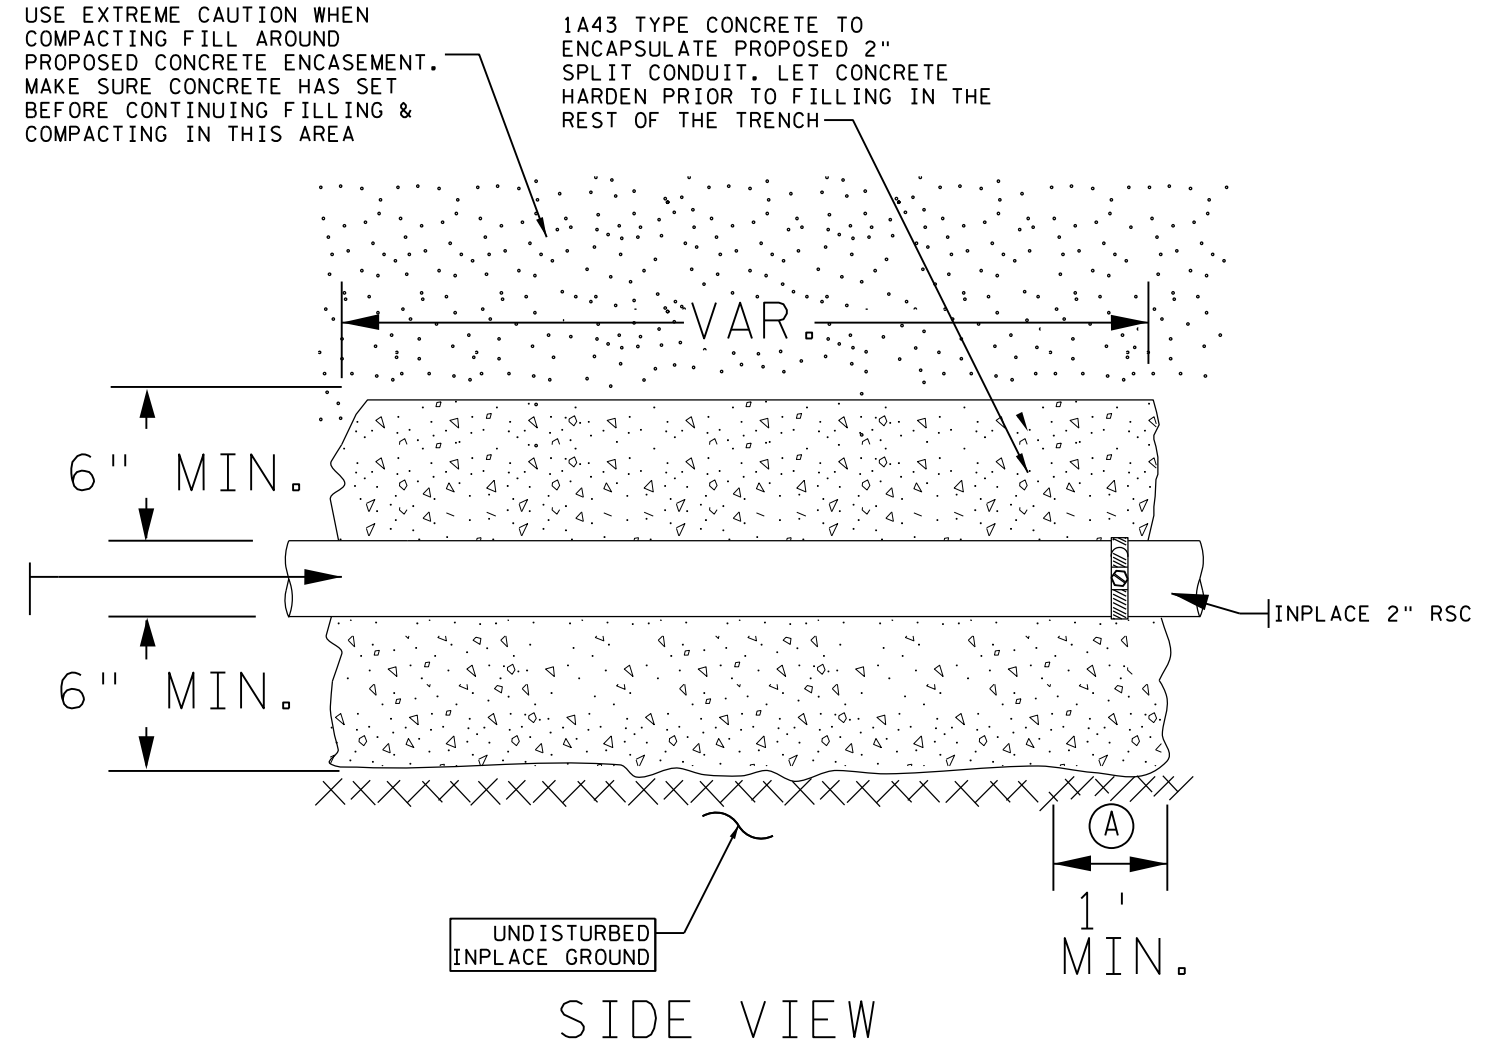


Reut1An1 T79CLW161FRW047 TMS
 6/6/2022 4:36:22 PM
 pw: \\p81.ad.dot.state.mn.us:cddp\Documents\Projects\DM_R05\Non_Project\FrOps\DetailDrawings\CAB_LOOP_MISC\cab_loop_misc.dtl.dwg_PLOTTED:

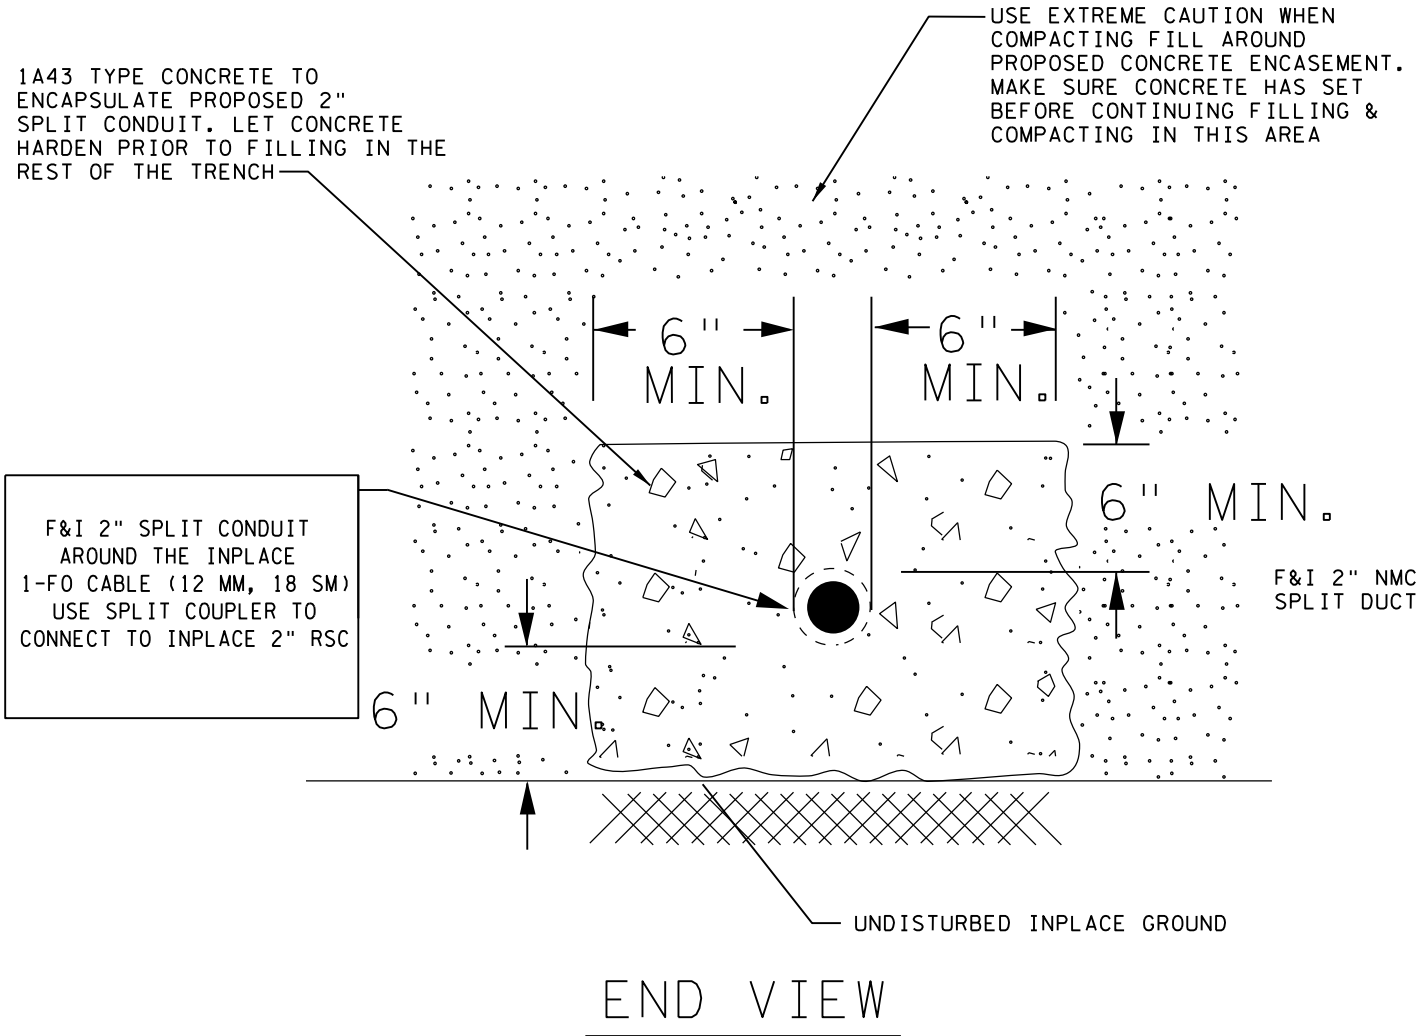

USE FOR INSTALLATIONS WITH INSUFFICIENT DEPTH OR FOR CONDUIT PROTECTION

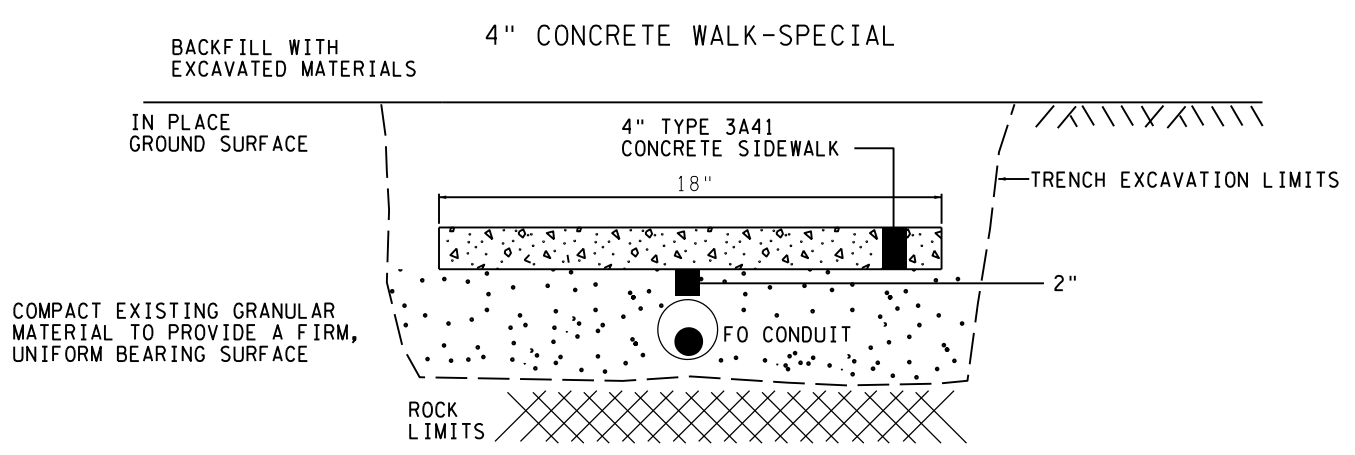

NOTES:

① F&I 4" CONCRETE CAP IN AREAS WHERE 24" MIN. DEPTH COVER CAN NOT BE MET DUE TO ROCK

NOTES:

EXCAVATE MATERIAL BY HYDRO VAC METHOD

PLACE SPLIT DUCT CONDUIT AROUND INPLACE FO CABLE

PLACE HOSE CLAMPS AT 1' INTERVALS AROUND SPLIT DUCT TO AVOID CONCRETE FROM ENTERING DUCT

CONCRETE TO BE 1A43

① PLACE CONCRETE AT LEAST 1 (ONE) FOOT AROUND THE INPLACE CONDUIT AND COUPLER.

FIBER OPTIC CABLE ENCASEMENT

REVISED 6/27/18

REV. NO.	DATE:	/ /
REV. NO.	DATE:	/ /

CERTIFIED BY _____ LIC. NO. 12345 DATE 2021
 LICENSED PROFESSIONAL ENGINEER

STATE PROJ. NO. XXXX-XXX (TH XXX) SHEET NO. XXXX? OF XXXXX SHEETS