

ATTACHMENT 1 – TECHNICAL REQUIREMENTS

Funding for any agreement resulting from this Request for Proposals (RFP) will be paid from National Electric Vehicle Infrastructure (NEVI) formula funds and state funds. All applicable requirements of Title 23 United States Code (USC) and 2 Code of Federal Regulations (CFR) Part 200 apply to the administration of these funds, which include, but are not limited to: 23 CFR 680, the Davis-Bacon Act, the Americans with Disabilities Act of 1990 (ADA), Title VI of the Civil Rights Act of 1964, the National Environmental Policy Act of 1969 (NEPA), and the Build America, Buy America (BABA) Act. The Grantee must also comply with all other standards and requirements required by federal, state, and local laws.

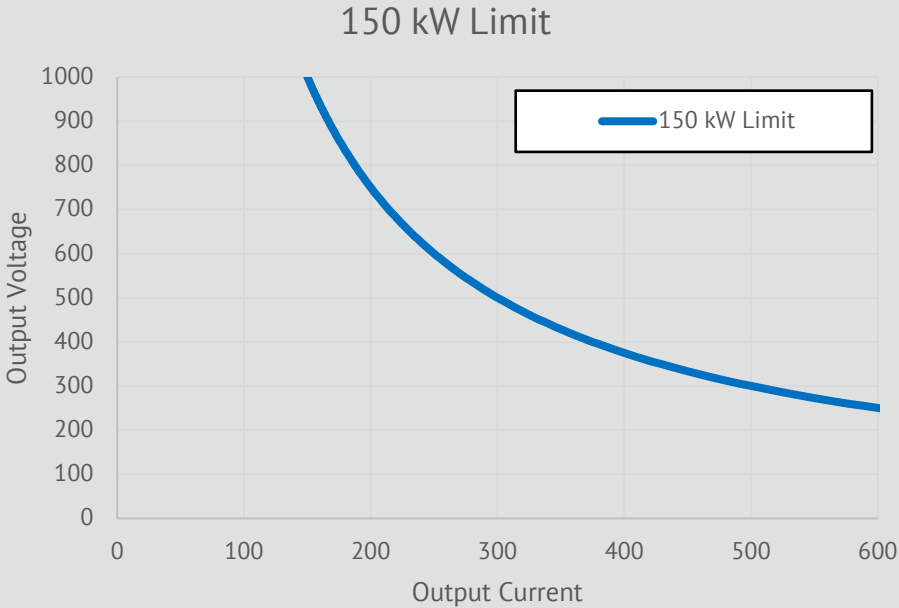
Electric Vehicle Supply Equipment (EVSE) funded under any agreement resulting from this RFP will be covered by the ***Build America, Buy America Implementation Plan to Enhance Buy America for Electric Vehicle (EV) Chargers.***

In addition to the above, Grantees must comply with the following technical requirements.

1	ADDITIONAL PROJECT SITE REQUIREMENTS	
1.1	Distance from AFC	The Project site shall be within a maximum driving distance of 1 mile from the Alternative Fuel Corridor (AFC). The measurement of the distance shall begin from the end of the nearest interstate off-ramp to the charging station and conclude at the entrance to the charging station.
1.2	Access to Restrooms	The Project site shall include a publicly accessible restroom located at the Project site or within 500 feet from the charging station. Restrooms must be reachable via sidewalks or pavement. These restrooms must remain open to the public whenever the charging site is operational, 24 hours per day, 7 days per week, throughout the year.
1.3	Access to Food and Drink	The Project site shall have access to food and drink 24 hours per day, 7 days per week, throughout the year. Vending machines at the Project site or within 500 feet of pedestrian travel distance from the charging station meet minimum requirements.
1.4	Site Accessibility	The Project site shall be accessible to the public and reachable from a public road 24 hours per day, 7 days per week, throughout the year, without a fee. Access to the Project site must have adequate traffic control measures, such as signage, signals, striping, etc. These sites may be situated on private property.
1.5	ADA Compliance	The Project site shall adhere to ADA requirements, incorporating a minimum of one ADA-compliant parking space equipped with access to EV charging infrastructure. The ADA parking space shall adhere to the guidelines specified by the <i>US Access Board.</i>
1.6	Site Signage	The Project site shall have clear signage that indicates the site's location and the location of the charging ports within the site. Locations and signage design

Attachment 1

1		ADDITIONAL PROJECT SITE REQUIREMENTS
		for the site will be finalized as part of the Project’s Preliminary Engineering design phase. The Applicant is responsible for obtaining all permits and approvals related to signage.
1.7	Safety Lighting	The Project site shall provide lighting to illuminate all EVSE and corresponding parking spaces. Lighting levels and requirements shall be consistent with existing jurisdictional and zoning requirements.
1.8	Cell Phone Service	The Grantee shall make certain that there is adequate cell phone service available at the Project site. This may include an open access Wi-Fi hotspot.
1.9	Security Cameras and On-Site Staff or Emergency Call Boxes	The Grantee shall ensure security through security cameras and either on-site staff or emergency call boxes. The security cameras shall fully cover the Project site, including the EVSE, EV infrastructure equipment, and parking area. High -definition, color cameras shall be used and footage from the cameras shall be stored for at least 30 days, complying with cybersecurity and data management requirements. Either on-site staff or emergency call boxes shall be provided. If utilizing on-site staff, they shall be present and available at the site 24 hours per day, 7 days per week, throughout the year. As an alternative to on-site staff, the Grantee shall provide Emergency call boxes that connect directly to local emergency management departments.
1.10	Trash and recycling receptacles	The Project site shall have trash and recycling receptacles available to site users. The trash and recycling receptacles shall be emptied and maintained on a regular basis to prevent overflow of contents. If recycling services are not available in the Project site location, the Applicant must state that clearly in the application.
1.11	Snow Removal	The Grantee shall provide snow and ice removal service at the Project site when snow accumulates above 1 inch within 2 hours of the end of the weather event.
1.12	Fire Extinguisher	The Grantee shall provide a functioning Class C fire extinguisher within 10 feet of the EVSE.
1.13	Physical Security	All EVSE, electrical infrastructure, and other equipment at the Project site shall be protected (e.g., bollards) from being hit by vehicles from inside and outside of the site. They must also be secured physically to prevent unauthorized access.

2	ADDITIONAL CHARGER REQUIREMENTS AND SPECIFICATIONS															
2.1	Range of Operating Temperature	EVSE shall be capable of operating at full power over an ambient temperature range of minus 22 degrees to 122 degrees Fahrenheit.														
2.2	Range of Output Current	All charging ports shall be able to provide output currents up to at least 375 350 amps of direct current (ADC).														
2.3	Weather Resistance	EVSE shall be constructed to withstand harsh weather conditions, such as snow, heavy rains, extreme temperatures, and high winds. All above-ground structures, cabinets, and enclosures shall be designed in accordance with local building code standards, and EV charger enclosures shall have a minimum rating of IP54 or equivalent.														
2.4	Output Current Limit	<p>The output current may be the lower of 375350 ADC or the current required to reach 150 kW based on the output voltage. The EVSE shall be capable of outputting at least one voltage and current combination that reaches 150 kW. This is satisfied by operating at any point along the line in Figure 1 below. (see Figure 1 below). All charging ports shall be capable of providing a continuous power output of at least 150 kW simultaneously from each charging port at the charging station. EVSE shall be capable of providing DC output voltages within the entire range of 250–920 volts (VDC).</p> <p>Figure 1: Required Operating Output</p>  <table border="1"> <caption>Data points for Figure 1: Required Operating Output (150 kW Limit)</caption> <thead> <tr> <th>Output Current (ADC)</th> <th>Output Voltage (VDC)</th> </tr> </thead> <tbody> <tr> <td>150</td> <td>1000</td> </tr> <tr> <td>200</td> <td>750</td> </tr> <tr> <td>300</td> <td>500</td> </tr> <tr> <td>400</td> <td>375</td> </tr> <tr> <td>500</td> <td>300</td> </tr> <tr> <td>600</td> <td>250</td> </tr> </tbody> </table>	Output Current (ADC)	Output Voltage (VDC)	150	1000	200	750	300	500	400	375	500	300	600	250
Output Current (ADC)	Output Voltage (VDC)															
150	1000															
200	750															
300	500															
400	375															
500	300															
600	250															
2.5	Charger Locks and Tamper Prevention	EVSE shall incorporate security features to deter tampering. Features shall include the use of locks on enclosures and tamper-resistant screws.														

2		ADDITIONAL CHARGER REQUIREMENTS AND SPECIFICATIONS
2.6	NACS Connectors	Each The direct current fast charging (DCFC) charger(s) port must be capable of charging any North American Charging Standard (NACS) compliant vehicle. and each DCFC port must have at least one permanently attached NACS connector in addition to the required Combined Charging System (CCS) Type 1 connector. A minimum of 4 permanently attached NACS connectors and 4 permanently attached CCS1 connectors are required at the Project site.
2.7	Minimum Power Supply	The utility feed to the Project site shall have a minimum power capacity of at least 150 kW per port, and the ESVE shall have an input power rating of at least 150 kW per port.
2.8	NEVI Port Power Sharing	The Project site shall have a minimum of 4 NEVI compliant charging ports. Additional charging ports that do not meet the NEVI requirements are allowed, but these additional non-NEVI ports are ineligible for NEVI funding. Power sharing between the NEVI ports and the non-NEVI ports is allowed as long as the 150 kW continuous and simultaneous power requirements for the NEVI ports are met. The full cost of the utility upgrades to support all charging ports is an eligible expense. The cost of any equipment that supports only the non-NEVI ports are an ineligible expense. The cost eligibility of any shared equipment that supports both the NEVI and non-NEVI ports shall be prorated based on the proportion of the power rating of the equipment that can supply the NEVI ports simultaneously. If the site contains both NEVI ports and non-NEVI ports, signage shall be provided to clearly identify the NEVI ports.

3		CYBERSECURITY AND DATA MANAGEMENT REQUIREMENTS
3.1	Cybersecurity and Data Management Plan	The Grantee shall develop a written cybersecurity plan. The plan shall adhere to the National Institute of Standards and Technology (NIST) Cybersecurity Framework (CSF). The plan shall outline cybersecurity best practices to be used through all phases of the Project and include the EV charging and supporting infrastructure. The plan shall include security and privacy measures to be implemented, a description of how the entire system will be safeguarded against cyberattacks, and a description of how data will be securely stored, transmitted, and protected from unauthorized access, modification, or destruction. In addition, the plan will detail the expected threat surface and specify the NIST 800-53 controls to be implemented for risk reduction. The plan shall establish roles for Project governance and oversight.
3.2	Cybersecurity Event	The Grantee shall establish a Cybersecurity Event Management Team (CEMT) made of Grantee staff members who will be responsible for responding to any cybersecurity events that may occur during any phase of the Project. The

3	CYBERSECURITY AND DATA MANAGEMENT REQUIREMENTS	
	Management Team	Grantee shall develop a Cybersecurity Event Management Plan that outlines the processes that will be followed in response to an event, including notifying the CEMT.
3.3	Data Segmentation	Data networks used by the charging network shall be segmented to minimize the risk of unintended damage, unauthorized access, data loss, lack of service, privacy breaches, or other issues resulting from unprotected connections.
3.4	Cybersecurity Operations	Cybersecurity operations shall adhere to and maintain certification for System and Organization Controls (SOC 2) and conduct an annual SOC 2 audit.
3.5	Risk Assessment Schedule	The Grantee shall provide a schedule for regular risk assessments and process reviews. Risk assessment read-out reports shall be provided to MnDOT twice per year. A baseline risk assessment shall be part of Task 3 of the Scope of Work and Deliverables and shall include penetration testing. Risk assessments shall include vulnerability scans using the MITRE or Cybersecurity and Infrastructure Security Agency (CISA) Common Vulnerability and Exposures (CVE) database and a report summarizing results and actions for mitigating new or existing vulnerabilities. Qualified personnel shall provide regularly scheduled security patching.
3.6	Cybersecurity Event Notification	The Grantee shall inform MnDOT of any cybersecurity event that requires notification to any person under federal or state law, including data breaches or incidents affecting an electric utility, within 24 hours of the Grantee's discovery of the event.

Attachment 1

4		OPERATIONS AND MAINTENANCE REQUIREMENTS
4.1	Monthly Preventative Maintenance	The Grantee shall perform monthly preventative maintenance on the EV charging infrastructure. This shall include checking for damage and vandalism and replacing any damaged or deteriorated cables or connectors.
4.2	Customer Service	The Grantee shall provide a customer service phone line. The Grantee shall also provide a website or text message number to report problems or issues with the EVSE or Project site. These shall be available 24 hours a day, 7 days a week, and posted clearly and visible at the charging stations. All contact methods must connect the customer to the Grantee and must provide access for users that have limited English proficiency and for people with disabilities.
5		EMERGENCY MANAGEMENT REQUIREMENTS
5.1	Emergency Management Plan	The Grantee shall develop an emergency management plan outlining actions the Grantee will take in the event of a natural disaster or other declared emergency.
6		TRAINING REQUIREMENTS
6.1	Annual Safety Training	The Grantee shall provide annual safety training to all on-site staff, staff operating and maintaining the EV charging infrastructure, and local emergency personnel. The training shall address subjects like electrical safety, shutdown procedures, and firefighting techniques relevant to EVs and/or EV charging emergencies.
6.2	Qualified Workforce Training and Technician Documentation	<p>The Grantee shall verify that the workforce installing, maintaining, and operating chargers has appropriate licenses, certifications, and training to verify that charger installation and maintenance is performed safely by a qualified and increasingly diverse workforce of licensed technicians and other laborers per 23 CFR 680.</p> <p>Workforce training is encouraged to target recruiting, training, and hiring individuals from disadvantaged communities.</p>
7		COMMUNITY ENGAGEMENT
7.1	Community Engagement Outcomes Report	The Grantee must supply any relevant information regarding community engagement to support MnDOT's development of the Community Engagement Outcomes Report per 23 CFR 680.112 (d).