


T.H. 61 S.B.L.
T.H. 61 N.B.L.


INPLACE PAD MOUNTED SOURCE OF POWER
SERVICE CABINET SECONDARY TYPE L2.
240/480 V. (METERED) FD. PT. 62J7

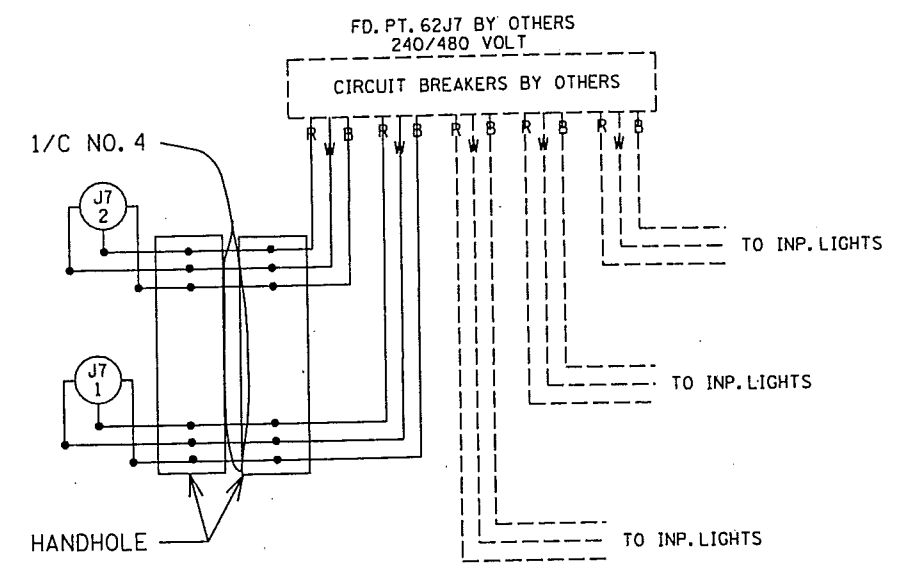

B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

FD. PT. 62J7

LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
1	105+237		-	T.H. 61 N.B.L. 3-30.5
2	105+384		-	T.H. 61 N.B.L. 3-30.5

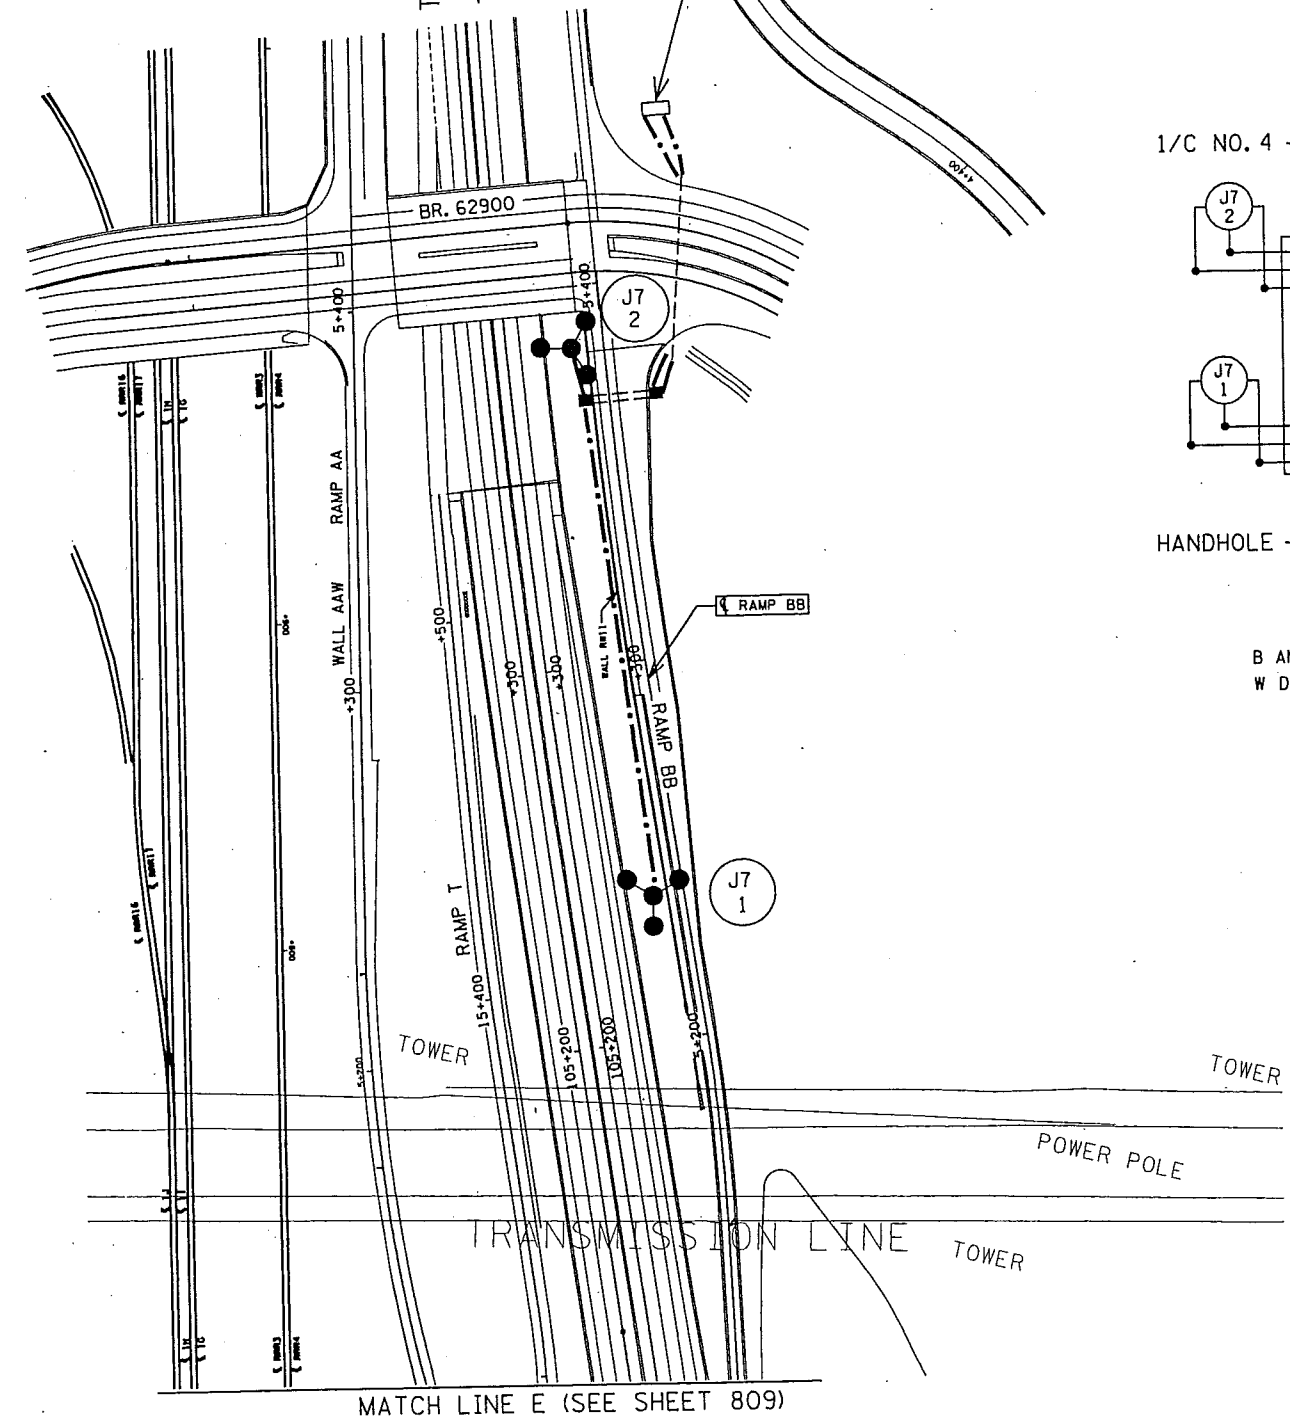


MATCH LINE E (SEE SHEET 809)


FD. PT. 62J7

LIGHTING STANDARDS AND BASES					
NO.	STATION	LT.	RT.	LOCATION	TYPE
1	FUTURE				
2	FUTURE				
3	105+410		-	T.H. 61 N.B.L.	L
(1) 4	105+537	16m		T.H. 61 N.B.L.	3-30.5
(1) 5	105+718	16m		T.H. 61 N.B.L.	3-30.5
6	105+830		-	T.H. 61 N.B.L.	4-12
7	5+835		-	RAMP P	3-12
8	105+905		-	T.H. 61 N.B.L.	4-12
9	105+785		-	T.H. 61 S.B.L.	4-12
10	105+410		-	T.H. 61 S.B.L.	L

(1) SHIELD LUMINAIRES AS DIRECTED BY THE ENGINEER

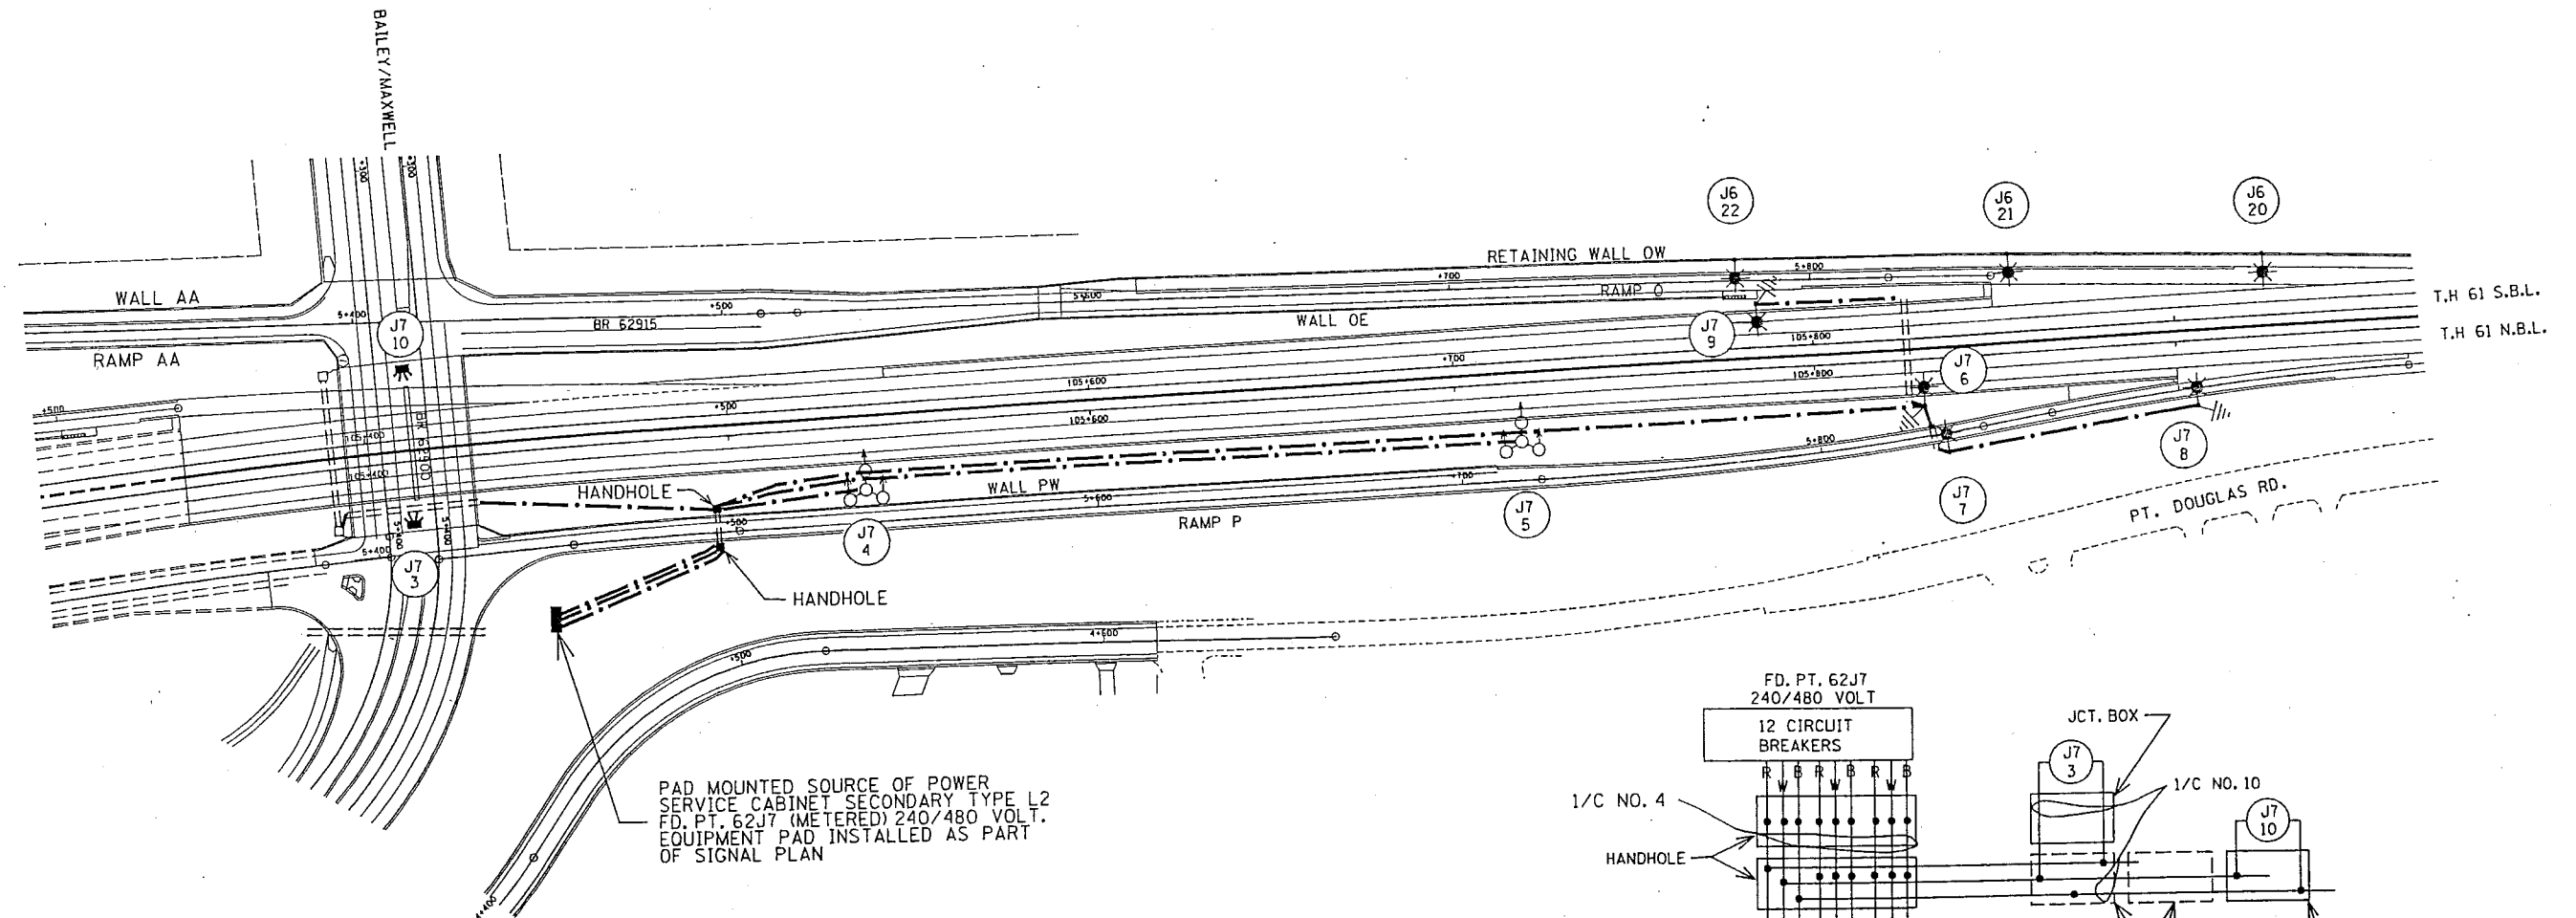

PAD MOUNTED SOURCE OF POWER
SERVICE CABINET SECONDARY TYPE L2
FD. PT. 62J7 (METERED) 240/480 VOLT.
EQUIPMENT PAD INSTALLED AS PART
OF SIGNAL PLAN

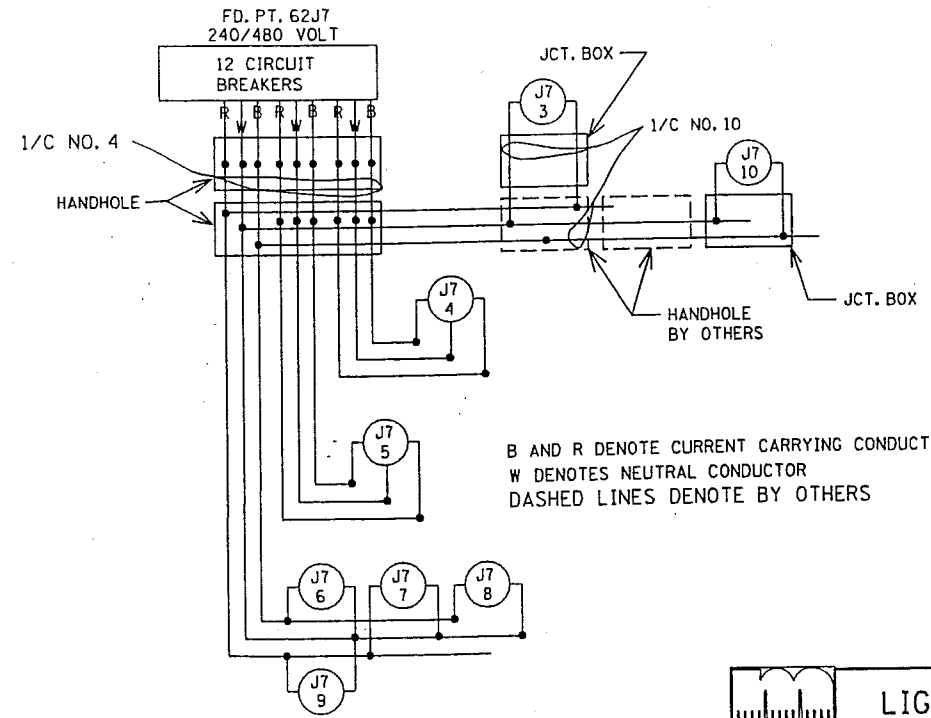

B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR
DASHED LINES DENOTE BY OTHERS



LIGHTING PLAN