



SHEET TOTAL

7 - 200 WATT HIGH PRESSURE SODIUM LIGHTING UNITS  
6 - 250 WATT MERCURY VAPOR SIGN LIGHTS

FD. PT. 70A2

LIGHTING STANDARDS AND BASES					
NO.	STATION	LT.	RT.	LOCATION	TYPE
(1) 1	148+60		-	T.H. 101 E.B.	VM-45
(1) 2	151+00		-	T.H. 101 E.B.	VM-45
(2) 3	153+40		-	T.H. 101 E.B.	VMD-45
(2) 4					
(1) 5	147+95		-	T.H. 101 W.B.	VM-45
(1) 6	145+55		-	T.H. 101 W.B.	VM-45
(1) 7	143+15		-	T.H. 101 W.B.	VM-45

- (1) PLACE LIGHTING UNIT 30 FT. BEHIND EDGE OF ROADWAY
- (2) PLACE LIGHTING UNIT MIDPOINT BETWEEN THE TWO ROADWAYS OR AS DIRECTED BY THE ENGINEER

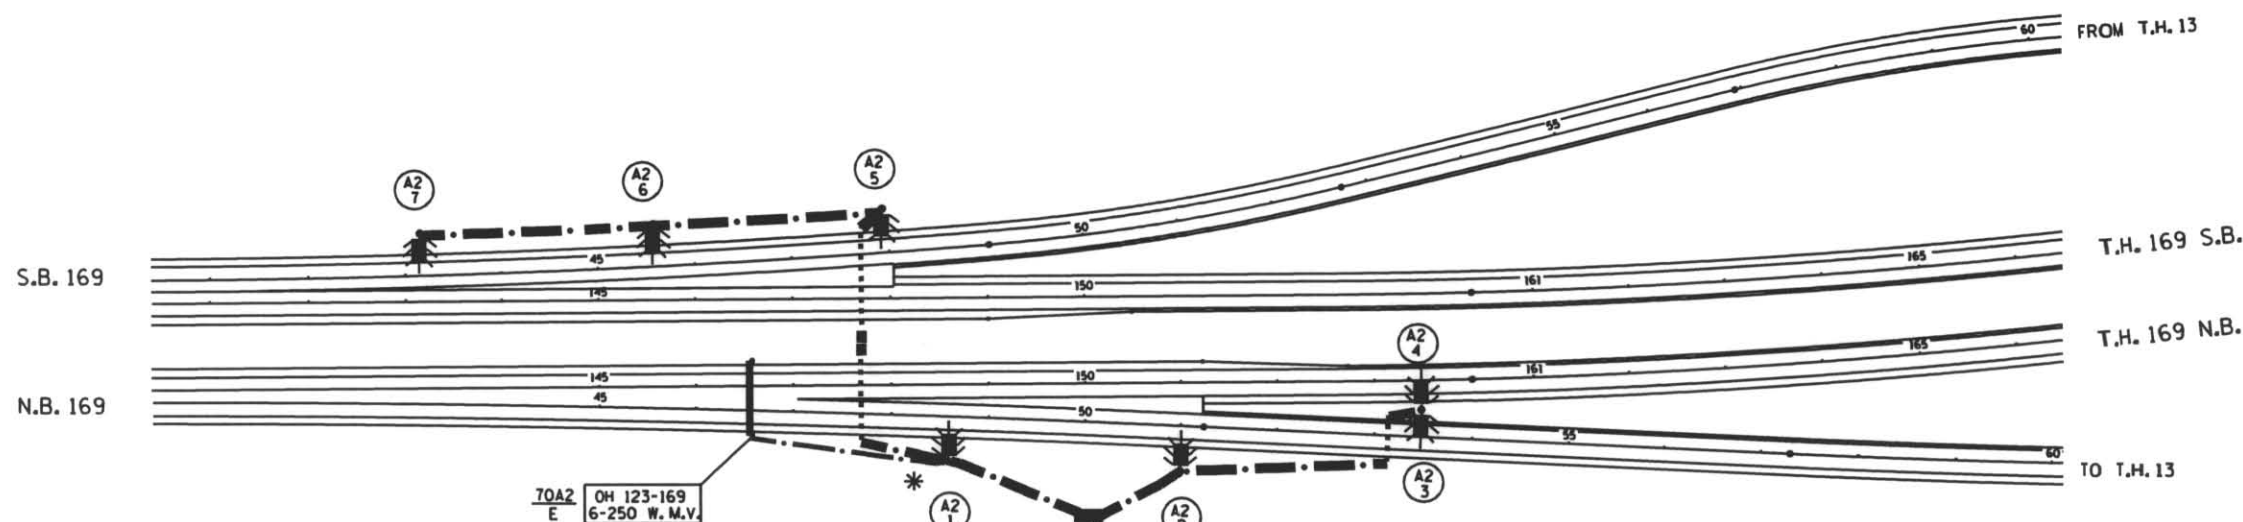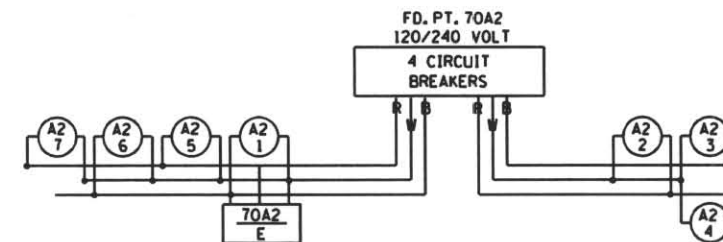

PAD MOUNTED SOURCE OF POWER  
SERVICE PANEL SECONDARY TYPE L1  
EQUIPMENT PAD A.  
FD. PT. 70A2, 120/240 V. (METERED)  
POWER BY SHAKOPEE PUBLIC UTILITIES

EXHIBIT 2  
T.H.13 RAMPS TO T.H. 169  
IN SHAKOPEE  
SHAKOPEE PUBLIC UTIL.  
METERED

FD. PT. 70A2