











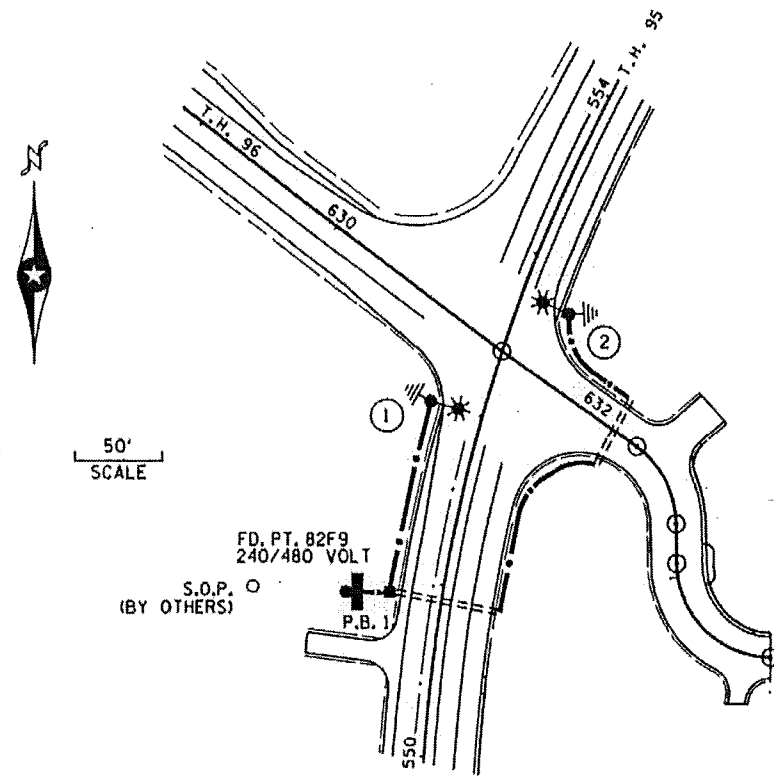
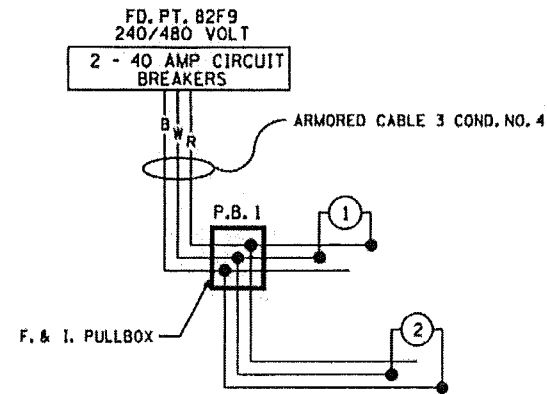
**FEED POINT 82F9**

**LIGHTING STANDARDS AND BASES**

NO.	STATION	LT.	RT.	LOCATION	TYPE
1	551 + 80	—	—	T.H. 95	8-40
2	553 + 00	—	—	T.H. 95	8-40

**LEGEND OF SYMBOLS  
THIS SHEET ONLY**

-  TYPE PT (POST TOP) LIGHTING UNIT INPLACE  
LIGHT BASE DESIGN P INPLACE
-  PAD MOUNTED SERVICE PANEL INPLACE, 120/240 VOLT
-  INSTALL WOOD POLE  
F. & I. 240/480 VOLT SERVICE PANEL, SECONDARY TYPE C
-  3/C #4 ARMORED CABLE INPLACE
-  RIGID STEEL CONDUIT INPLACE
-  INSTALL SALVAGED LIGHT STANDARD  
F. & I. LIGHT BASE, DESIGN E OR DESIGN R-40  
F. & I. 200 WATT H.P.S. LUMINAIRE
-  F. & I. PULLBOX
-  F. & I. 3/C #4 ARMORED CABLE
-  F. & I. 2" R.S.C.  
F. & I. 3/C #4 ARMORED CABLE
-  F. & I. GROUND ROD (25 OHMS OR LESS)



T.H. 95 AT INTERSECTION OF T.H. 96

EXHIBIT 87A

FEEDPOINT 82F9