



LEGEND

- SOURCE OF POWER (PAD MOUNTED)
- SOURCE OF POWER INP. (PAD MOUNTED)
- F. & I. 3" RIGID STEEL CONDUIT
- ⊥ F. & I. PERMANENT GROUND ROD, 25 OHMS OR LESS

- DIRECT BURIED POWER CABLE, 3 CONDUCTOR NO. 4 ARMORED CABLE
- ARMORED CABLE INPLACE
- ⤴ OVERHEAD ILLUMINATED SIGN BY OTHERS

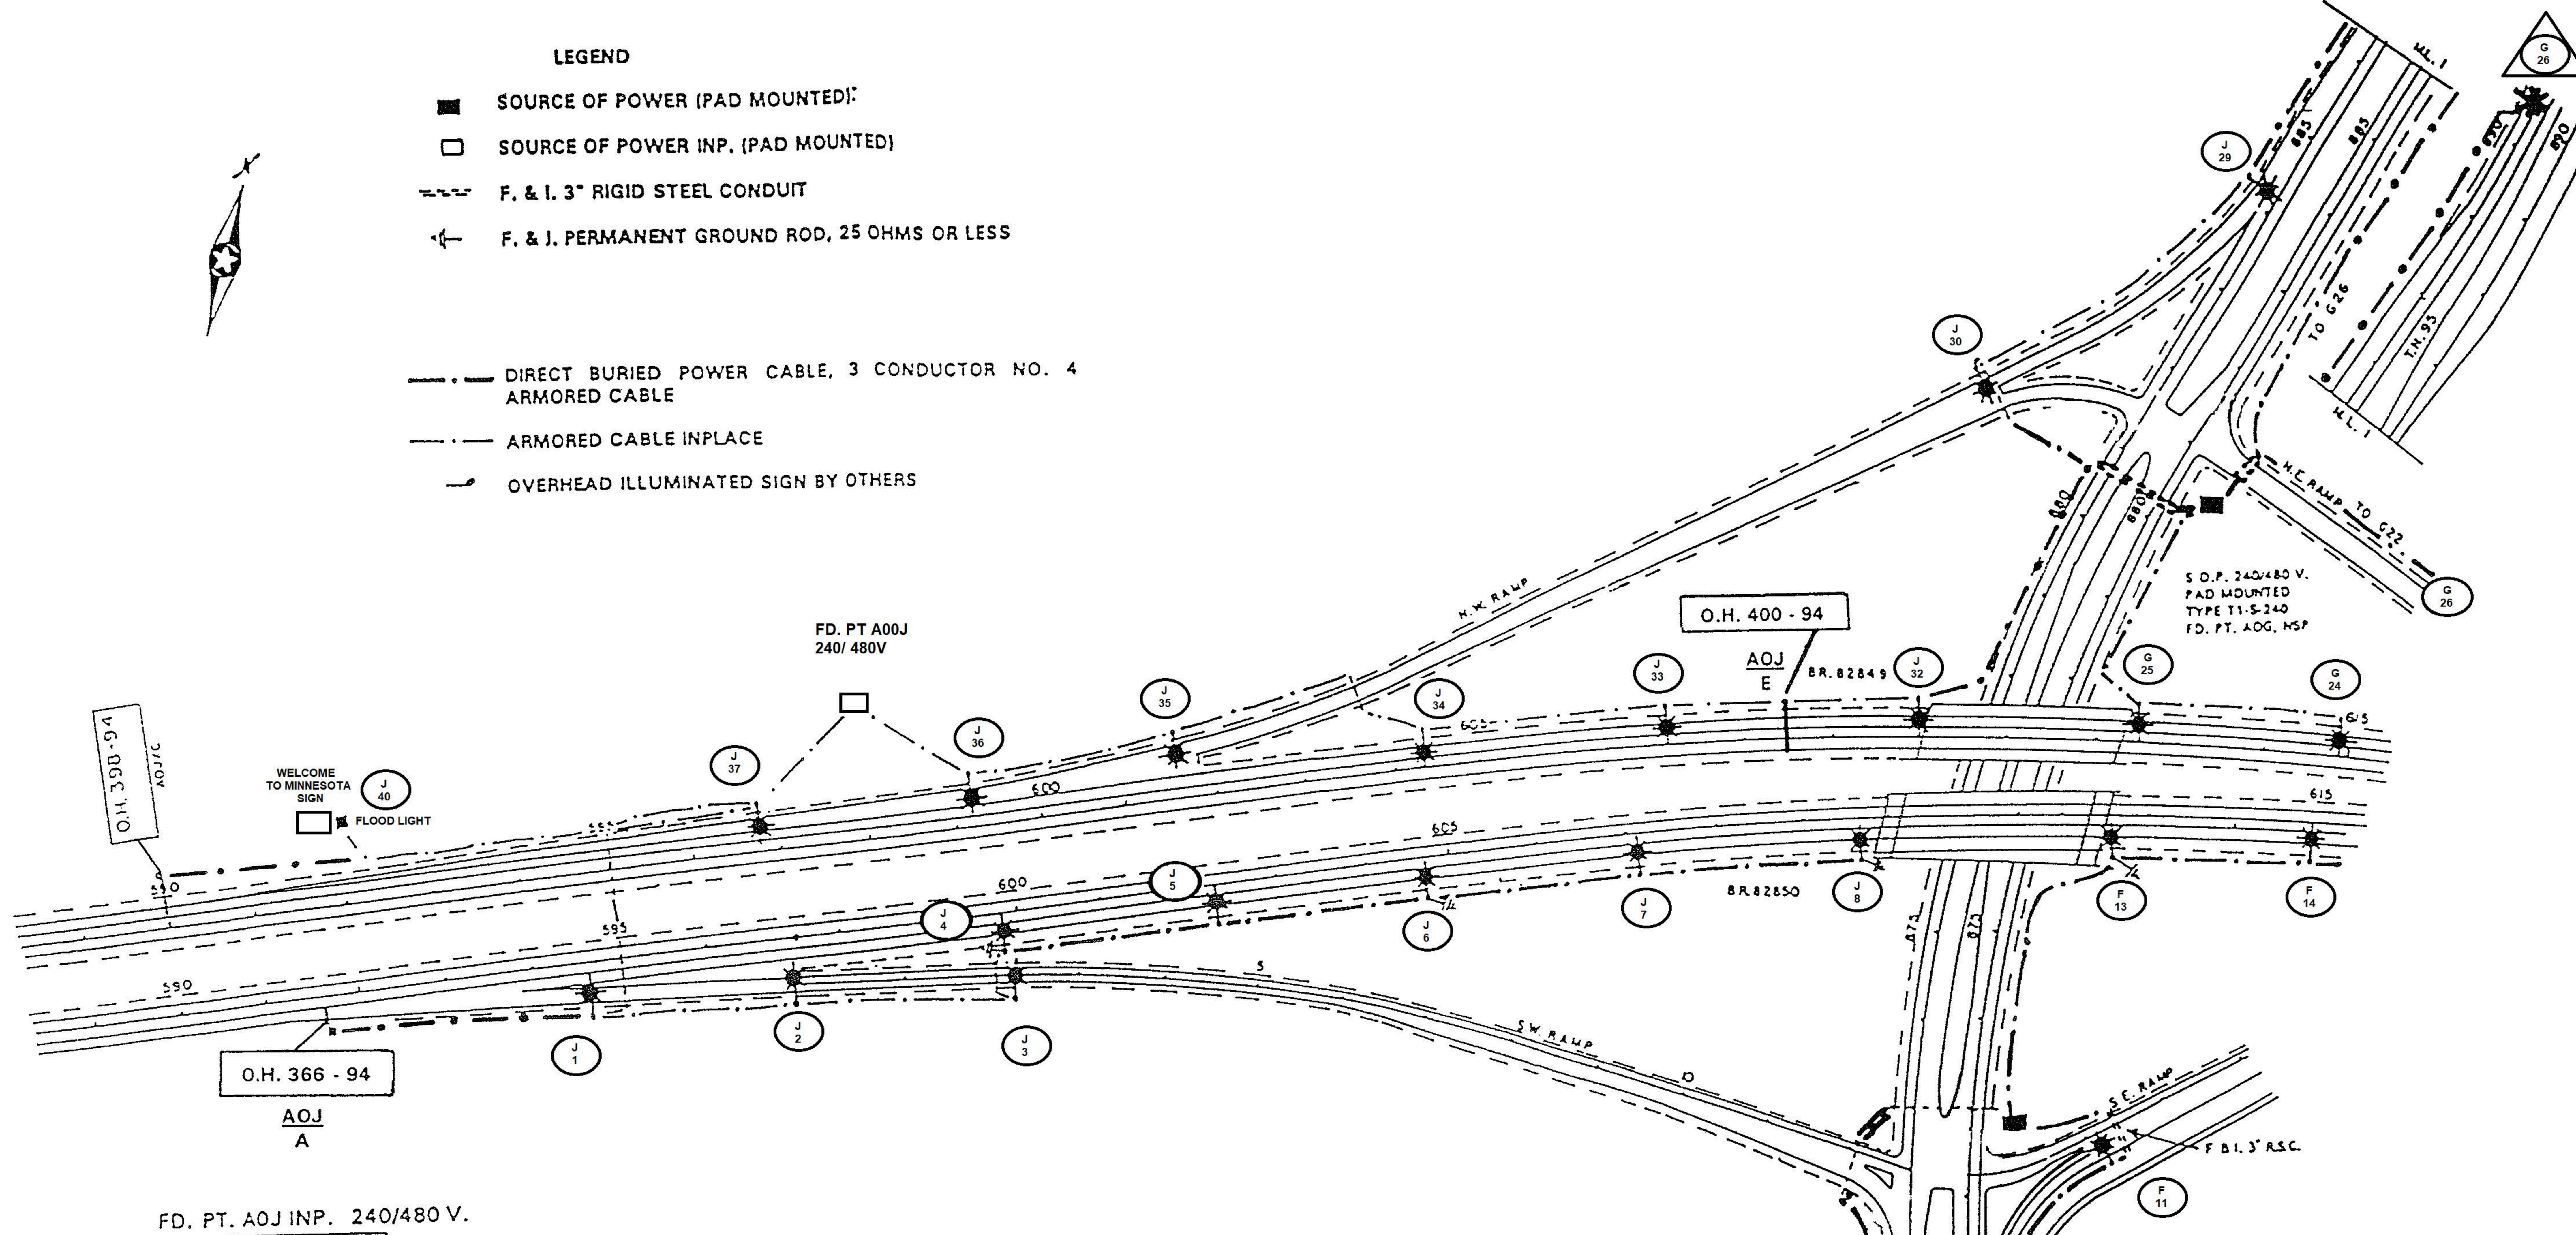

FD. PT. AOJ INP. 240/480 V.

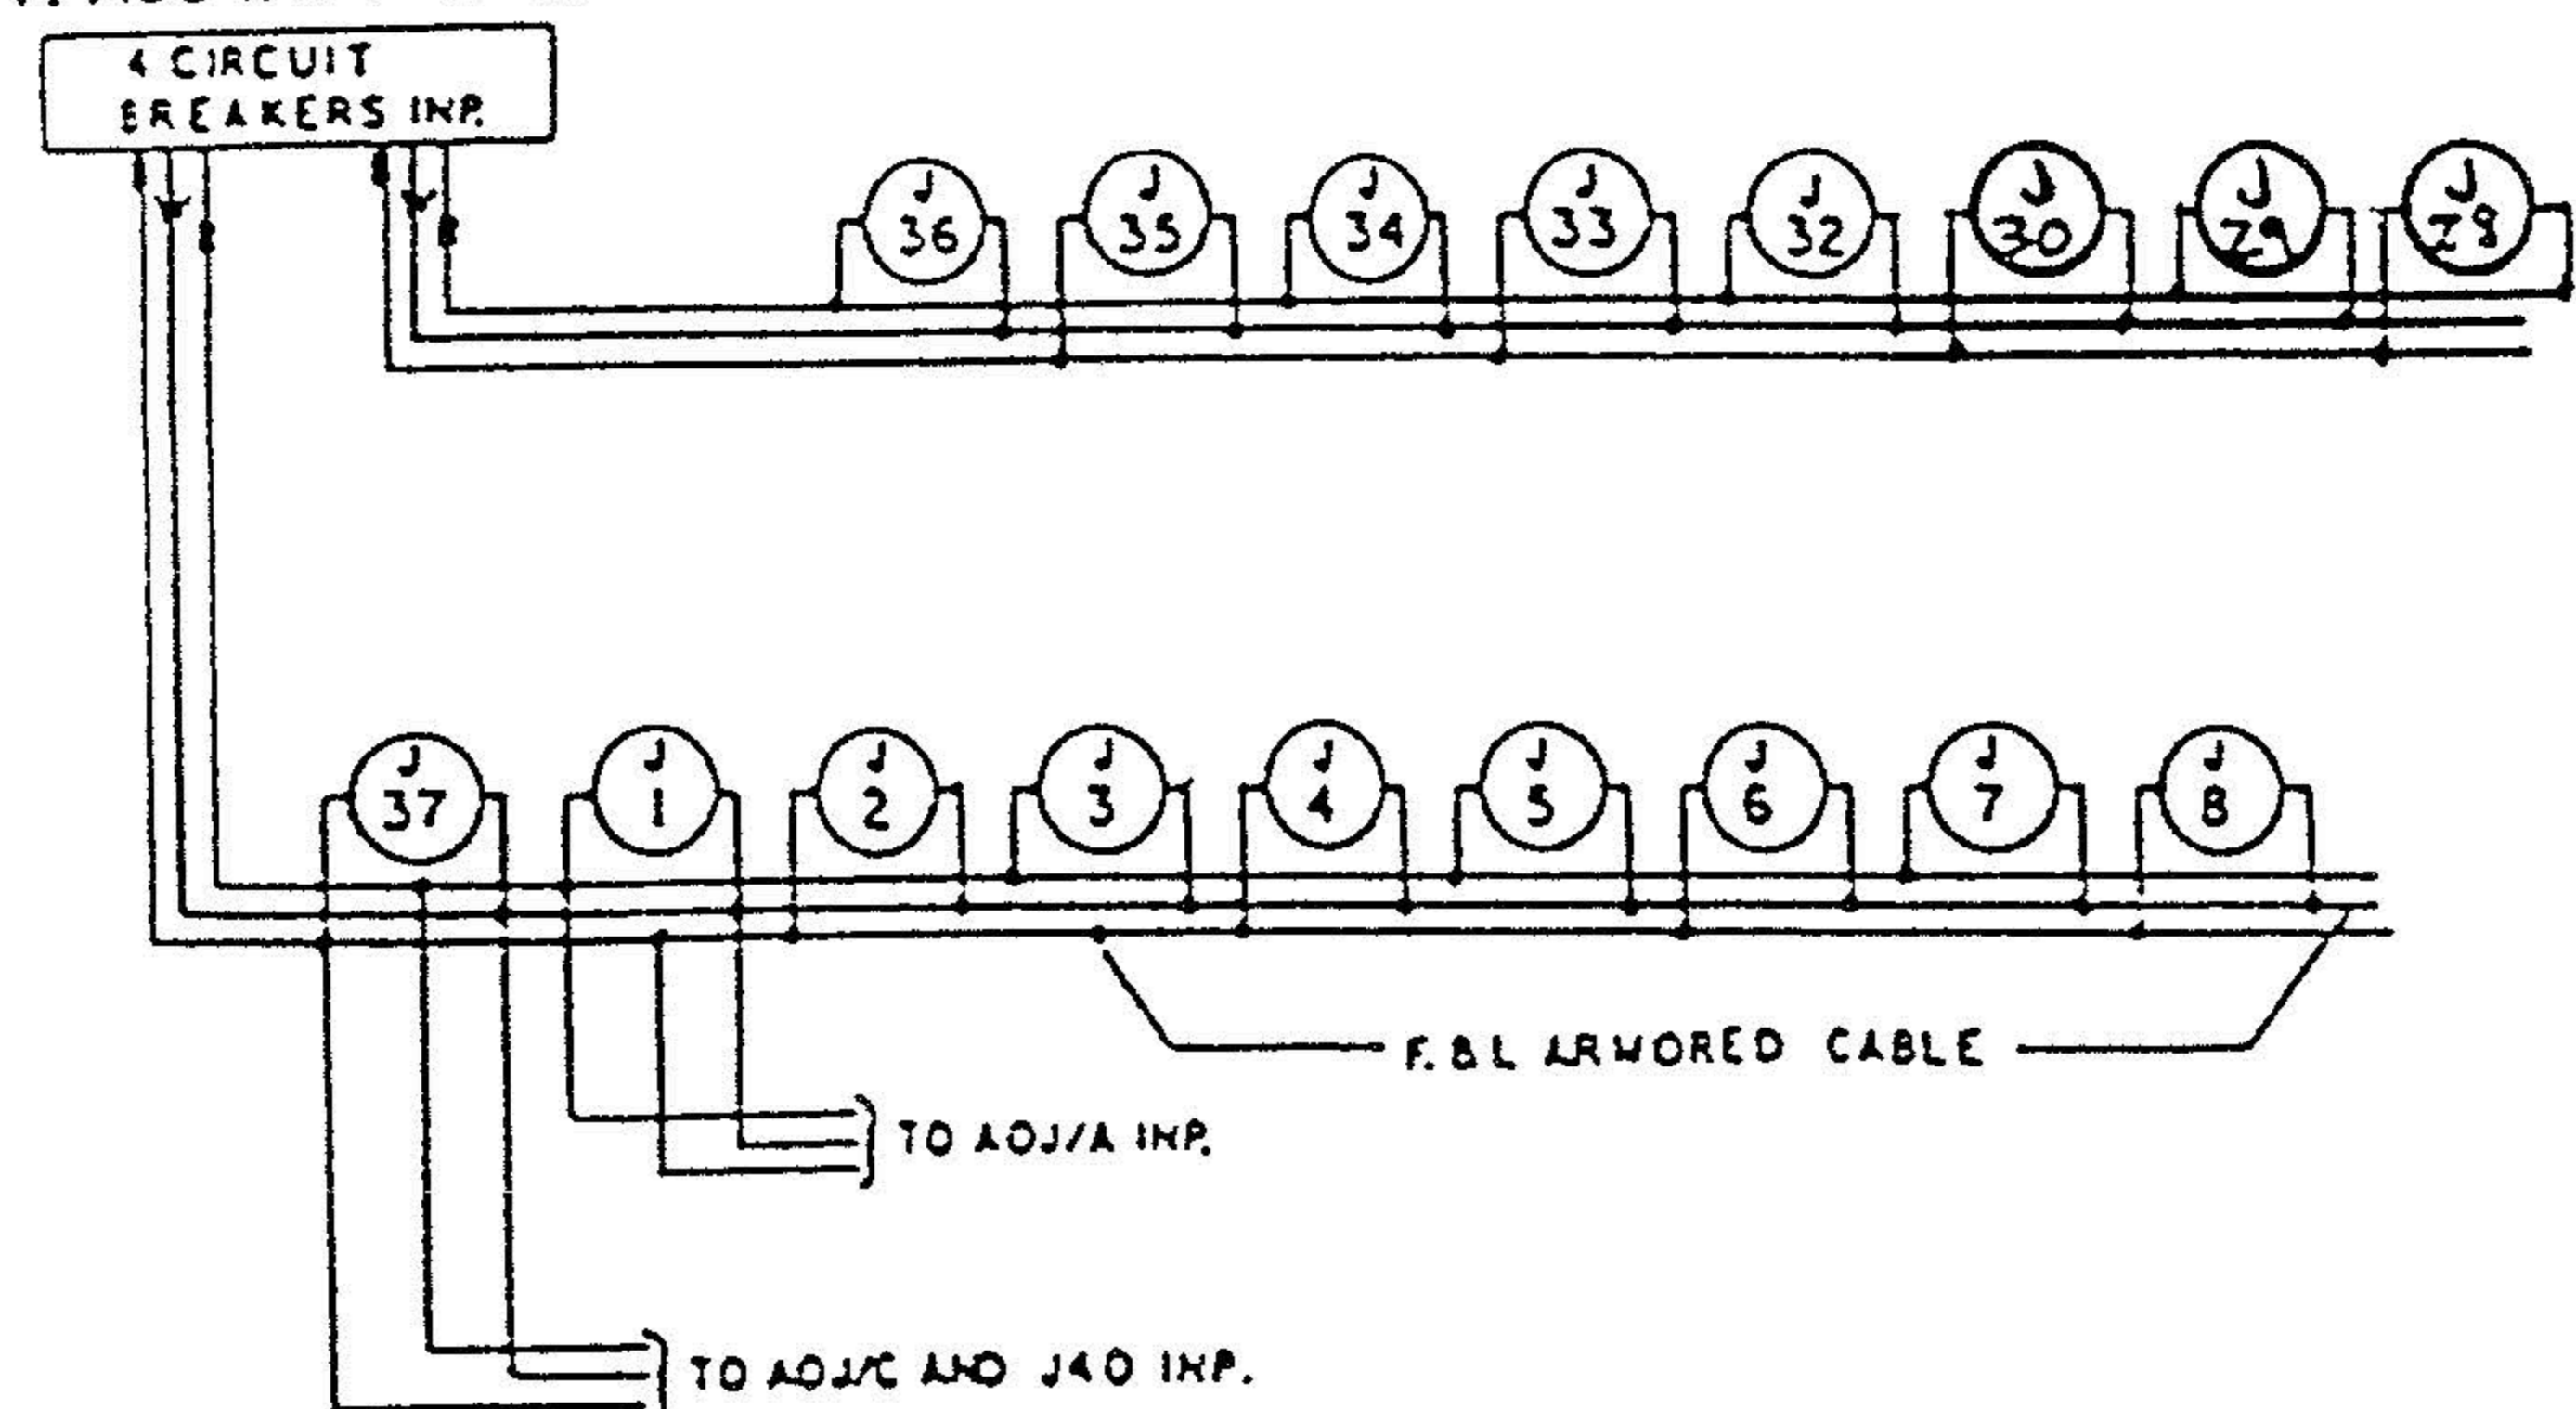

B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

FD. PT. AOJ INP., 240/480 V.

LIGHT STANDARD LOCATIONS					
NO.	STATION	LT.	RT.	LOCATION	TYPE
1	E.B. 594+60 IMP.	-	-	T.H. 94	9-40
2	E.B. 597+00 IMP.	-	-	T.H. 94	9-40
3	2+23 IMP.	-	-	SW RAMP	6-40
4	E.B. 599+80	-	-	T.H. 94	9-40
(1)	5 E.B. 602+30	-	-	T.H. 94	9-40
(1)	6 E.B. 604+70	-	-	T.H. 94	9-40
(1)	7 E.B. 607+10	-	-	T.H. 94	9-40
(1)	8 E.B. 609+60	-	-	T.H. 94	9-40
	32 W.B. 610+00 IMP.	-	-	T.H. 94	9-40
	33 W.B. 607+20 IMP.	-	-	T.H. 94	9-40
	34 W.B. 604+40 IMP.	-	-	T.H. 94	9-40
	35 W.B. 601+60 IMP.	-	-	T.H. 94	9-40
	36 W.B. 597+20 IMP.	-	-	T.H. 94	9-40
	37 W.B. 596+80 IMP.	-	-	T.H. 94	9-40
29	AS SHOWN	-	-	NW RAMP EDG	6-40
30	AS SHOWN	-	-	NW RAMP EDG	6-40

LOCATE LIGHT STANDARD 8" BEHIND EDGE OF SHOULDER OR AS DIRECTED BY THE ENGINEER
LIGHT AOJ/40 IS GROUND MOUNTED FOR WELCOME TO MINNESOTA SIGN
(1) INSTALL SALVAGED LIGHTING UNIT


NOTE: 
LIGHTS ARE MAINTAINED BY THE CITY OF LAKELAND

CERTIFIED COPY
MAY 08 1996


T.H. 94 & T.H. 95
IN LAKELAND

FD.PTS. AOJ,AOF,AOG

State Proj. No. 8282-82

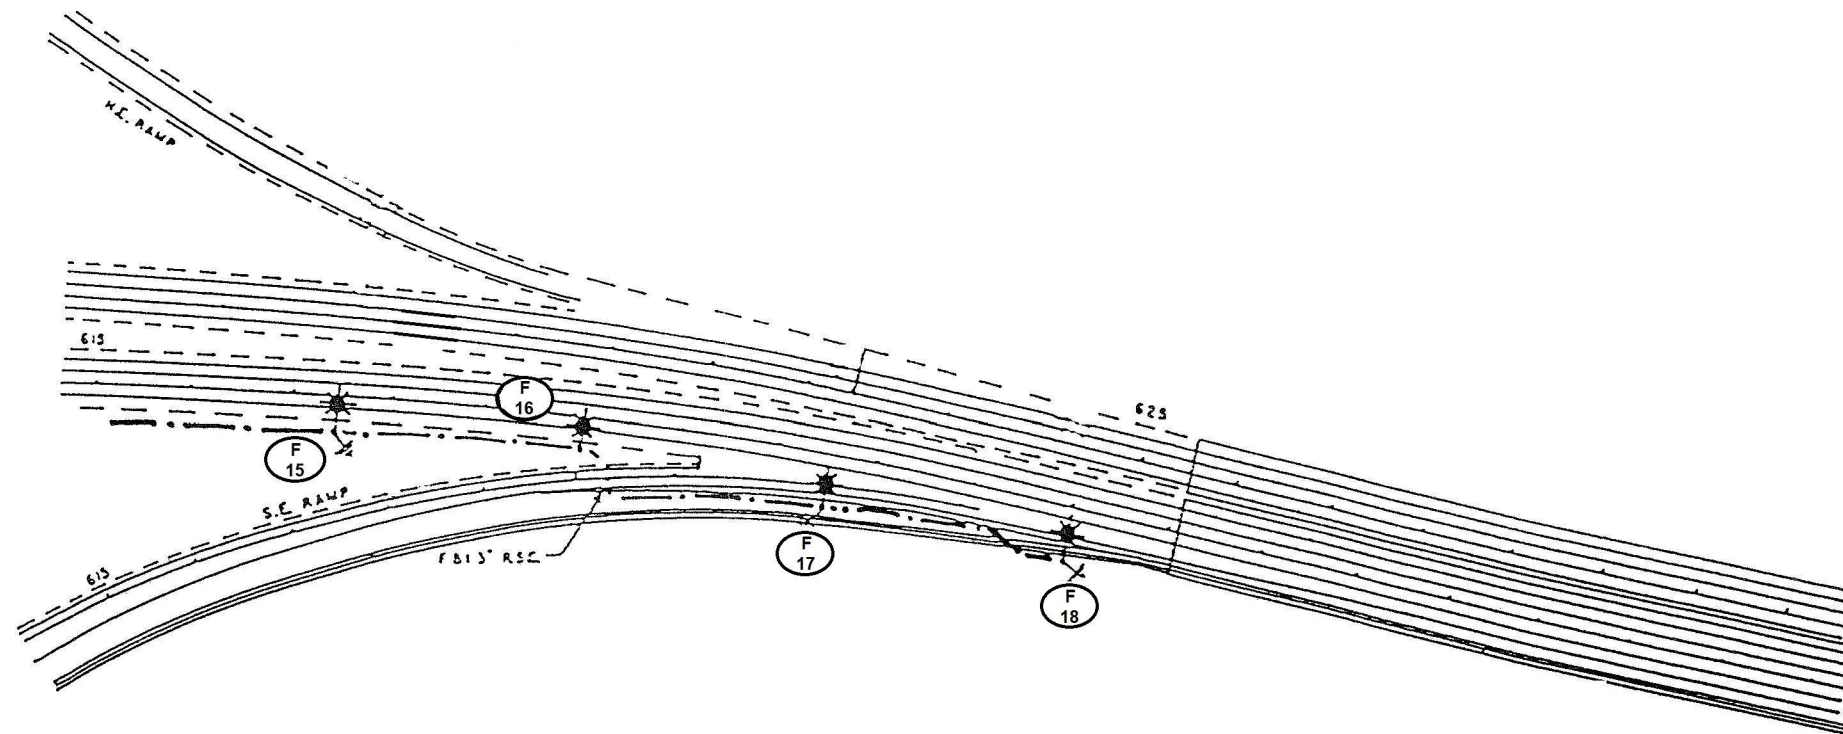

F.D. PT. A00F, 240/480V

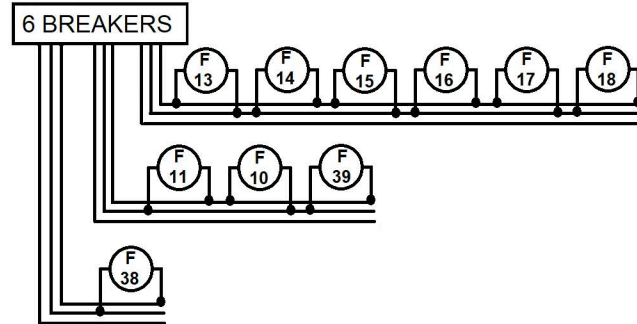

B AND R DENOTES CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

FEEDPOINT A00F
LIGHTING STANDARDS AND FOUNDATIONS

NO.	STATION	LT.	RT.	LOCATION	TYPE
10	0+70		X	SE RAMP	9-40
11	2+70		X	SE RAMP	9-40
13	EB 612+30		X	TH 94	9-40
14	EB 614+90		X	TH 94	9-40
15	EB 617+40		X	TH 94	9-40
16	EB 620+00		X	TH 94	9-40
17	EB 622+43		X	TH 94	9-40
18	EB 624+90		X	TH 94	9-40
38	SB 869+50	X		TH 95	9-40
39	NB 868+50		X	TH 95	9-40

E. RAMPS
T.H. 94 & T.H. 95
IN LAKELAND
N.S.P.

FD.PTS. A0F