
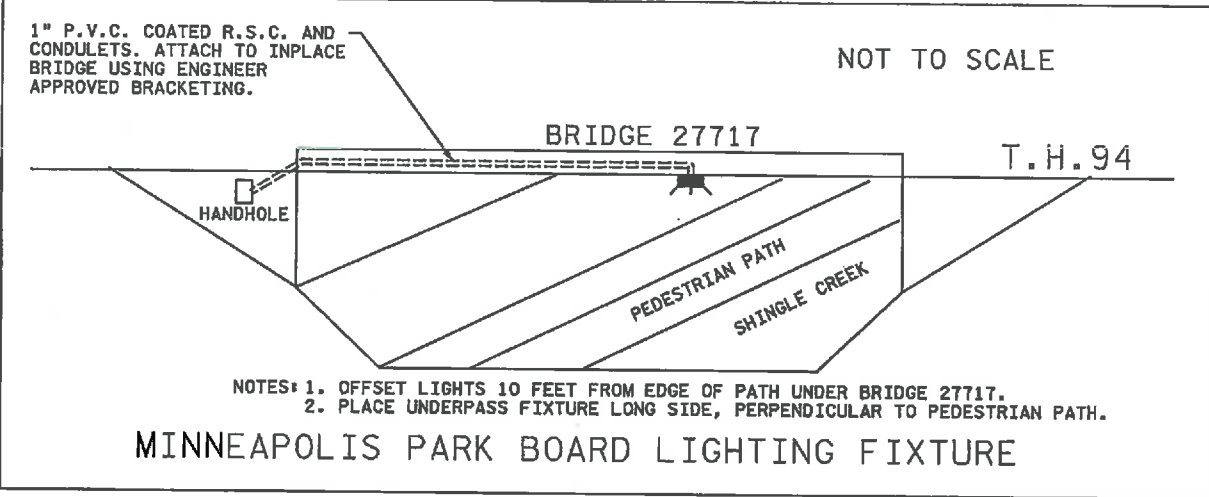


FD. PT. A08C  
 PAD MOUNTED SERVICE CABINET TYPE L1  
 240/480V (METERED)  
 EQUIPMENT PAD TYPE B REQUIRED  
 2\"/>



**LEGEND**

	PAD MOUNTED SERVICE CABINET
	DIRECT BURIED LIGHTING CABLE 4 COND. NO. 4
	3\"/>
	LIGHTING UNIT TYPE 9-49
	LIGHTING UNIT TYPE SPECIAL
	UNDERPASS LIGHTING UNIT (MINNEAPOLIS PARK BOARD LIGHTING FIXTURE)
	INPLACE UNDERPASS LIGHTING UNIT
	HANDHOLE
	INPLACE HANDHOLE
	GROUND ROD
	INPLACE CONDUIT

11/24/17 54 PM  
 C:\Projects\2016\160068\DESIGN\Plan Sheets\02781432\_11150.dwg

NO	DATE	DWN	CKD	REVISIONS
0	10/24/16	AKF	JJB	



I HEREBY CERTIFY THAT THIS SHEET WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.

PRINT NAME: MICHAEL P. MCCURDY  
 SIGNATURE: *Michael P. McCurdy*  
 DATE: 10/24/16      LICENSE #: 45902

PROPOSED LIGHTING SYSTEM


FEED POINT A08C

A08C METER ADDRESS: 4210 LYNDAL AVE. N., MINNEAPOLIS 55412

**SP 2781-432 (T.H. 94)**  
 SHEET NO. SL47 OF SL71 SHEETS

FEEDPOINT A08C  
LIGHTING STANDARDS AND BASES

NO.	STATION	LT.	RT.	LOCATION	TYPE	LUMINAIRE
1	296+70		-	T.H. 94 MED	9-49	49-FOOT
2	298+59		-	T.H. 94 MED	UNDERPASS (INPLACE)	
3	299+24		-	T.H. 94 MED	9-49 ⑦	49-FOOT
4	301+79		-	T.H. 94 MED	9-49 ⑦	49-FOOT
5	304+40		-	T.H. 94 MED	9-49 ⑦	49-FOOT
6	306+44		-	T.H. 94 MED	UNDERPASS (INPLACE)	
7	307+04		-	T.H. 94 MED	9-49 ⑦	49-FOOT
8	309+13		-	T.H. 94 MED	9-49 ⑦	49-FOOT
9	311+23		-	T.H. 94 MED	9-49 ⑦	49-FOOT
10	313+29		-	T.H. 94 MED	9-49 ⑦	49-FOOT
11	315+95		-	T.H. 94 MED	9-49 ⑦	49-FOOT
12	318+57		-	T.H. 94 MED	9-49 ⑦	49-FOOT
13	321+09		-	T.H. 94 MED	9-49 ⑦	49-FOOT
14	323+61		-	T.H. 94 MED	9-49 ⑦	49-FOOT
15	323+99	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
16	321+25	-	-	T.H. 94 MED	9-49	49-FOOT
17	318+53	-	-	T.H. 94 MED	9-49	49-FOOT
18	315+83	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
19	313+37	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
20	311+29	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
21	309+15	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
22	307+41	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
23	306+44	-	-	T.H. 94 MED	UNDERPASS (INPLACE)	
24	305+08	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
25	302+62	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
26	300+17	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
27	298+60	-	-	T.H. 94 MED	UNDERPASS (INPLACE)	
28	297+68	-	-	T.H. 94 MED	9-49 ⑦	49-FOOT
29	295+18	-	-	T.H. 94 MED	9-49	49-FOOT
30	314+84			PED_PATHA	UNDERPASS ④	LED
31	314+84			PED_PATHA	UNDERPASS ④	LED
32	314+83			PED_PATHA	UNDERPASS ④	LED
33	314+83			PED_PATHA	UNDERPASS ④	LED
34	325+68			PED_PATHF	UNDERPASS ④	LED
35	325+51			PED_PATHF	UNDERPASS ④	LED
36	325+33			PED_PATHF	UNDERPASS ④	LED
37	325+16			PED_PATHF	UNDERPASS ④	LED

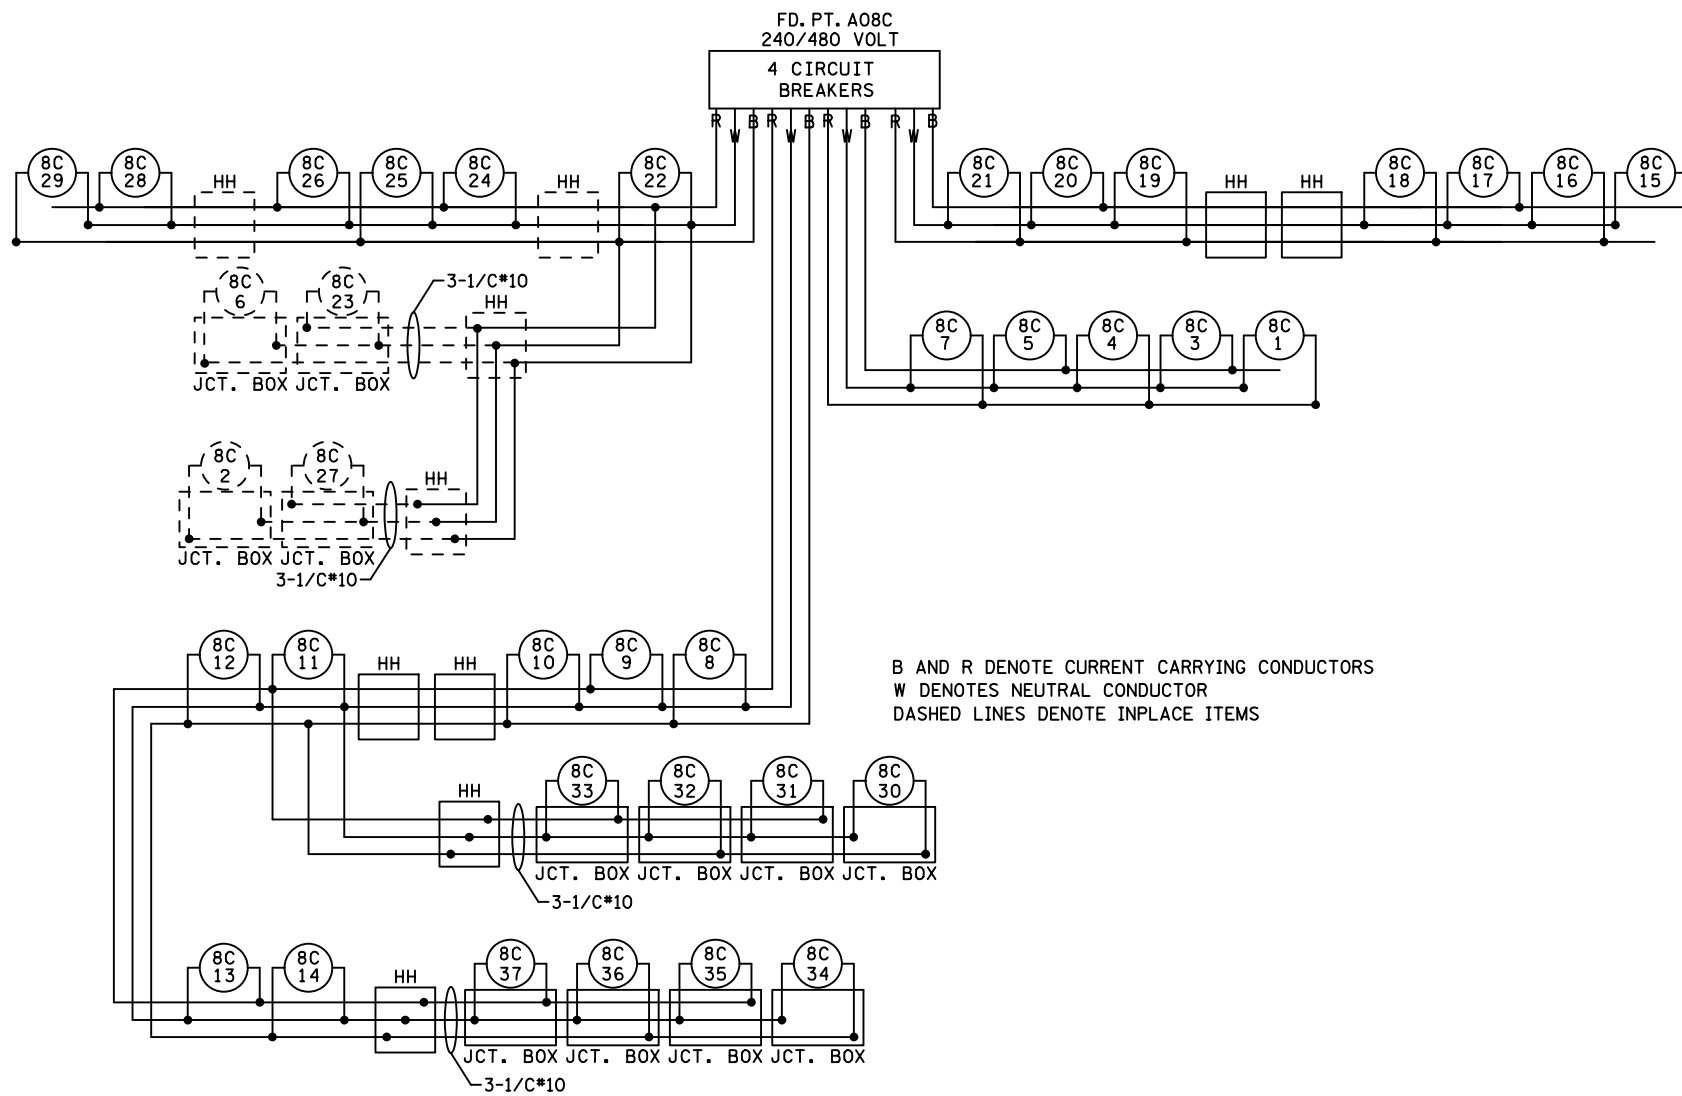

GENERAL NOTE:

1. INSTALL SALVAGED LUMINAIRES, UNLESS OTHERWISE NOTED.

SPECIFIC NOTES:

- ④ MINNEAPOLIS PARK BOARD LIGHT FIXTURE
- ⑦ TURN LIGHTING UNIT ACCESS DOOR AWAY FROM OBSTRUCTION.

FEED POINT A08C

PROPOSED LIGHTING SYSTEM

SP 2781-432 (T.H. 94)  
SHEET NO. SL48 OF SL71 SHEETS





12:51:31 AM 10/25/2016 C:\Users\2016\160069\DESIGN\Plan Sheets\02781432\_11151.dgn

NO	DATE	DWN	CKD	REVISIONS
0	10/24/16	AKF	JUG	



I HEREBY CERTIFY THAT THIS SHEET WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.

PRINT NAME: MICHAEL P. MCCURDY  
SIGNATURE: *Michael P. McCurdy*  
DATE: 10/24/16 LICENSE #: 45902

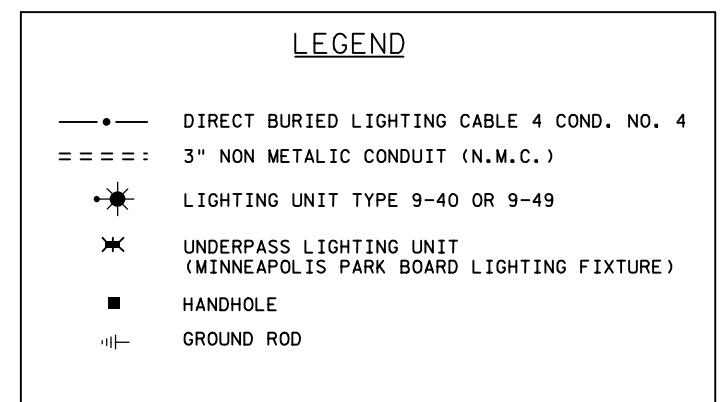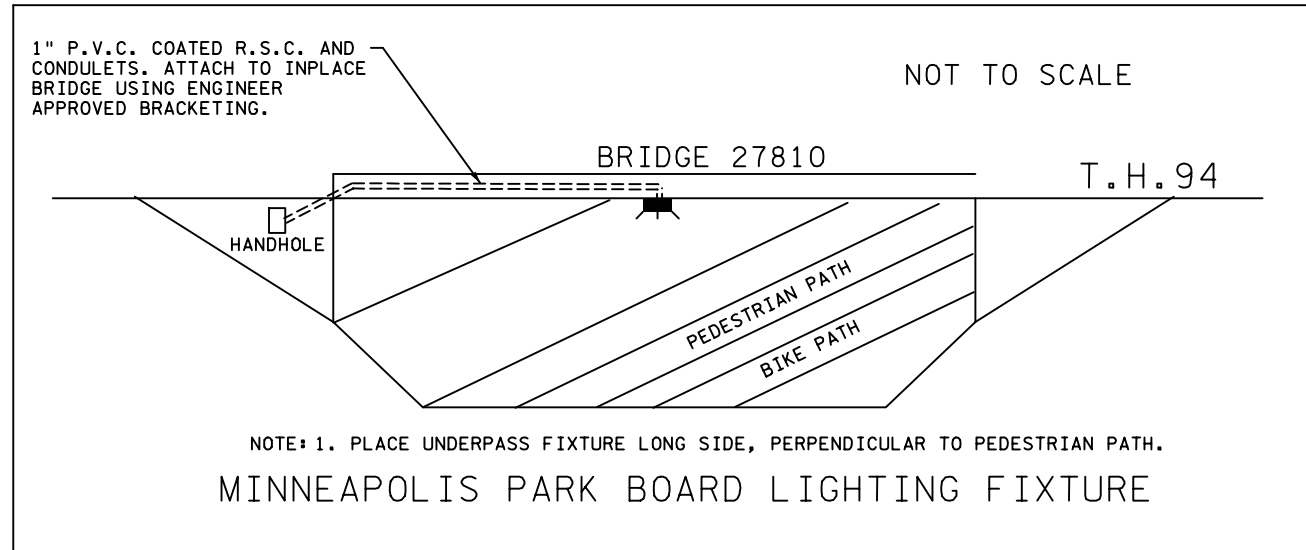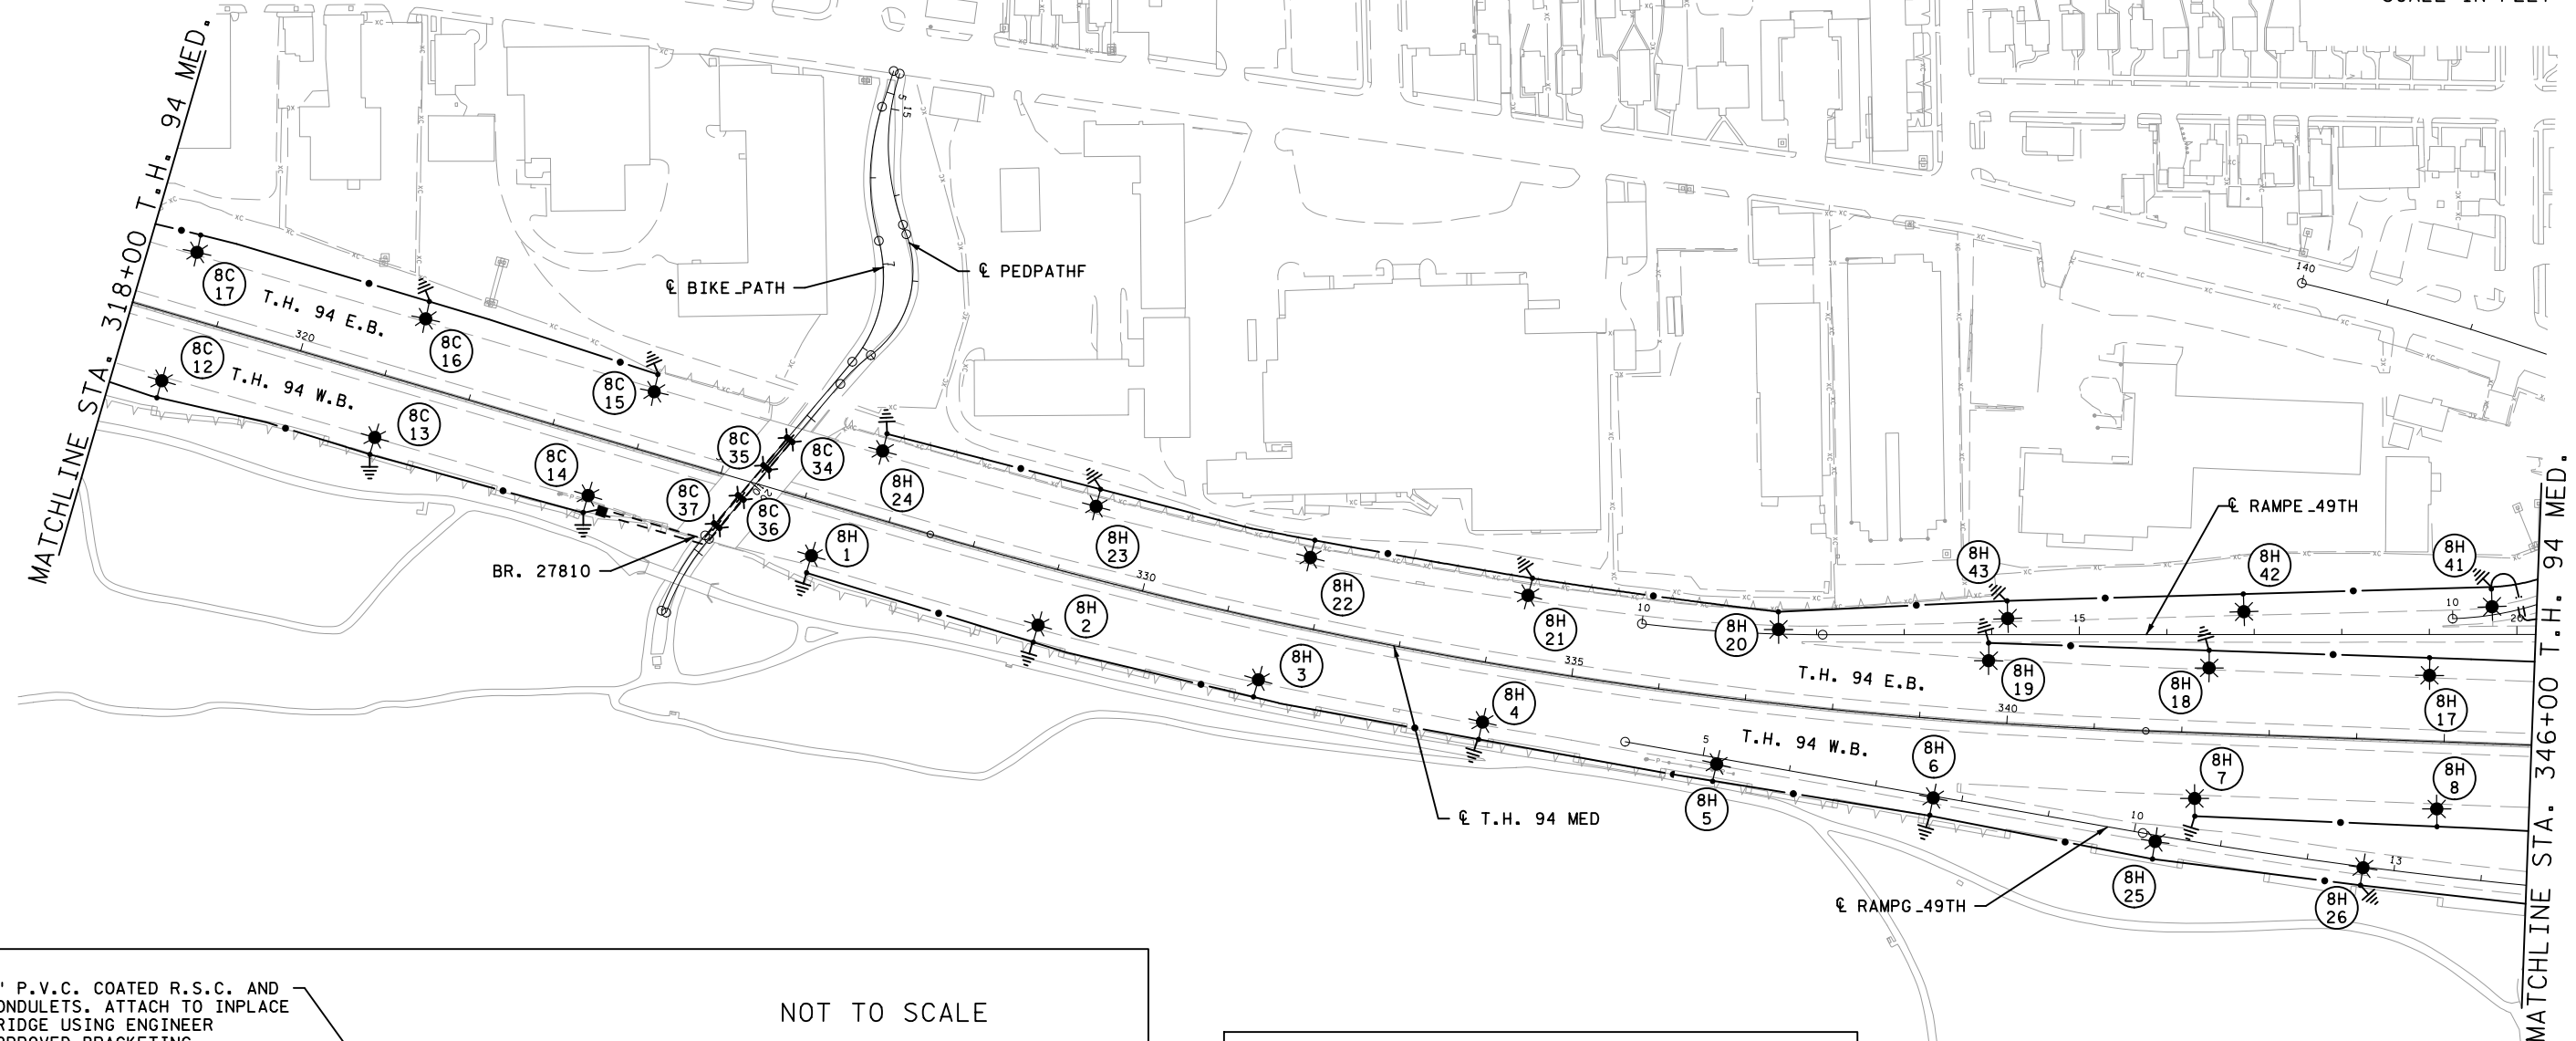

FEED POINT A08H

PROPOSED LIGHTING SYSTEM

SP 2781-432 (T.H. 94)  
SHEET NO. SL49 OF SL71 SHEETS

2:30:32 PM 11/16/2016 C:\Users\160069\Documents\DESIGN\Projects\2016\160069\DESIGN\VP\cn Sheets\02781432\_11155.dgn

0	10/24/16	AKF	JUG	
NO	DATE	DWN	CKD	REVISIONS



I HEREBY CERTIFY THAT THIS SHEET WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.

PRINT NAME: MICHAEL P. MCCURDY  
SIGNATURE: *Michael P. McCurdy*  
DATE: 10/24/16 LICENSE #: 45902