


FD. PT. E5A, 240/480 V.

LIGHTING STANDARDS & BASES					
NO.	STATION	LT.	RT.	LOCATION	TYPE
1	511+60	—	—	NB 35E2	6P-40 MOD
2	514+20	—	—	NB 35E2	6P-40 MOD
3	84+00	—	—	LANE W-N	6P-40 MOD
4	86+60	—	—	LANE W-N	6P-40 MOD
5	87+85	—	—	LANE W-N	6P-40 MOD
6	91+00	—	—	LANE W-N	6P-40 MOD
11	25+90	—	—	W.B. TH 94	6P-40 MOD
12	29+10	—	—	W.B. TH 94	6P-40 MOD
13	30+40	—	—	W.B. TH 94	6P-40 MOD
14	33+00	—	—	W.B. TH 94	6P-40 MOD
15	34+15	—	—	W.B. TH 94	6P-40 MOD
16	511+70	—	—	W.B. TH 94	6P-40 MOD
17	509+90	—	—	SB 35E2	6P-40 MOD
18	507+90	—	—	SB 35E2	6P-40 MOD
(1)	19	—	—	—	—
(1)	24	512+80	—	NB 35E 2	6DP-40 MOD
(1)	20	85+20	—	LANE W-N	6DP-40 MOD
(1)	21	89+40	—	LANE W-N	6DP-40 MOD
(1)	22	—	—	—	—

(1) DESIGN E LIGHT BASE. 6 BOLT ANCHORAGE

FD. PT. E5A, 240/480 V.

DRAWING NOT TO SCALE

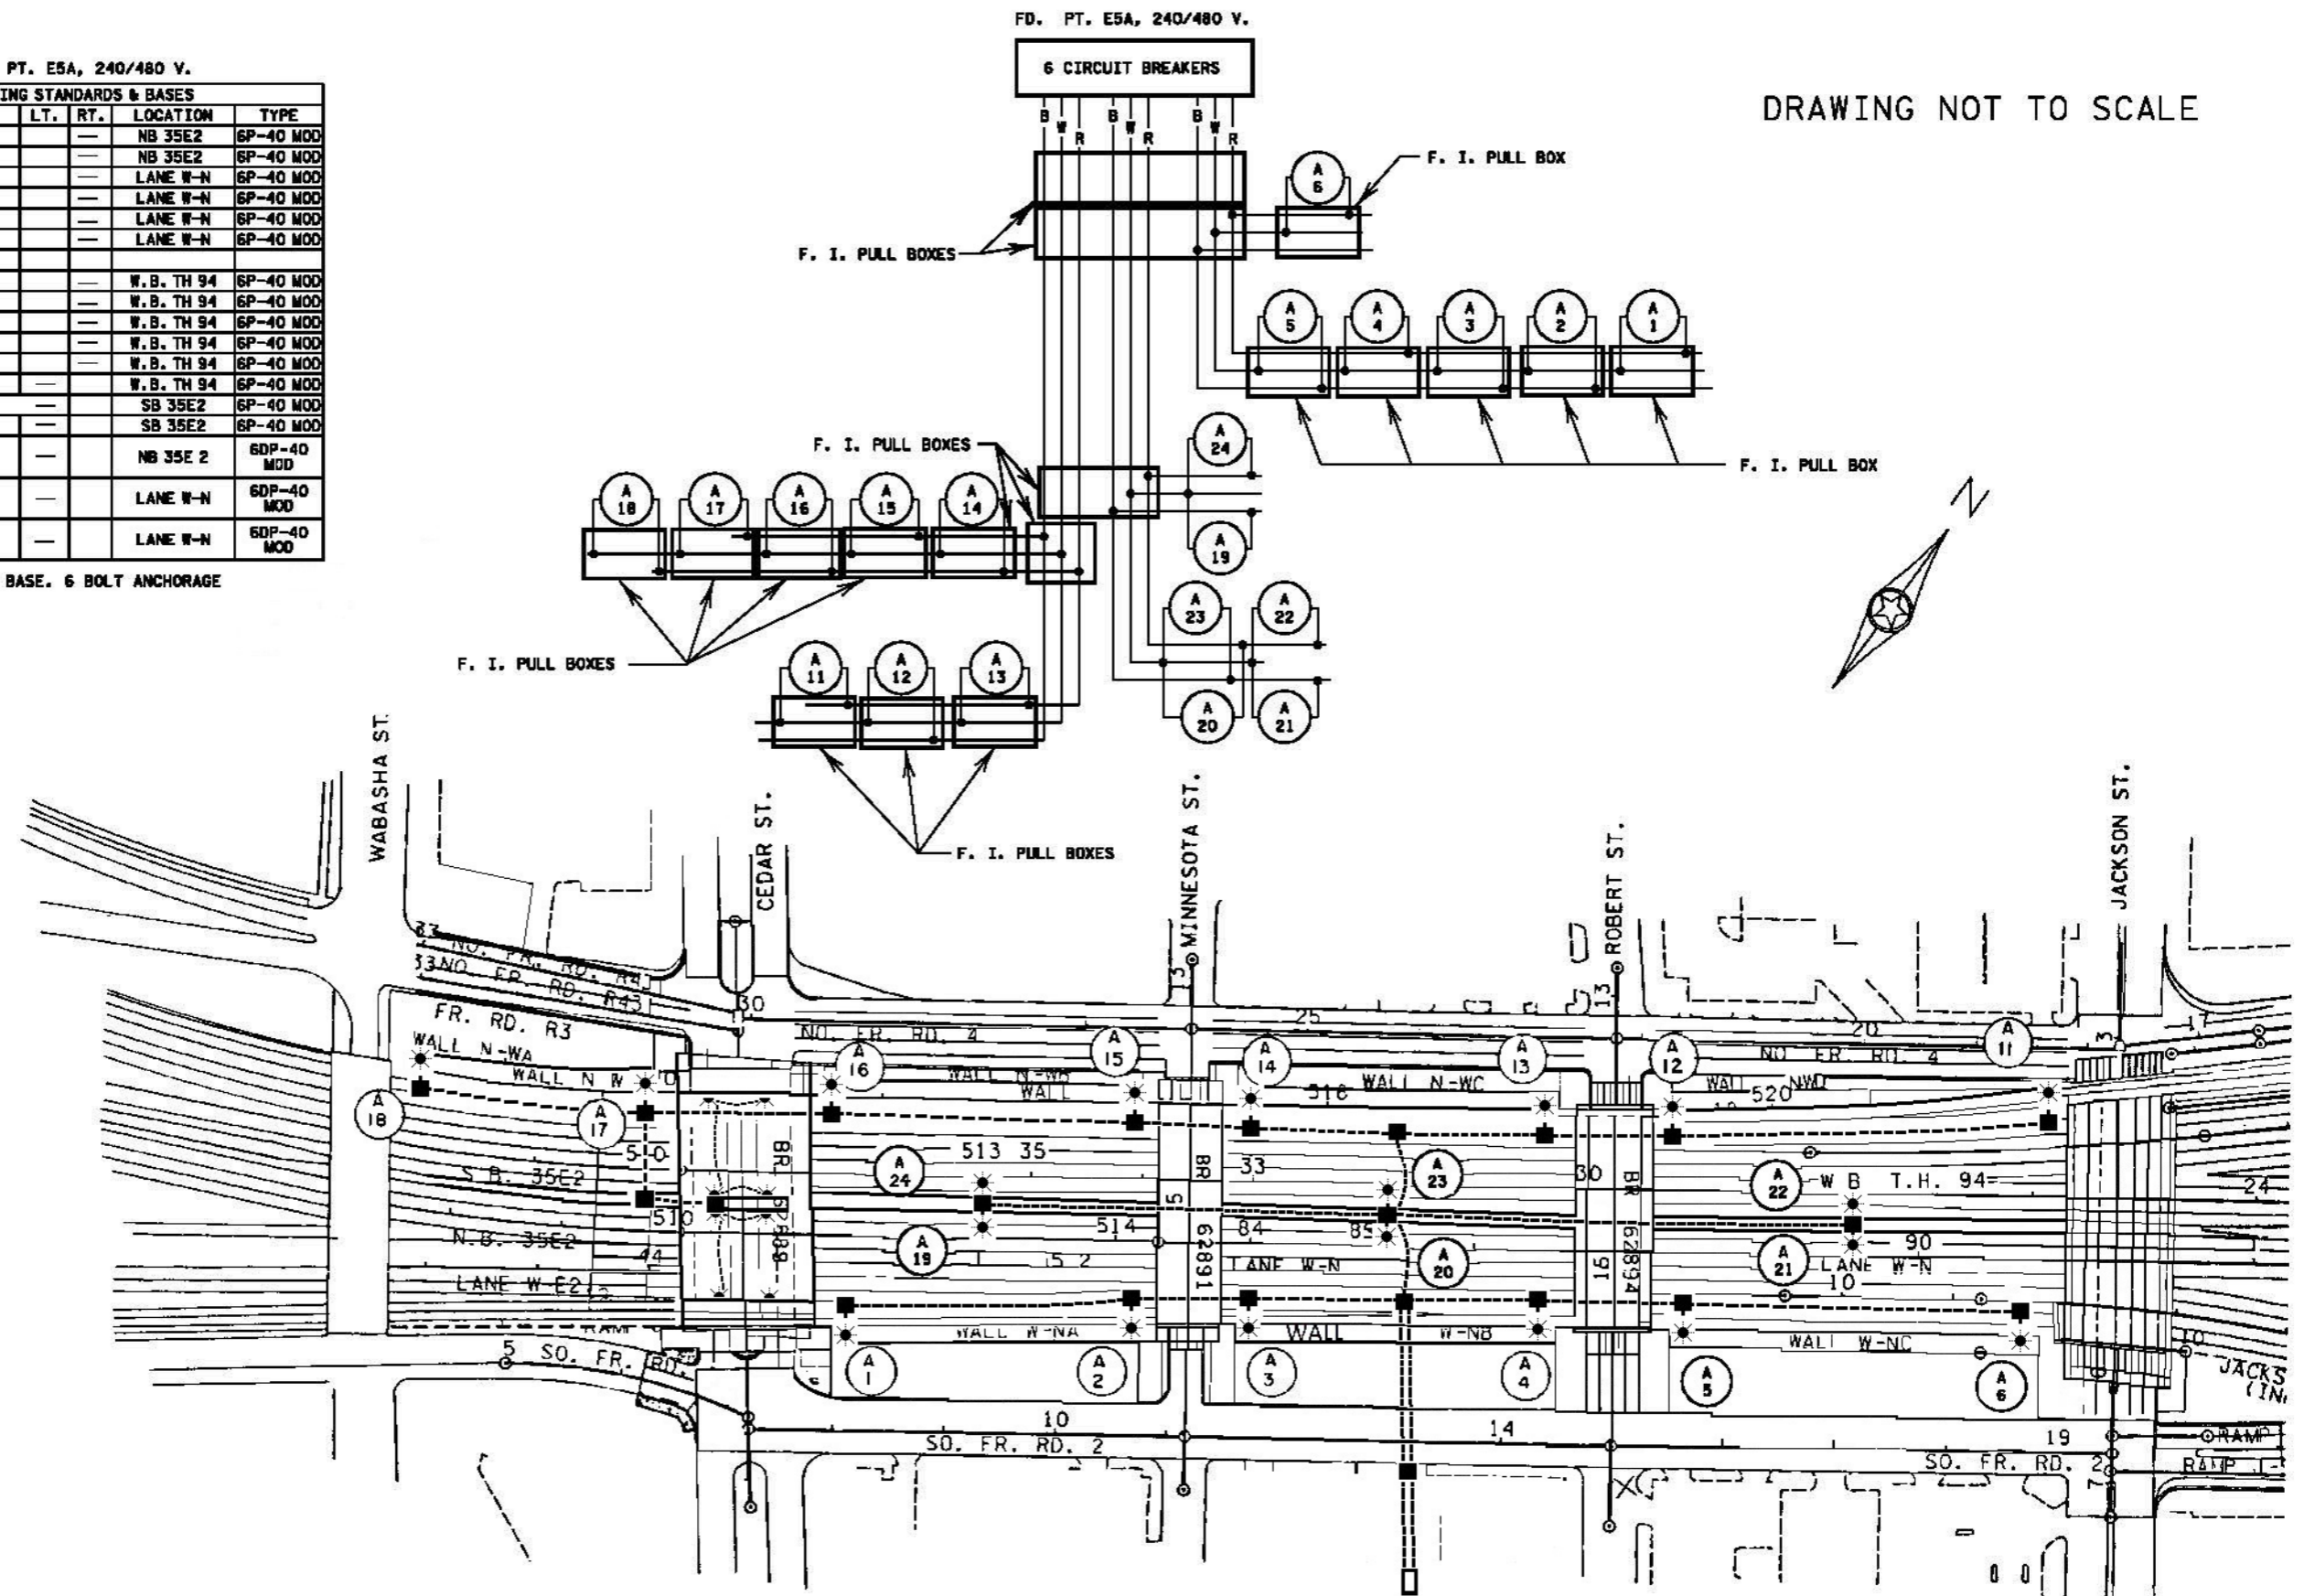

S.O.P. 240/480 V. FD. PT. E5A
Service Cabinet TYPE L1

METER ADDRESS: E5A - 49 27th AVE SE MINNEAPOLIS 55414

T.H. 94 - WABASHA ST TO JACKSON ST
FEEDPOINT E5A

CERTIFIED BY _____ LIC. NO. _____
LICENSED PROFESSIONAL ENGINEER

State Proj. No.

Sheet No. 1 of 1 Sheets