


SHEET TOTAL

- 18 - 250 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
- 6 - 200 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
- 2 - 200 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHTS
- 12 - 175 WATT MERCURY VAPOR SIGN LIGHTS

FD. PT. F3S

LIGHTING STANDARDS AND BASES					
NO.	STATION	LT.	RT.	LOCATION	TYPE
(1)	1	454+30	-	T.H. 10 E.B.L.	L
(1)	20	454+30	-	T.H. 10 W.B.L.	L
(2)	2	456+25		T.H. 10	680-49
	19	456+25		MEDIAN BARRIER	
(2)	3	459+75		T.H. 10	680-49
	18	459+75		MEDIAN BARRIER	
(2)	4	463+25		T.H. 10	680-49
	17	463+25		MEDIAN BARRIER	
(2)	5	466+75		T.H. 10	680-49
	16	466+75		MEDIAN BARRIER	
(2)	6	469+75		T.H. 10	680-49
	15	469+75		MEDIAN BARRIER	
(2)	7	472+75		T.H. 10	680-49
	14	472+75		MEDIAN BARRIER	
(2)	8	475+75		T.H. 10	680-49
	13	475+75		MEDIAN BARRIER	
(2)	9	478+75		T.H. 10	680-49
	12	478+75		MEDIAN BARRIER	
(2)	10	481+75		T.H. 10	680-49
	11	481+75		MEDIAN BARRIER	
(3)	21	465+25	-	T.H. 47 S.B.L.	9-40
(3)	22	468+25	-	T.H. 47 S.B.L.	9-40
(3)	23	471+25	-	T.H. 47 S.B.L.	9-40
(3)	24	474+25	-	T.H. 47 S.B.L.	9-40
(3)	25	477+25	-	T.H. 47 S.B.L.	9-40
(3)	26	480+25	-	T.H. 47 S.B.L.	9-40


- (1) 200 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHT
- (2) LIGHT ANCHORAGE INSTALLED IN S.P. 0214-11
- (3) PLACE LIGHTING UNITS 9' BEHIND BIT. SHOULDER OR AS DIRECTED BY THE ENGINEER

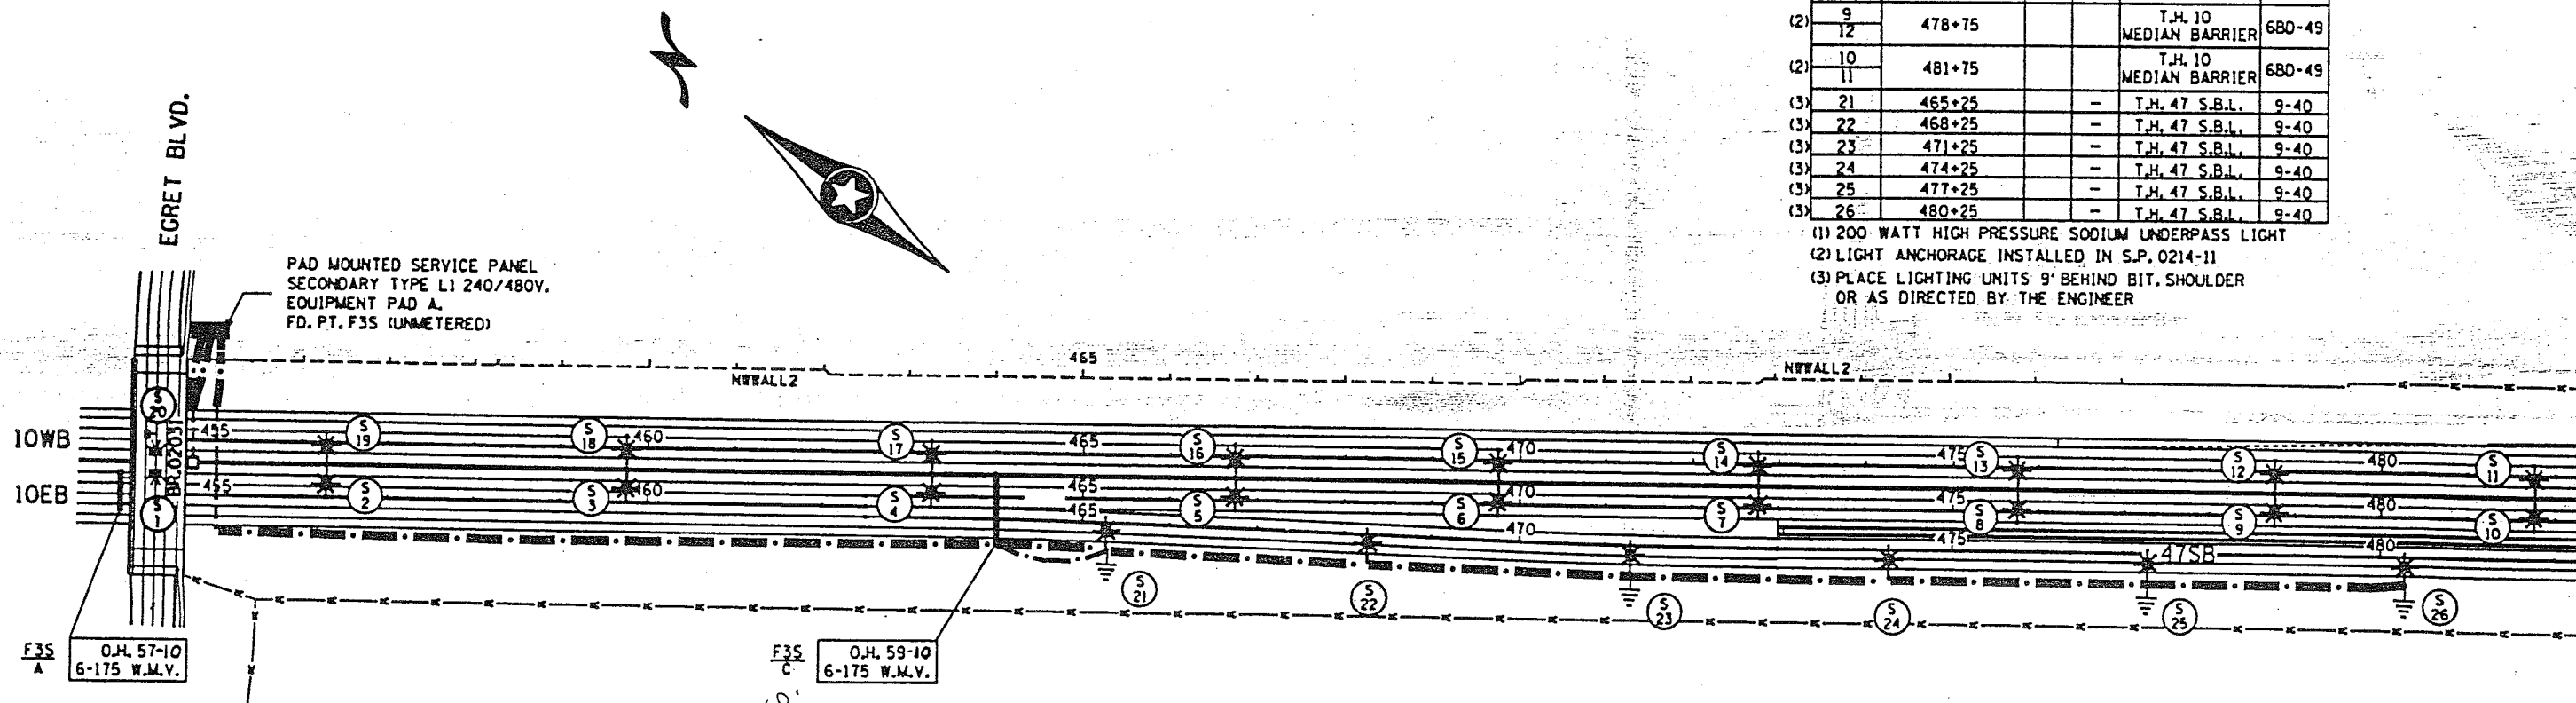

PAD MOUNTED SERVICE PANEL
SECONDARY TYPE LI 240/480V.
EQUIPMENT PAD A.
FD. PT. F3S (UNMETERED)

F3S
A
O.H. 57-10
6-175 W.M.V.

F3S
C
O.H. 59-10
6-175 W.M.V.

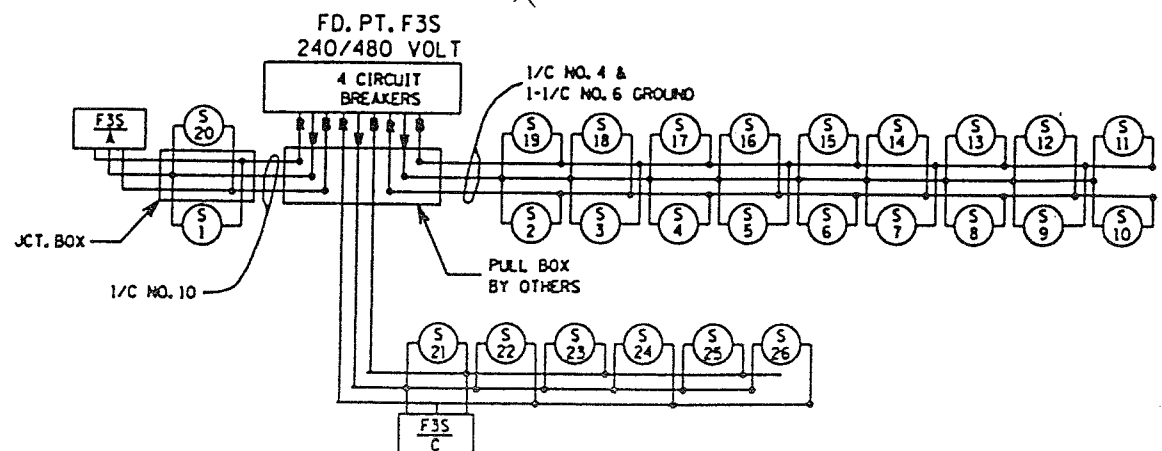

B & R DENOTE CURRENT CARRYING CONDUCTORS
N DENOTES NEUTRAL CONDUCTORS

CERTIFIED COPY

EXHIBIT 17
T.H. 10 & EGRET BLVD.
IN COON RAPIDS
ANOKA ELECTRIC CO-OP

FD. PT. F3S