


| FD PT F4H<br>LIGHTING STANDARDS & BASES |         |       |                |      |
|---|---------|-------|----------------|------|
| NO                                      | STATION | LT RT | LOCATION       | TYPE |
| 1                                       | 193+45  | -     | T.H. IO E.B.L. | 9-40 |
| 2                                       | 195+85  | -     | T.H. IO E.B.L. | 9-40 |
| 3                                       | 198+25  | -     | T.H. IO E.B.L. | 9-40 |
| 4                                       | 198+00  | -     | RAMP C         | 8-40 |
| 5                                       | 210+40  | -     | T.H. IO E.B.L. | 9-40 |
| 6                                       | 211+80  | -     | T.H. IO E.B.L. | 9-40 |
| 7                                       | 213+50  | -     | T.H. IO E.B.L. | 9-40 |
| 8                                       | 220+55  | -     | T.H. IO E.B.L. | 9-40 |
| 9                                       | 222+95  | -     | T.H. IO E.B.L. | 9-40 |
| 10                                      | 225+35  | -     | T.H. IO E.B.L. | 9-40 |
| 11                                      | 227+60  | -     | T.H. IO W.B.L. | 9-40 |
| 12                                      | 225+20  | -     | T.H. IO W.B.L. | 9-40 |

PLACE LIGHTING UNITS 8' BEHIND BIT. SHOULDER OR CURB

| FD PT F4H<br>LIGHTING STANDARDS & BASES |         |       |                |       |
|---|---------|-------|----------------|-------|
| NO                                      | STATION | LT RT | LOCATION       | TYPE  |
| 13                                      | 222+80  | -     | T.H. IO W.B.L. | 9-40  |
| 14                                      | 223+00  | -     | RAMP B         | 6-40  |
| 15                                      | 213+15  | -     | T.H. IO W.B.L. | 9-40  |
| 16                                      | 211+80  | -     | T.H. IO W.B.L. | 9-40  |
| 17                                      | 210+05  | -     | T.H. IO W.B.L. | 9-40  |
| 18                                      | 202+40  | -     | T.H. IO W.B.L. | 9-40  |
| 19                                      | 200+00  | -     | T.H. IO W.B.L. | 9-40  |
| 20                                      | 197+60  | -     | T.H. IO W.B.L. | 9-40  |
| 21                                      | 213+55  | -     | RAMP A         | 3R-30 |
| 22                                      | 199+50  | -     | LOOP C         | 3R-30 |
| 23                                      | 213+63  | -     | RAMP D         | 3R-30 |
| 24                                      | 223+20  | -     | LOOP B         | 3R-30 |

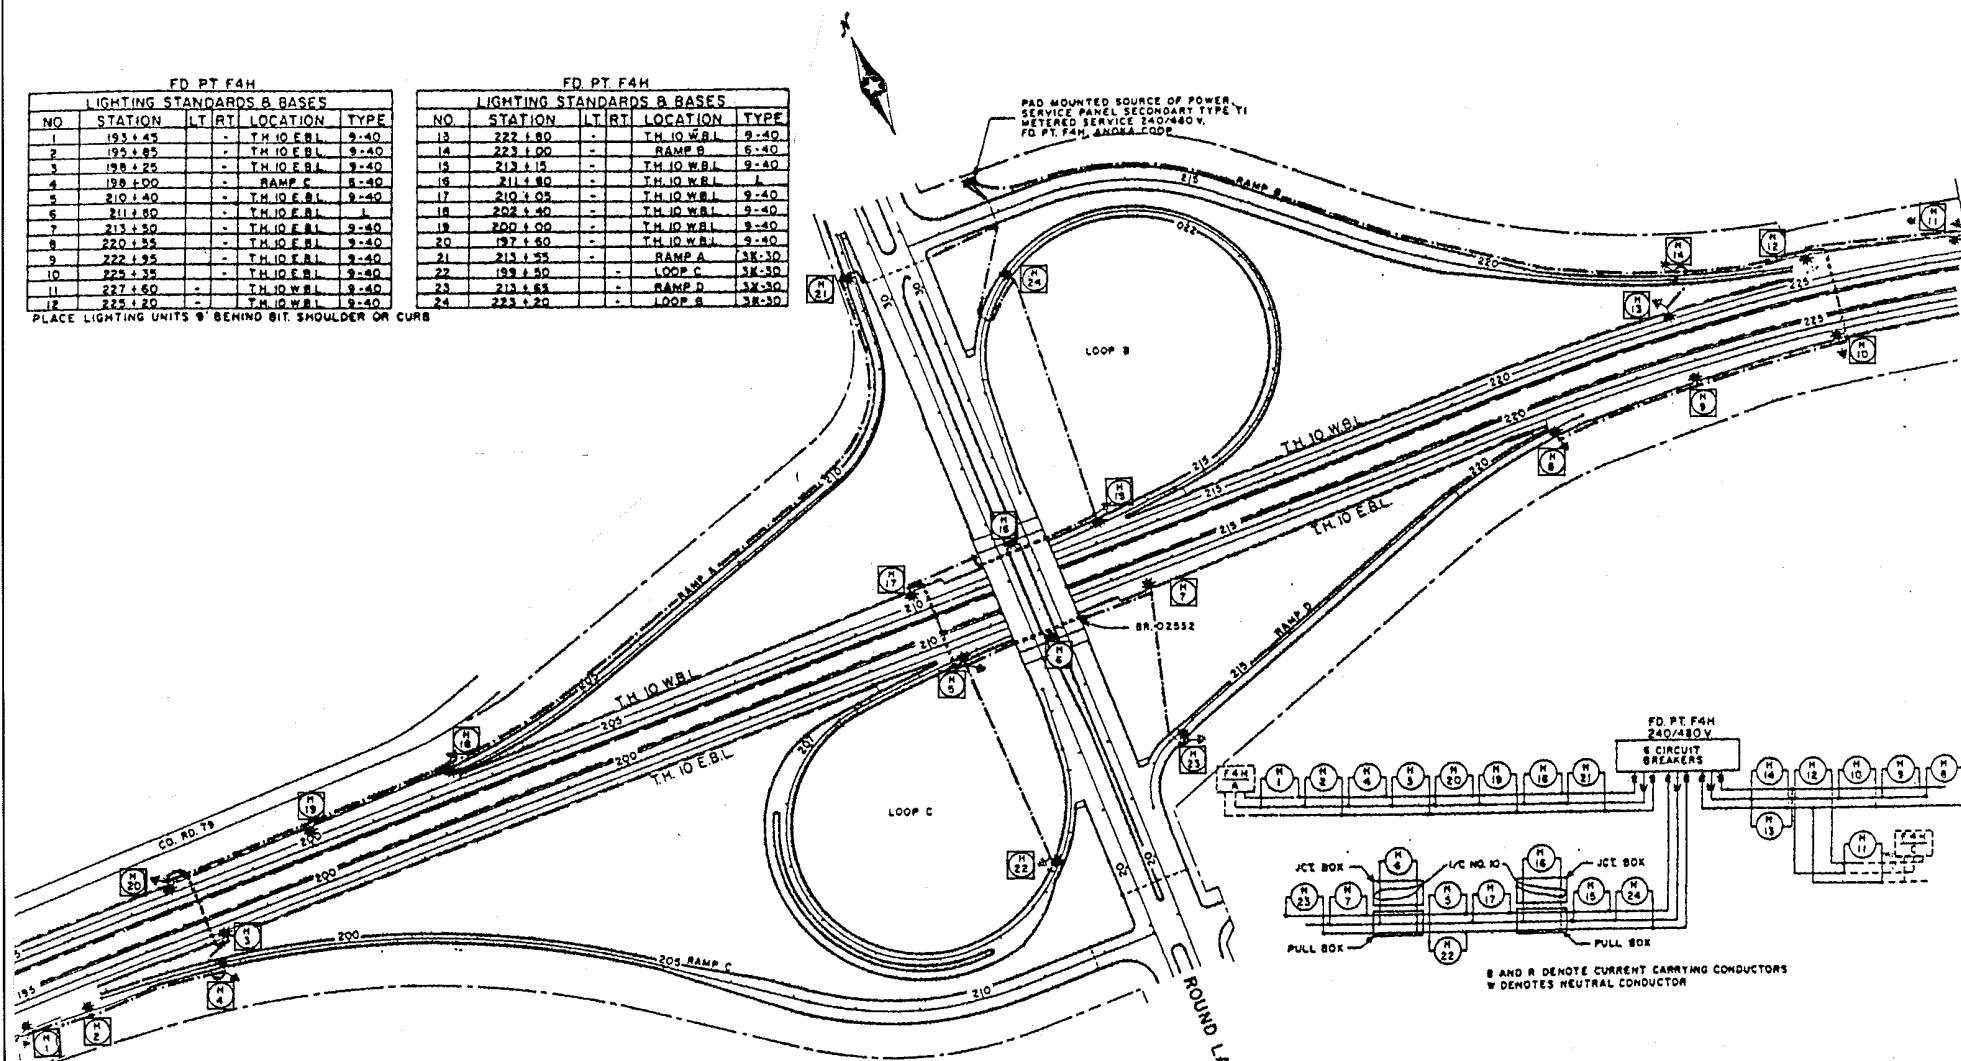

**TOTAL**  
 22 - 200 WATT HIGH PRESSURE SODIUM LIGHTING UNITS  
 2 - 200 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHTS

EXHIBIT 14 METERED  
 ROUNDLAKE BLVD. & T.H. 10  
 ANOKA ELEC. CO-OP.

FD. PT. F4H.