


B AND R DENOTE CURRENT CARRYING CONDUCTORS
 W DENOTES NEUTRAL CONDUCTOR
 DASHED LINES DENOTE BY OTHERS

FD. PT. F6C

LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
1	45+182	-	-	T.H. 610 W.B. 3-12
2	45+109	-	-	T.H. 610 W.B. 3-12
3	45+036	-	-	T.H. 610 W.B. 3-12
4	45+412	-	-	T.H. 610 E.B. 3-12
5	45+485	-	-	T.H. 610 E.B. 3-12
6	0+060	-	-	RAMP A 3-12
7	45+558	-	-	T.H. 610 E.B. 3-12

PLACE LIGHTING UNITS 3 m BEHIND SHOULDER OR CURB OR AS DIRECTED BY THE ENGINEER

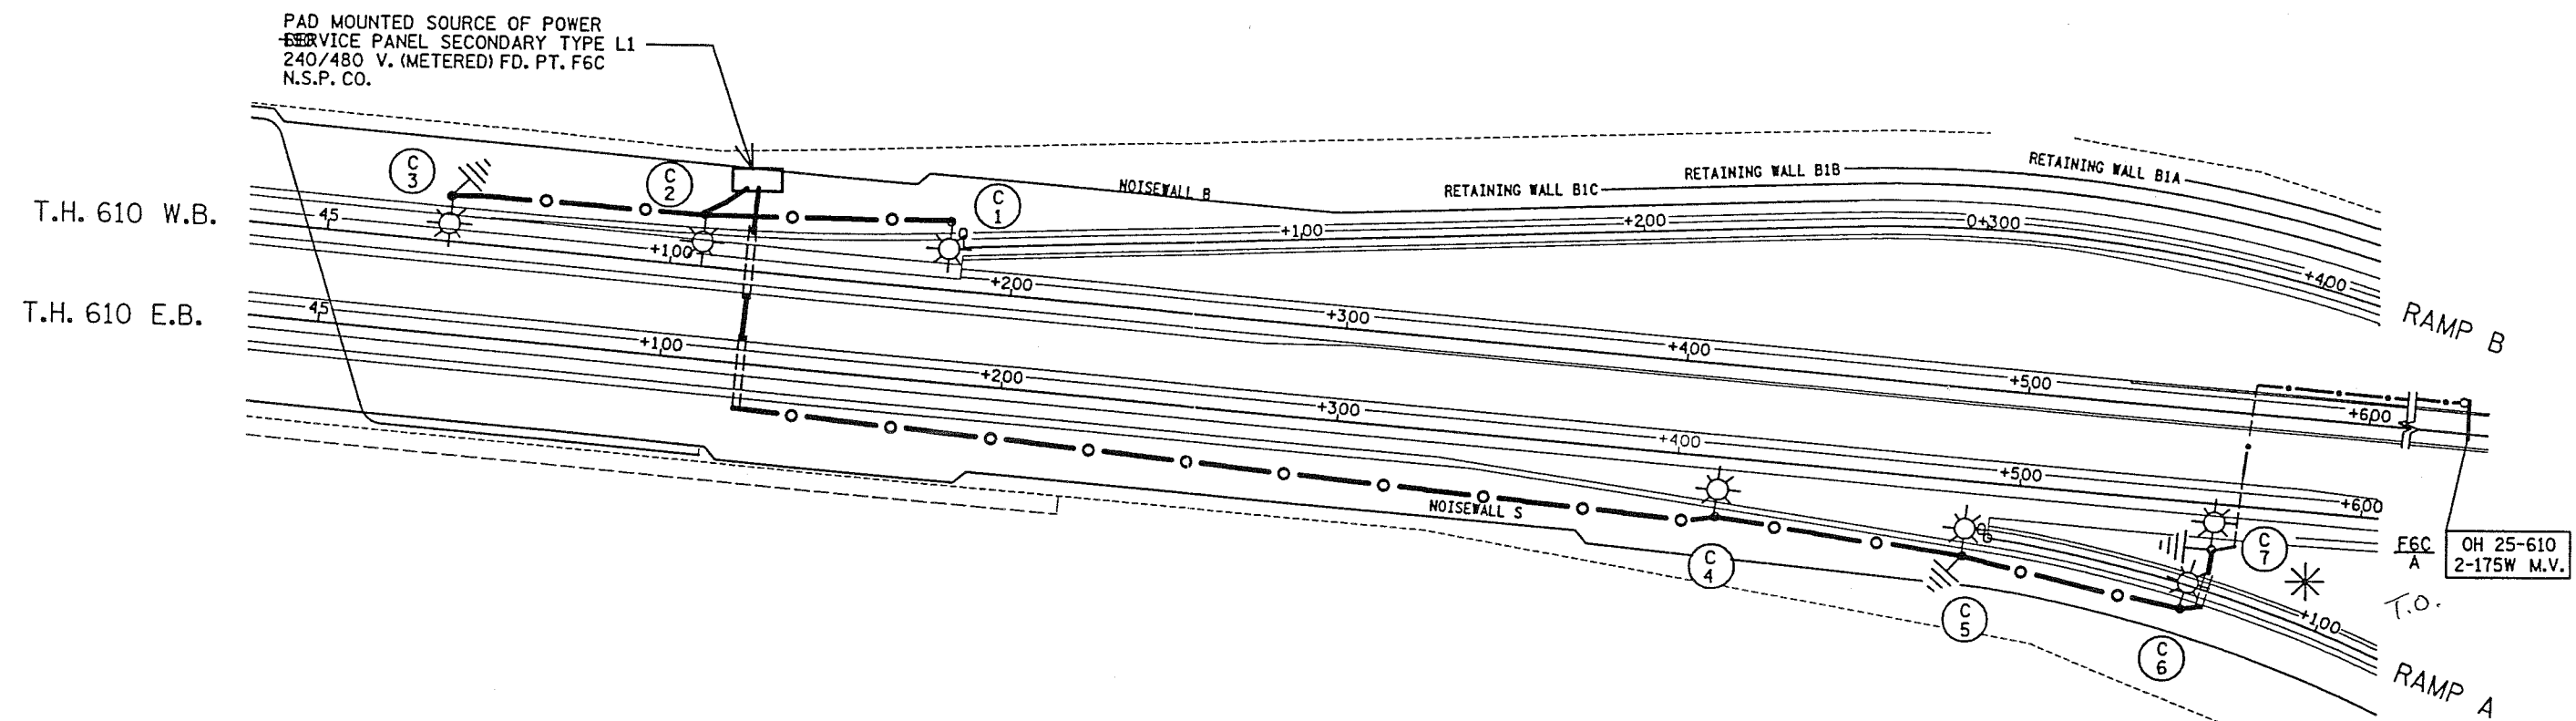

PAD MOUNTED SOURCE OF POWER
 SERVICE PANEL SECONDARY TYPE L1
 240/480 V. (METERED) FD. PT. F6C
 N.S.P. CO.

OH 25-610
 2-175W M.V.

SHEET TOTALS
 7-200 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
 2-175 WATT HIGH PRESSURE SODIUM LIGHTING UNITS

GRAND TOTALS
 21-200 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
 12-175 WATT HIGH PRESSURE SODIUM LIGHTING UNITS

EXHIBIT 281
 T.H. 610 & 93RD AVE.
 IN BROOKLYN PARK
 N.S.P.
 METERED