


LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
1	96+36			T.H. 100 N.B. 12-40
2	98+66			T.H. 100 N.B. 12-40
3	101+00			T.H. 100 N.B. 12-40
4	103+27			T.H. 100 N.B. 12-40
5	105+57			T.H. 100 N.B. 12-40
6	107+62			T.H. 100 N.B. 12-40
7	109+88			T.H. 100 N.B. 12-40
8	112+13			T.H. 100 N.B. 12-40
9	114+39			T.H. 100 N.B. 12-40
10	AS SHOWN			T.H. 100 N.B. L
11	117+50			T.H. 100 N.B. 12-40
12	119+80			T.H. 100 N.B. 12-40
13	122+15			T.H. 100 N.B. 12-40
14	124+50			T.H. 100 N.B. 12-40
15	126+85			T.H. 100 N.B. 12-40
16	129+15			T.H. 100 N.B. 12-40
17	127+93			T.H. 100 S.B. 12-40
18	125+95			T.H. 100 S.B. 12-40
19	123+65			T.H. 100 S.B. 12-40
20	121+55			T.H. 100 S.B. 12-40

LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
21	119+43			T.H. 100 S.B. 12-40
22	117+15			T.H. 100 S.B. 12-40
23	AS SHOWN			T.H. 100 S.B. L
24	114+20			T.H. 100 S.B. 12-40
25	111+80			T.H. 100 S.B. 12-40
26	109+30			T.H. 100 S.B. 12-40
27	106+85			T.H. 100 S.B. 12-40
28	104+45			T.H. 100 S.B. 12-40
29	102+05			T.H. 100 S.B. 12-40
30	99+65			T.H. 100 S.B. 12-40
31	97+25			T.H. 100 S.B. 12-40
32	42+30			S.E. RAMP 9-40
33	44+62			S.E. RAMP 9-40
34	47+00			S.E. RAMP 9-40
35	50+65			S.W. RAMP 9-40
36	53+00			S.W. RAMP 9-40
37	55+45			S.W. RAMP 9-40
38	58+05			S.W. RAMP 9-40
39	75+77			S.W. LOOP 9-40
40	78+15			S.W. LOOP 9-40
41	80+46			S.W. LOOP 9-40

① 250 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHT

SEE SHT. 667 FOR PLACEMENT OF LIGHTING UNITS

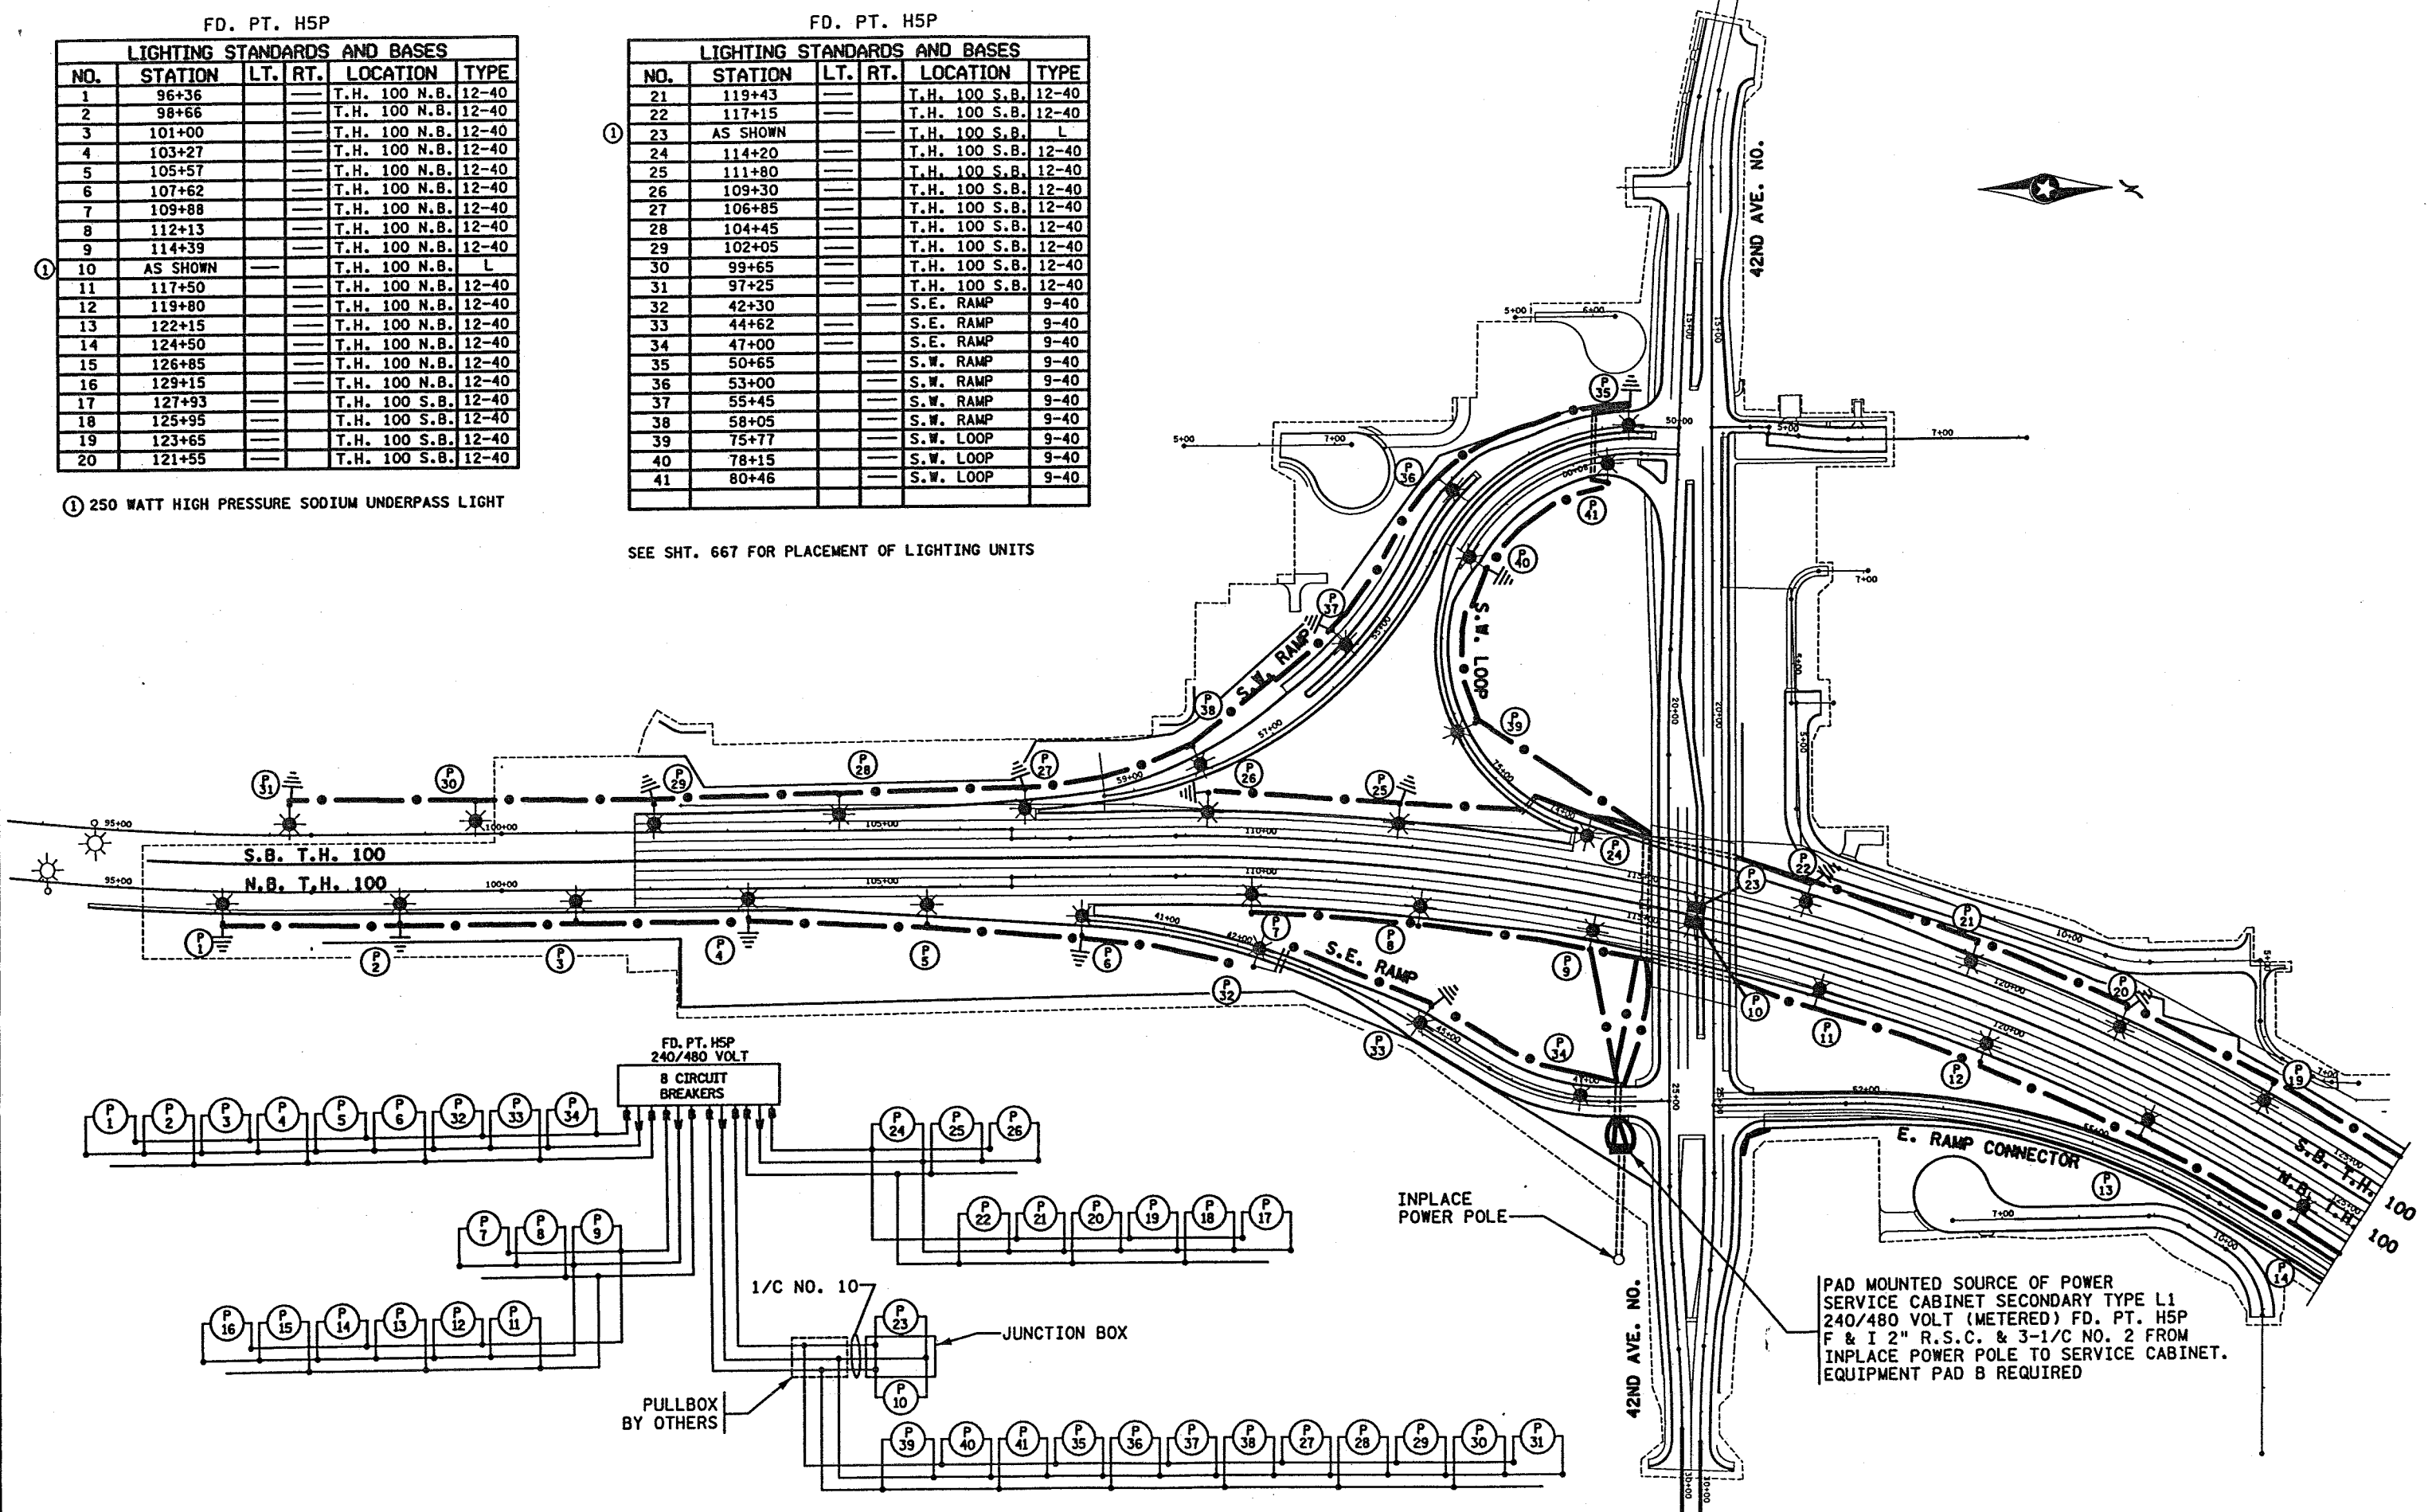

B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
1	AS SHOWN	---	---	T.H. 100 N.B. L
2	132+45	---	---	T.H. 100 N.B. 12-40
3	134+95	---	---	T.H. 100 N.B. 12-40
4	AS SHOWN	---	---	T.H. 100 N.B. L
5	138+30	---	---	T.H. 100 N.B. 12-40
6	141+05	---	---	T.H. 100 N.B. 12-40
7	143+65	---	---	T.H. 100 N.B. 12-40
8	146+25	---	---	T.H. 100 N.B. 12-40
9	148+90	---	---	T.H. 100 N.B. 6B-40
10	149+50	---	---	T.H. 100 S.B. 12-40
11	147+50	---	---	T.H. 100 S.B. 12-40
12	145+50	---	---	T.H. 100 S.B. 12-40
13	143+20	---	---	T.H. 100 S.B. 12-40
14	140+90	---	---	T.H. 100 S.B. 12-40
15	138+60	---	---	T.H. 100 S.B. 12-40
16	AS SHOWN	---	---	T.H. 100 S.B. L
17	135+38	---	---	T.H. 100 S.B. 12-40
18	132+86	---	---	T.H. 100 S.B. 12-40
19	AS SHOWN	---	---	T.H. 100 S.B. L
20	130+65	---	---	T.H. 100 S.B. 9D-40
21	87+35	---	---	N.E. LOOP 9-40
22	89+65	---	---	N.E. LOOP 9-40
23	92+00	---	---	N.E. LOOP 9-40
24	94+40	---	---	N.E. LOOP 9-40
25	71+60	---	---	N.E. RAMP 9-40
26	74+10	---	---	N.E. RAMP 9-40
27	76+40	---	---	N.E. RAMP 9-40
28	79+05	---	---	N.E. RAMP 6B-40
29	81+45	---	---	N.E. RAMP 6B-40
30	92+25	---	---	N.W. RAMP 12-40
31	94+55	---	---	N.W. RAMP 12-40
32	96+90	---	---	N.W. RAMP 12-40
33	83+77	---	---	W. RAMP 9-40
34	86+24	---	---	W. RAMP 9-40
35	88+80	---	---	W. RAMP 9-40
36	91+28	---	---	W. RAMP 9-40

① 250 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHT
SEE SHT. 667 FOR PLACEMENT OF LIGHTING UNITS

