


LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
1	AS SHOWN	---	---	T.H. 100 N.B. L
2	132+45	---	---	T.H. 100 N.B. 12-40
3	134+95	---	---	T.H. 100 N.B. 12-40
4	AS SHOWN	---	---	T.H. 100 N.B. L
5	138+30	---	---	T.H. 100 N.B. 12-40
6	141+05	---	---	T.H. 100 N.B. 12-40
7	143+65	---	---	T.H. 100 N.B. 12-40
8	146+25	---	---	T.H. 100 N.B. 12-40
9	148+90	---	---	T.H. 100 N.B. 6B-40
10	149+50	---	---	T.H. 100 S.B. 12-40
11	147+50	---	---	T.H. 100 S.B. 12-40
12	145+50	---	---	T.H. 100 S.B. 12-40
13	143+20	---	---	T.H. 100 S.B. 12-40
14	140+90	---	---	T.H. 100 S.B. 12-40
15	138+60	---	---	T.H. 100 S.B. 12-40
16	AS SHOWN	---	---	T.H. 100 S.B. L
17	135+38	---	---	T.H. 100 S.B. 12-40
18	132+86	---	---	T.H. 100 S.B. 12-40
19	AS SHOWN	---	---	T.H. 100 S.B. L
20	130+65	---	---	T.H. 100 S.B. 9D-40
21	87+35	---	---	N.E. LOOP 9-40
22	89+65	---	---	N.E. LOOP 9-40
23	92+00	---	---	N.E. LOOP 9-40
24	94+40	---	---	N.E. LOOP 9-40
25	71+60	---	---	N.E. RAMP 9-40
26	74+10	---	---	N.E. RAMP 9-40
27	76+40	---	---	N.E. RAMP 9-40
28	79+05	---	---	N.E. RAMP 6B-40
29	81+45	---	---	N.E. RAMP 6B-40
30	92+25	---	---	N.W. RAMP 12-40
31	94+55	---	---	N.W. RAMP 12-40
32	96+90	---	---	N.W. RAMP 12-40
33	83+77	---	---	W. RAMP 9-40
34	86+24	---	---	W. RAMP 9-40
35	88+80	---	---	W. RAMP 9-40
36	91+28	---	---	W. RAMP 9-40

① 250 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHT
SEE SHT. 667 FOR PLACEMENT OF LIGHTING UNITS



PAD MOUNTED SOURCE OF POWER
SERVICE CABINET SECONDARY TYPE L1
240/480 VOLT (METERED) FD. PT. H55
F & I 2" R.S.C. & 3-1/4 NO. 2 FROM
INPLACE POWER POLE TO SERVICE CABINET.
EQUIPMENT PAD B REQUIRED

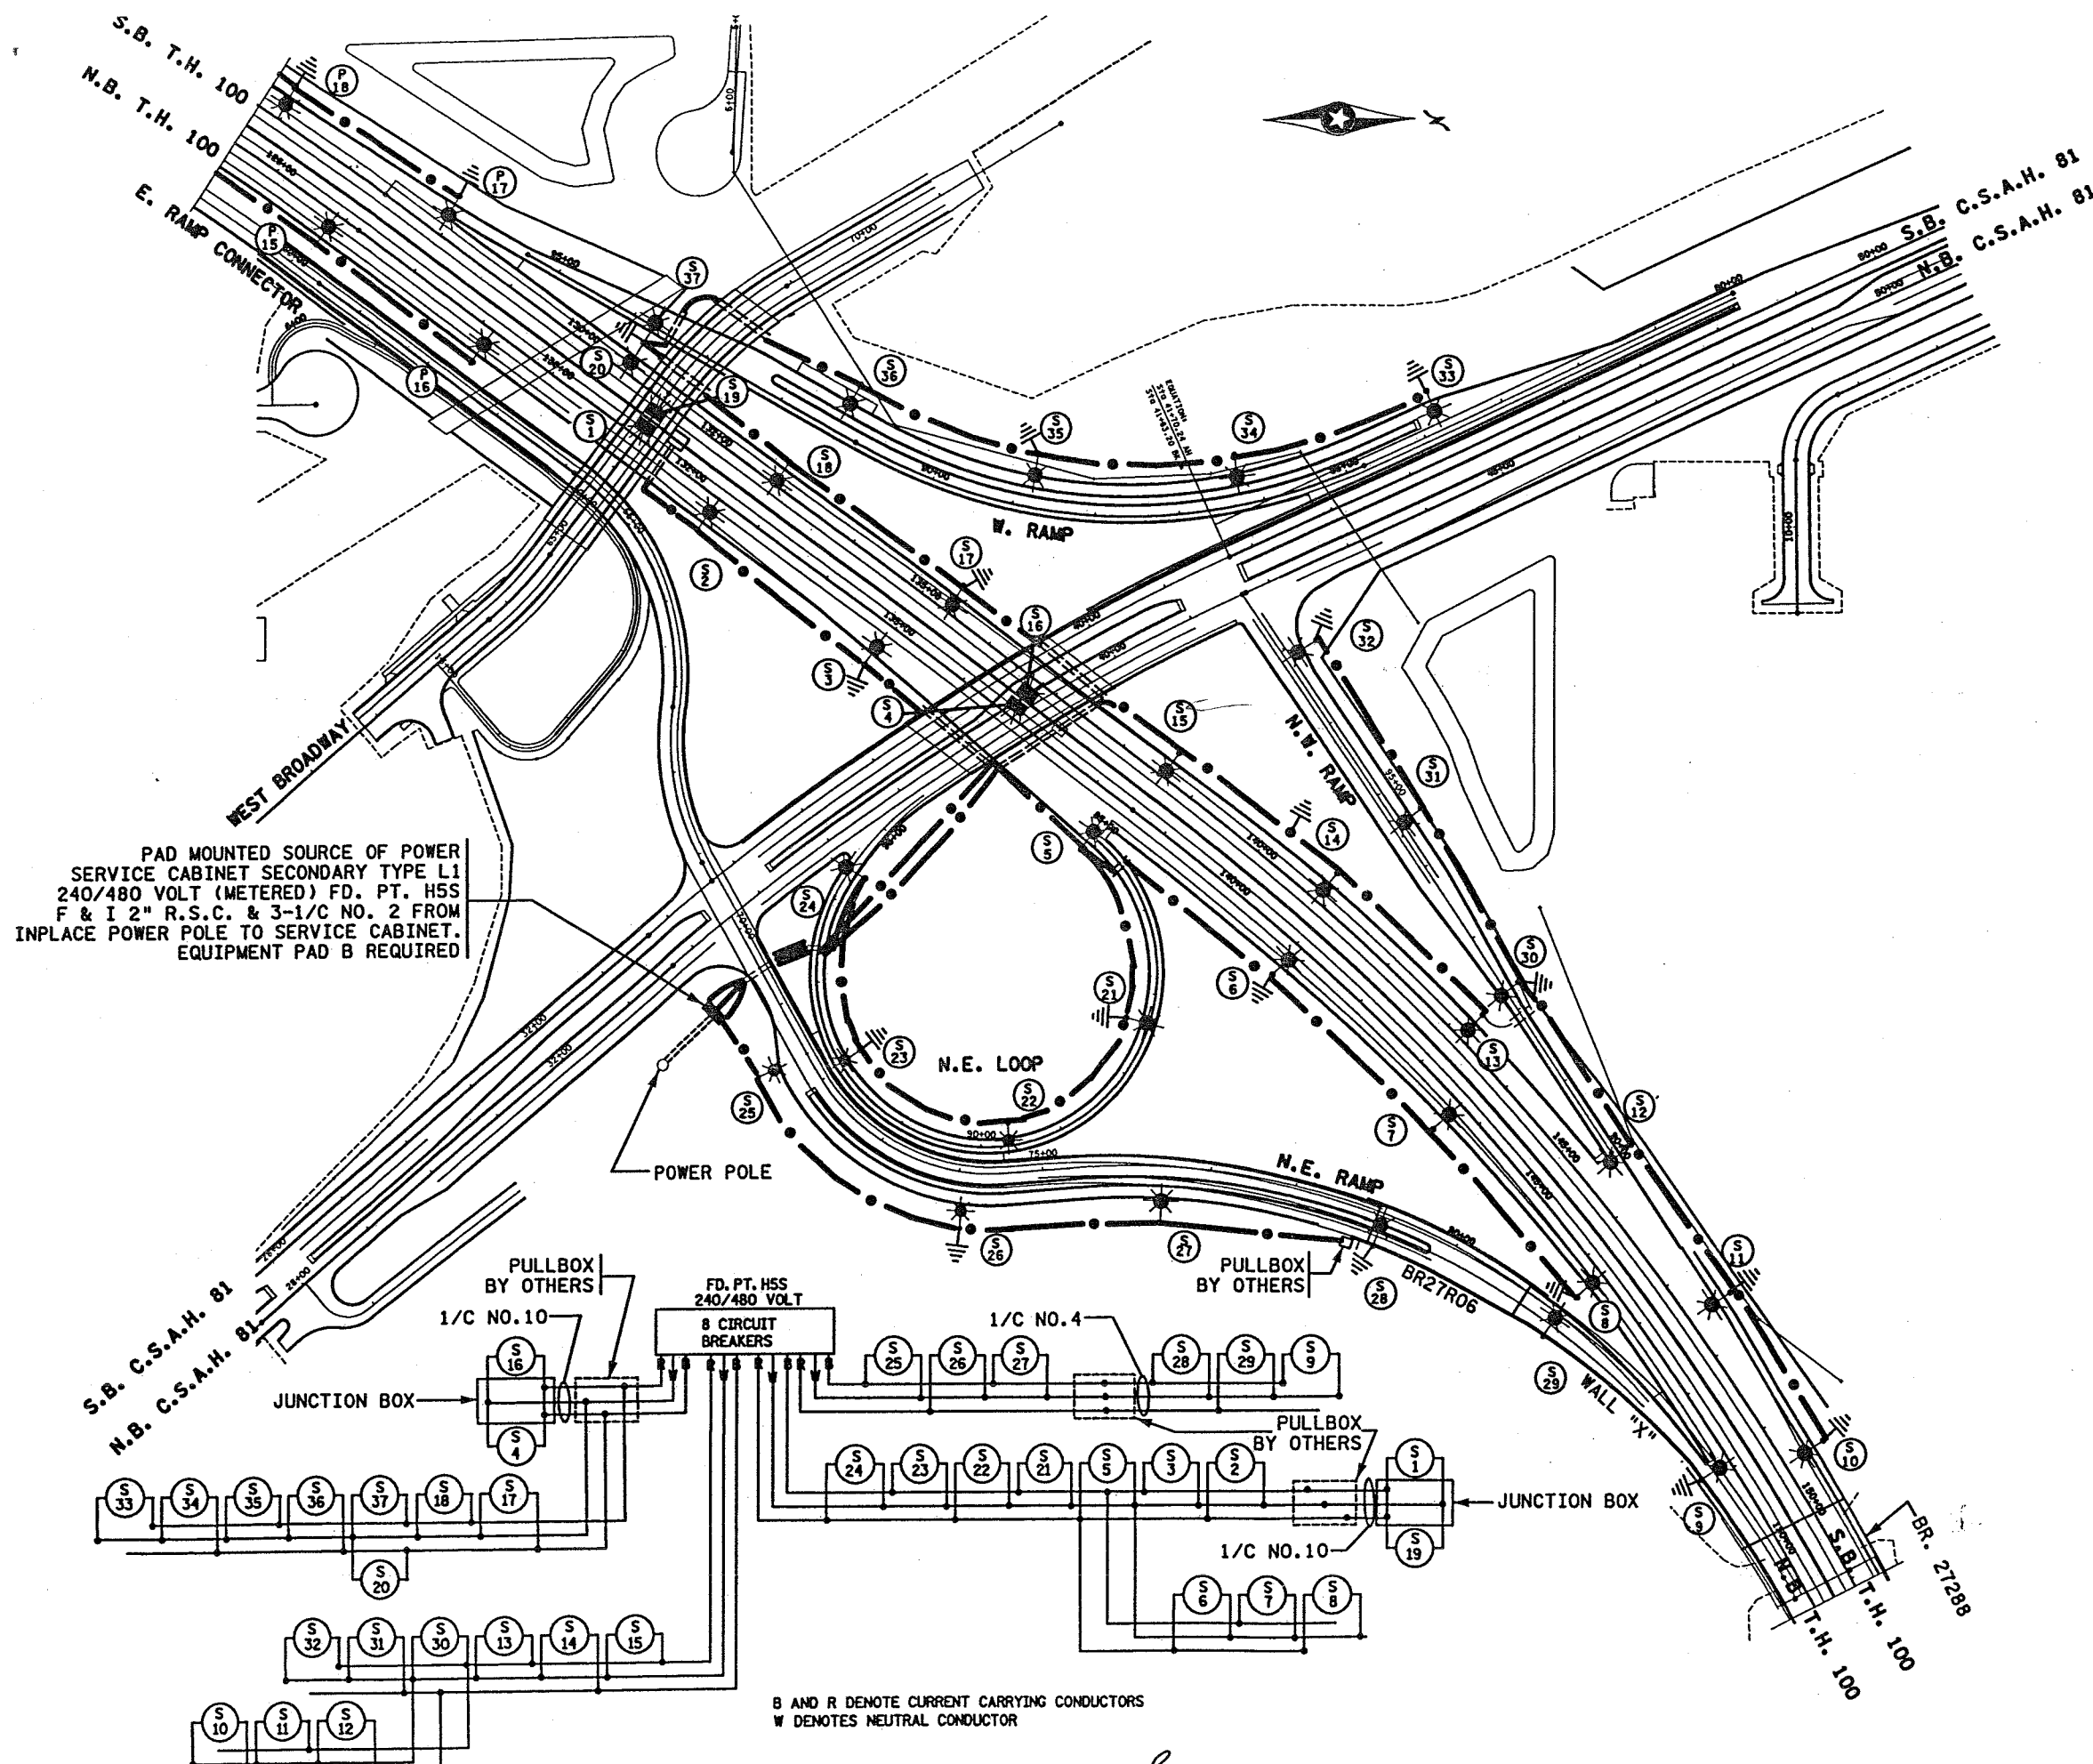