


B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

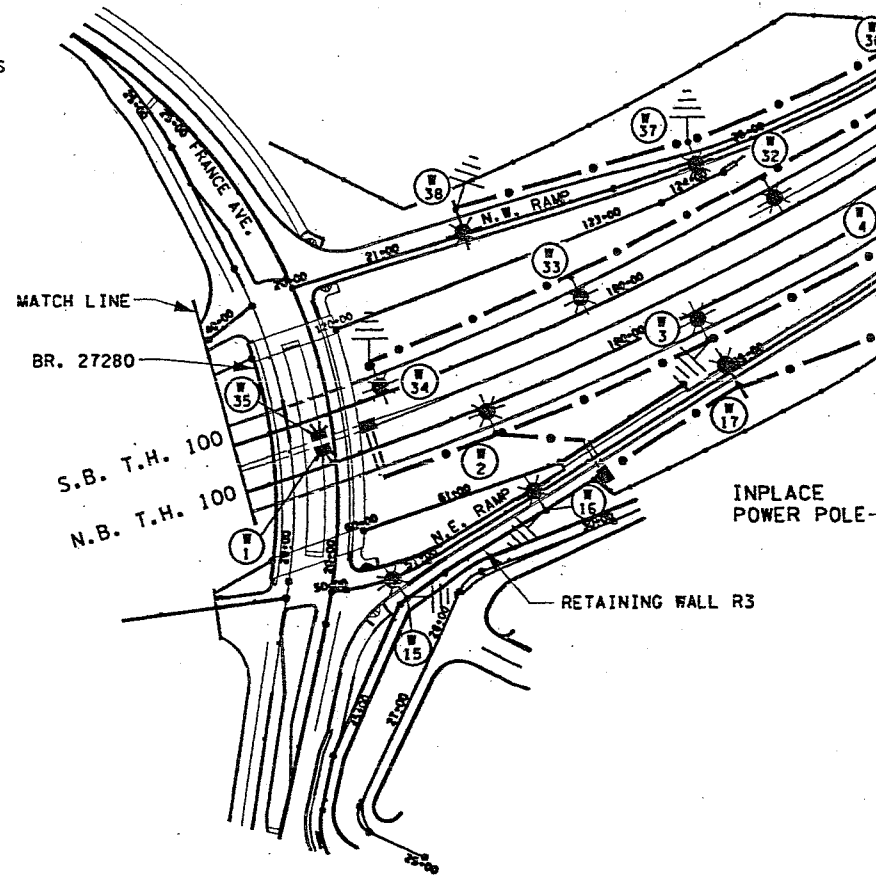

PAD MOUNTED SOURCE OF POWER
SERVICE CABINET SECONDARY TYPE L1
240/480 VOLT (METERED) FD. PT. H5W
F & I 2" R.S.C. & 3-1/C NO. 2 FROM
INPLACE POWER POLE TO SERVICE CABINET.
EQUIPMENT PAD B REQUIRED

FD. PT. H5W

LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
1	AS SHOWN			T.H. 100 N.B. L
2	178+35			T.H. 100 N.B. 12-40
3	180+75			T.H. 100 N.B. 12-40
4	183+15			T.H. 100 N.B. 9D-40
5				
18	183+15			T.H. 100 N.B. 9D-40
19	185+75			T.H. 100 N.B. 9D-40
6	188+05			T.H. 100 N.B. 9D-40
20				
7	190+35			T.H. 100 N.B. 12-40
8	192+75			T.H. 100 N.B. 12-40
9	195+15			T.H. 100 N.B. 12-40
10	197+55			T.H. 100 N.B. 12-40
11	199+95			T.H. 100 N.B. 12-40
12	202+35			T.H. 100 N.B. 12-40
13	204+75			T.H. 100 N.B. 12-40
14	207+15			T.H. 100 N.B. 12-40
15	50+65			N.E. RAMP 6B-40
16	52+35			N.E. RAMP 6B-40

FD. PT. H5W

LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
17	54+75			N.E. RAMP 9-40
21	207+25			T.H. 100 S.B. 12-40
22	204+85			T.H. 100 S.B. 12-40
23	202+45			T.H. 100 S.B. 12-40
24	200+05			T.H. 100 S.B. 12-40
25	197+65			T.H. 100 S.B. 12-40
26	195+25			T.H. 100 S.B. 12-40
27	192+85			T.H. 100 S.B. 12-40
28	190+45			T.H. 100 S.B. 12-40
29	188+50			T.H. 100 S.B. 12-40
30	186+58			T.H. 100 S.B. 12-40
31	184+00			T.H. 100 S.B. 12-40
32	181+80			T.H. 100 S.B. 12-40
33	179+50			T.H. 100 S.B. 12-40
34	177+25			T.H. 100 S.B. 12-40
35	AS SHOWN			T.H. 100 S.B. L
36	26+88			N.W. RAMP 9-40
37	24+38			N.W. RAMP 9-40
38	21+85			N.W. RAMP 9-40