

FD PT. J6T, 120/240V.


LIGHT STANDARDS & BASES					
NO.	STATION	LT	RT	LOCATION	TYPE
1	N.B. 123+40	-	-	T.H. 280	4B-40
2	N.B. 125+75	-	-		
3	N.B. 128+50	-	-		
4	N.B. 130+45	-	-		
5	S.B. 131+05	-	-		
6	S.B. 128+65	-	-		
7	S.B. 126+65	-	-		
8	S.B. 124+35	-	-		
9	S.B. 121+80	-	-		4B-40
10	N.B. 132+70	-	-	T.H. 280	9-40
11	135+30	-	-	RAMP R	6-40
12	137+50	-	-	RAMP R	6-40
13	AS SHOWN			ENTRANCE RD	L (1)
14	AS SHOWN			ROBBINS ST	L (1)
15	AS SHOWN			ROBBINS ST	L (1)

LOCATE LIGHT STANDARDS 9' BEHIND EDGE OF SHOULDER OR AS DIRECTED BY THE ENGINEER.

(1) MAINTAINED BY CITY OF ST. PAUL

EXHIBIT 109B
T.H. 280
@ KASOTA AVE. & ENERGY PARK DR.
IN ST. PAUL
N.S.P.

MAINTAINED BY THE
CITY OF ST. PAUL

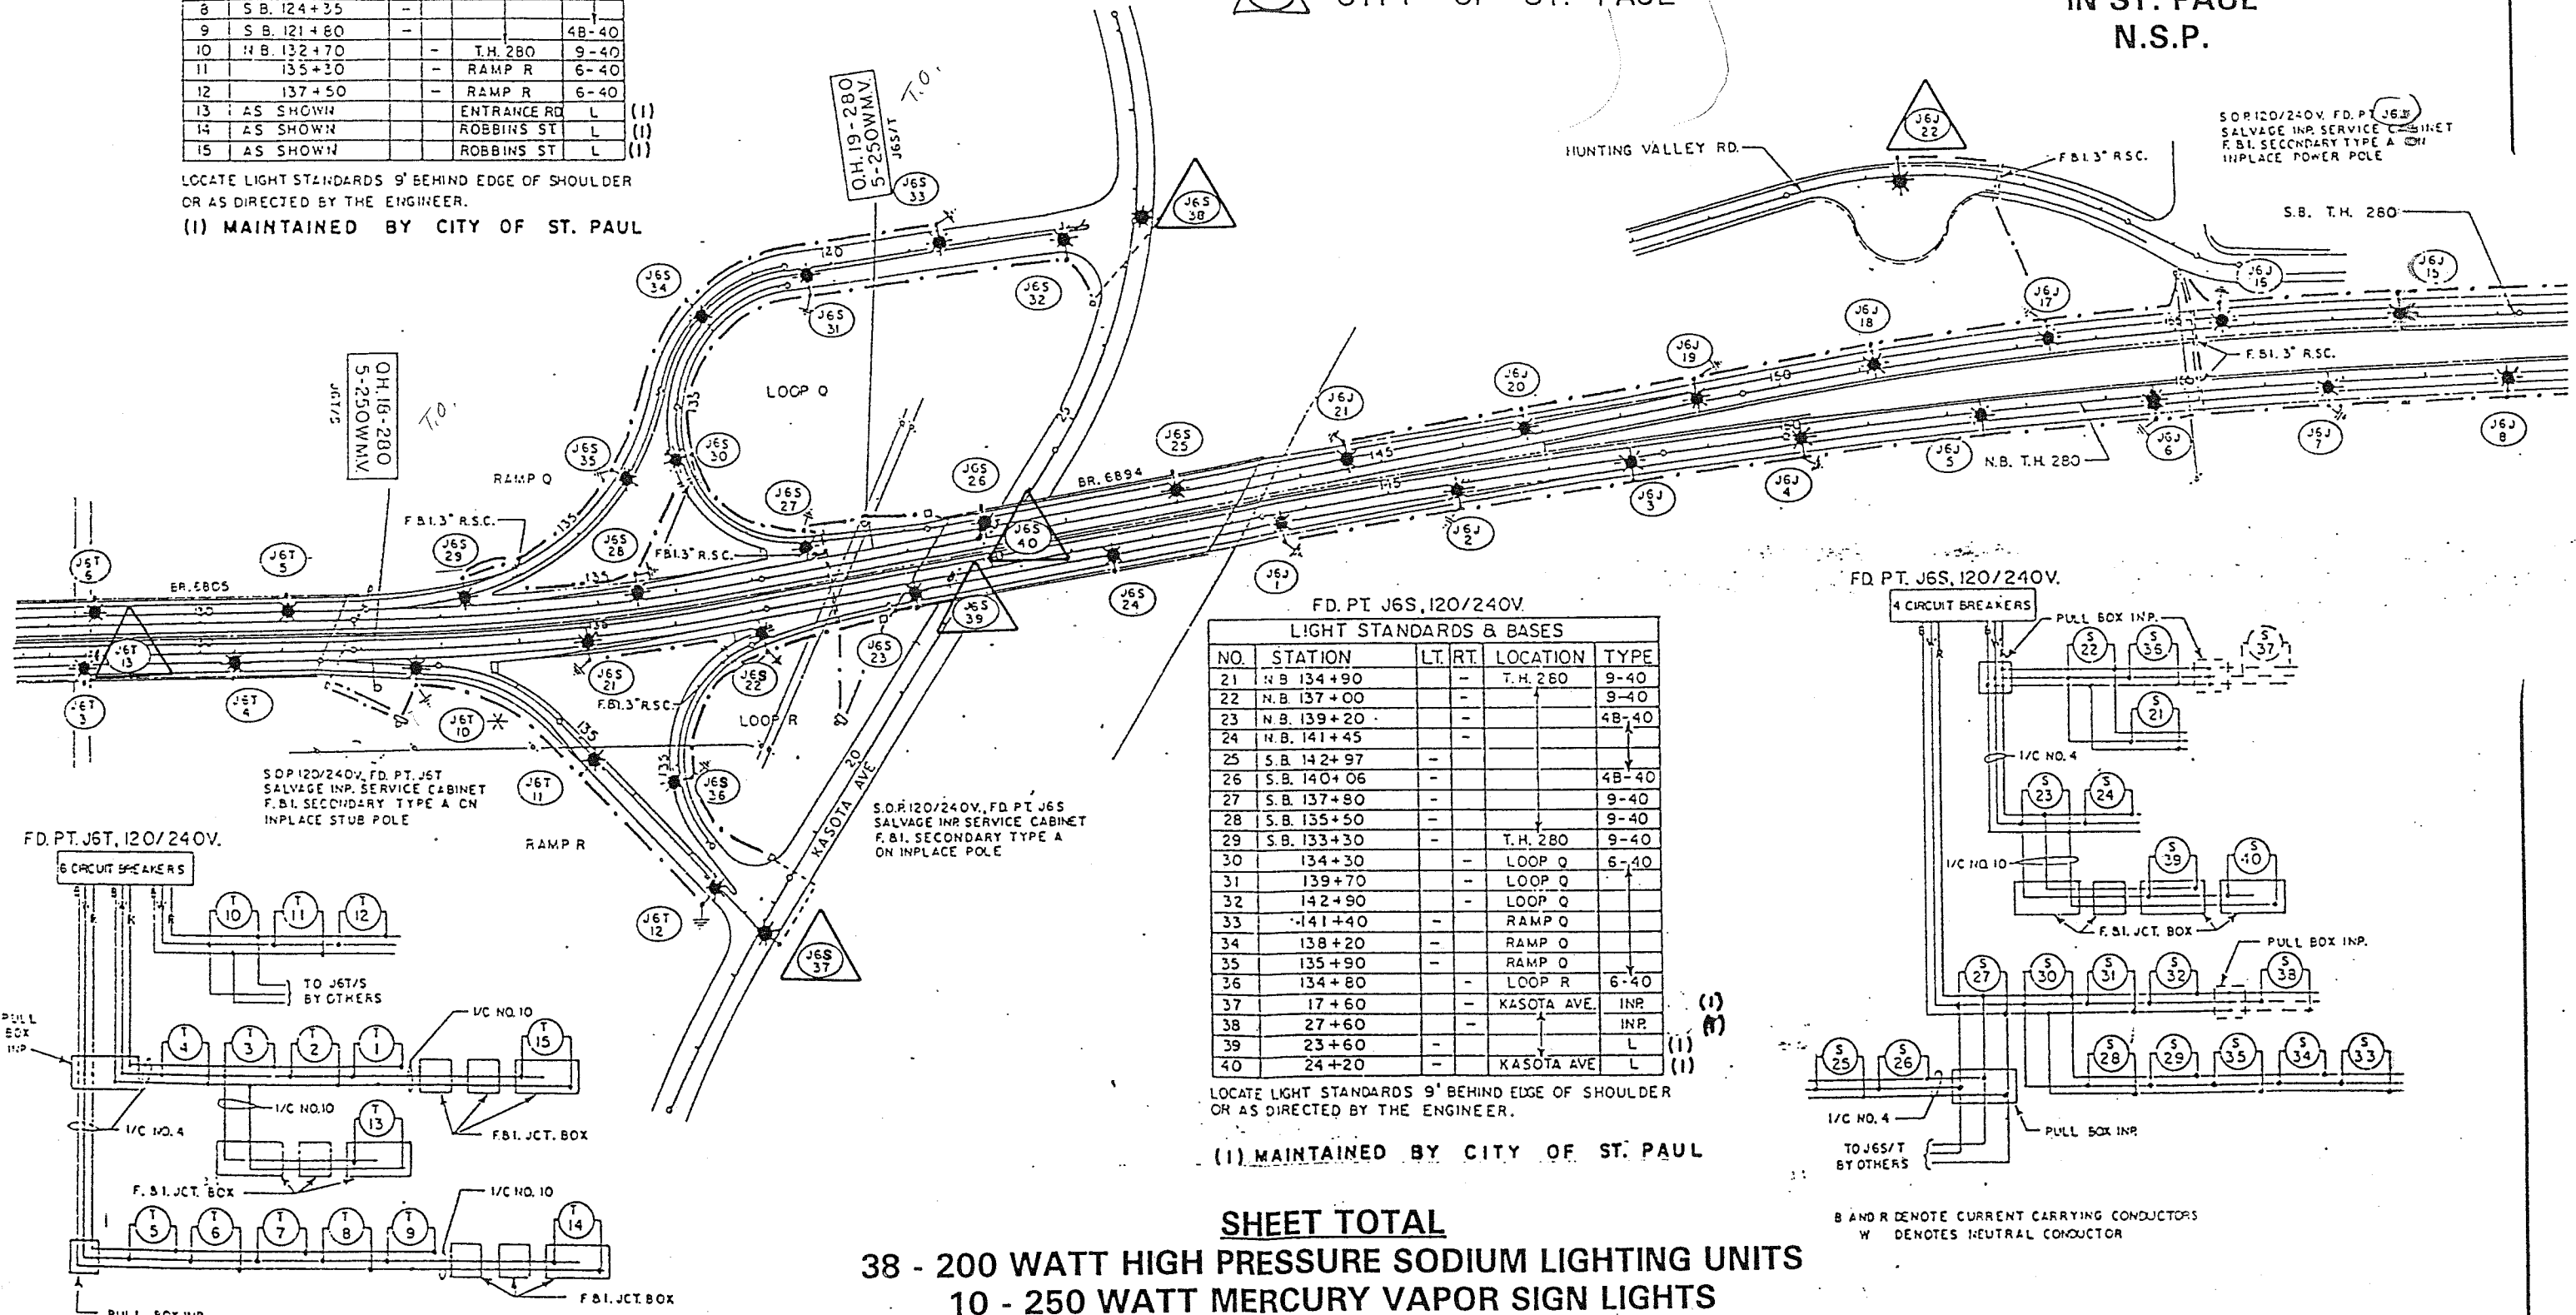


FD. PT. J6S, 120/240V.

LIGHT STANDARDS & BASES					
NO.	STATION	LT	RT	LOCATION	TYPE
21	N.B. 134+90	-	-	T.H. 280	9-40
22	N.B. 137+00	-	-		9-40
23	N.B. 139+20	-	-		4B-40
24	N.B. 141+45	-	-		
25	S.B. 142+97	-	-		
26	S.B. 140+06	-	-		4B-40
27	S.B. 137+80	-	-		9-40
28	S.B. 135+50	-	-		9-40
29	S.B. 133+30	-	-	T.H. 280	9-40
30	134+30	-	-	LOOP Q	6-40
31	139+70	-	-	LOOP Q	
32	142+90	-	-	LOOP Q	
33	141+40	-	-	RAMP Q	
34	138+20	-	-	RAMP Q	
35	135+90	-	-	RAMP Q	
36	134+80	-	-	LOOP R	6-40
37	17+60	-	-	KASOTA AVE.	INP (1)
38	27+60	-	-		INP (1)
39	23+60	-	-		L (1)
40	24+20	-	-	KASOTA AVE	L (1)

LOCATE LIGHT STANDARDS 9' BEHIND EDGE OF SHOULDER OR AS DIRECTED BY THE ENGINEER.

(1) MAINTAINED BY CITY OF ST. PAUL

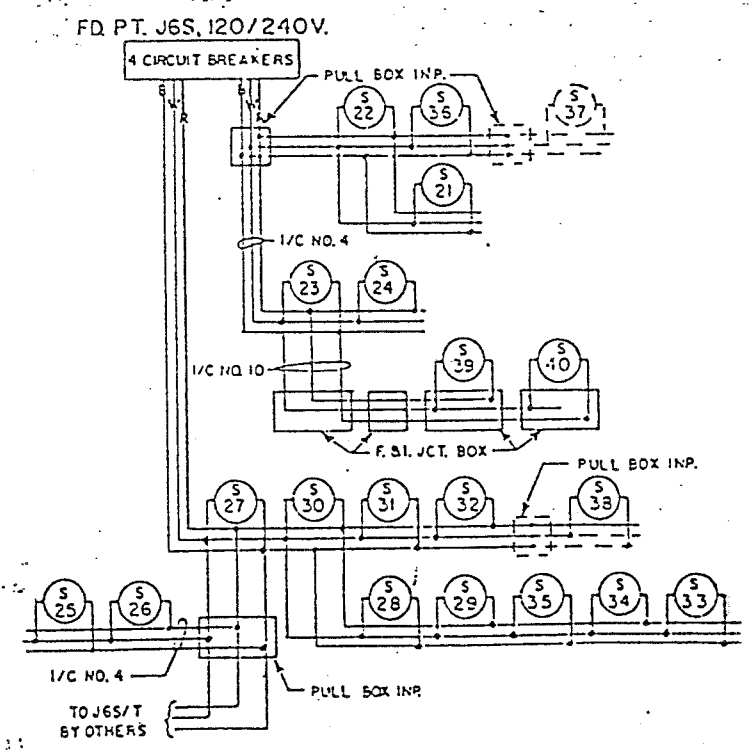

B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

SHEET TOTAL
38 - 200 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
10 - 250 WATT MERCURY VAPOR SIGN LIGHTS

B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

LIGHTING PLAN