








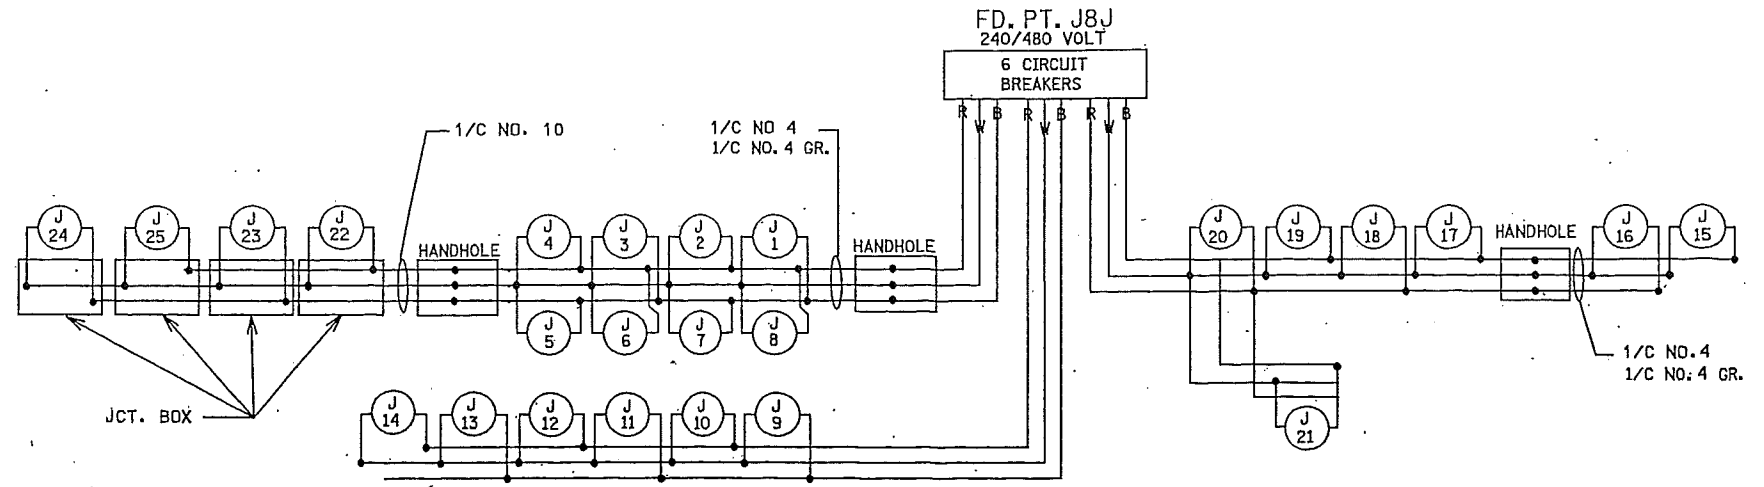




LEGEND

-  PAD MOUNTED SOURCE OF POWER
240/480 VOLT
-  250 WATT HIGH PRESSURE SODIUM
LIGHTING UNIT
-  250 WATT HIGH PRESSURE SODIUM
TWIN LIGHTING UNIT
-  INPLACE LIGHTING UNIT
-  250 WATT HIGH PRESSURE SODIUM
UNDERPASS LIGHTING FIXTURE
-  ARMORED CABLE 4 CONDUCTOR NO. 4
-  HANDHOLE
-  78 mm NON-METALIC CONDUIT
UNLESS OTHERWISE NOTED
-  PERMANENT GROUND ROD 25 OHMS
OR LESS



B AND R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR

PAD MOUNTED SOURCE OF POWER
SERVICE CABINET SECONDARY TYPE L1
240/480 VOLT (METERED) FD, PT. J8J
F & I 53 mm R.S.C. & 3-1/C NO. 2 FROM
SERVICE CABINET TO XCEL ENERGY POLE.
EQUIPMENT PAD B REQUIRED

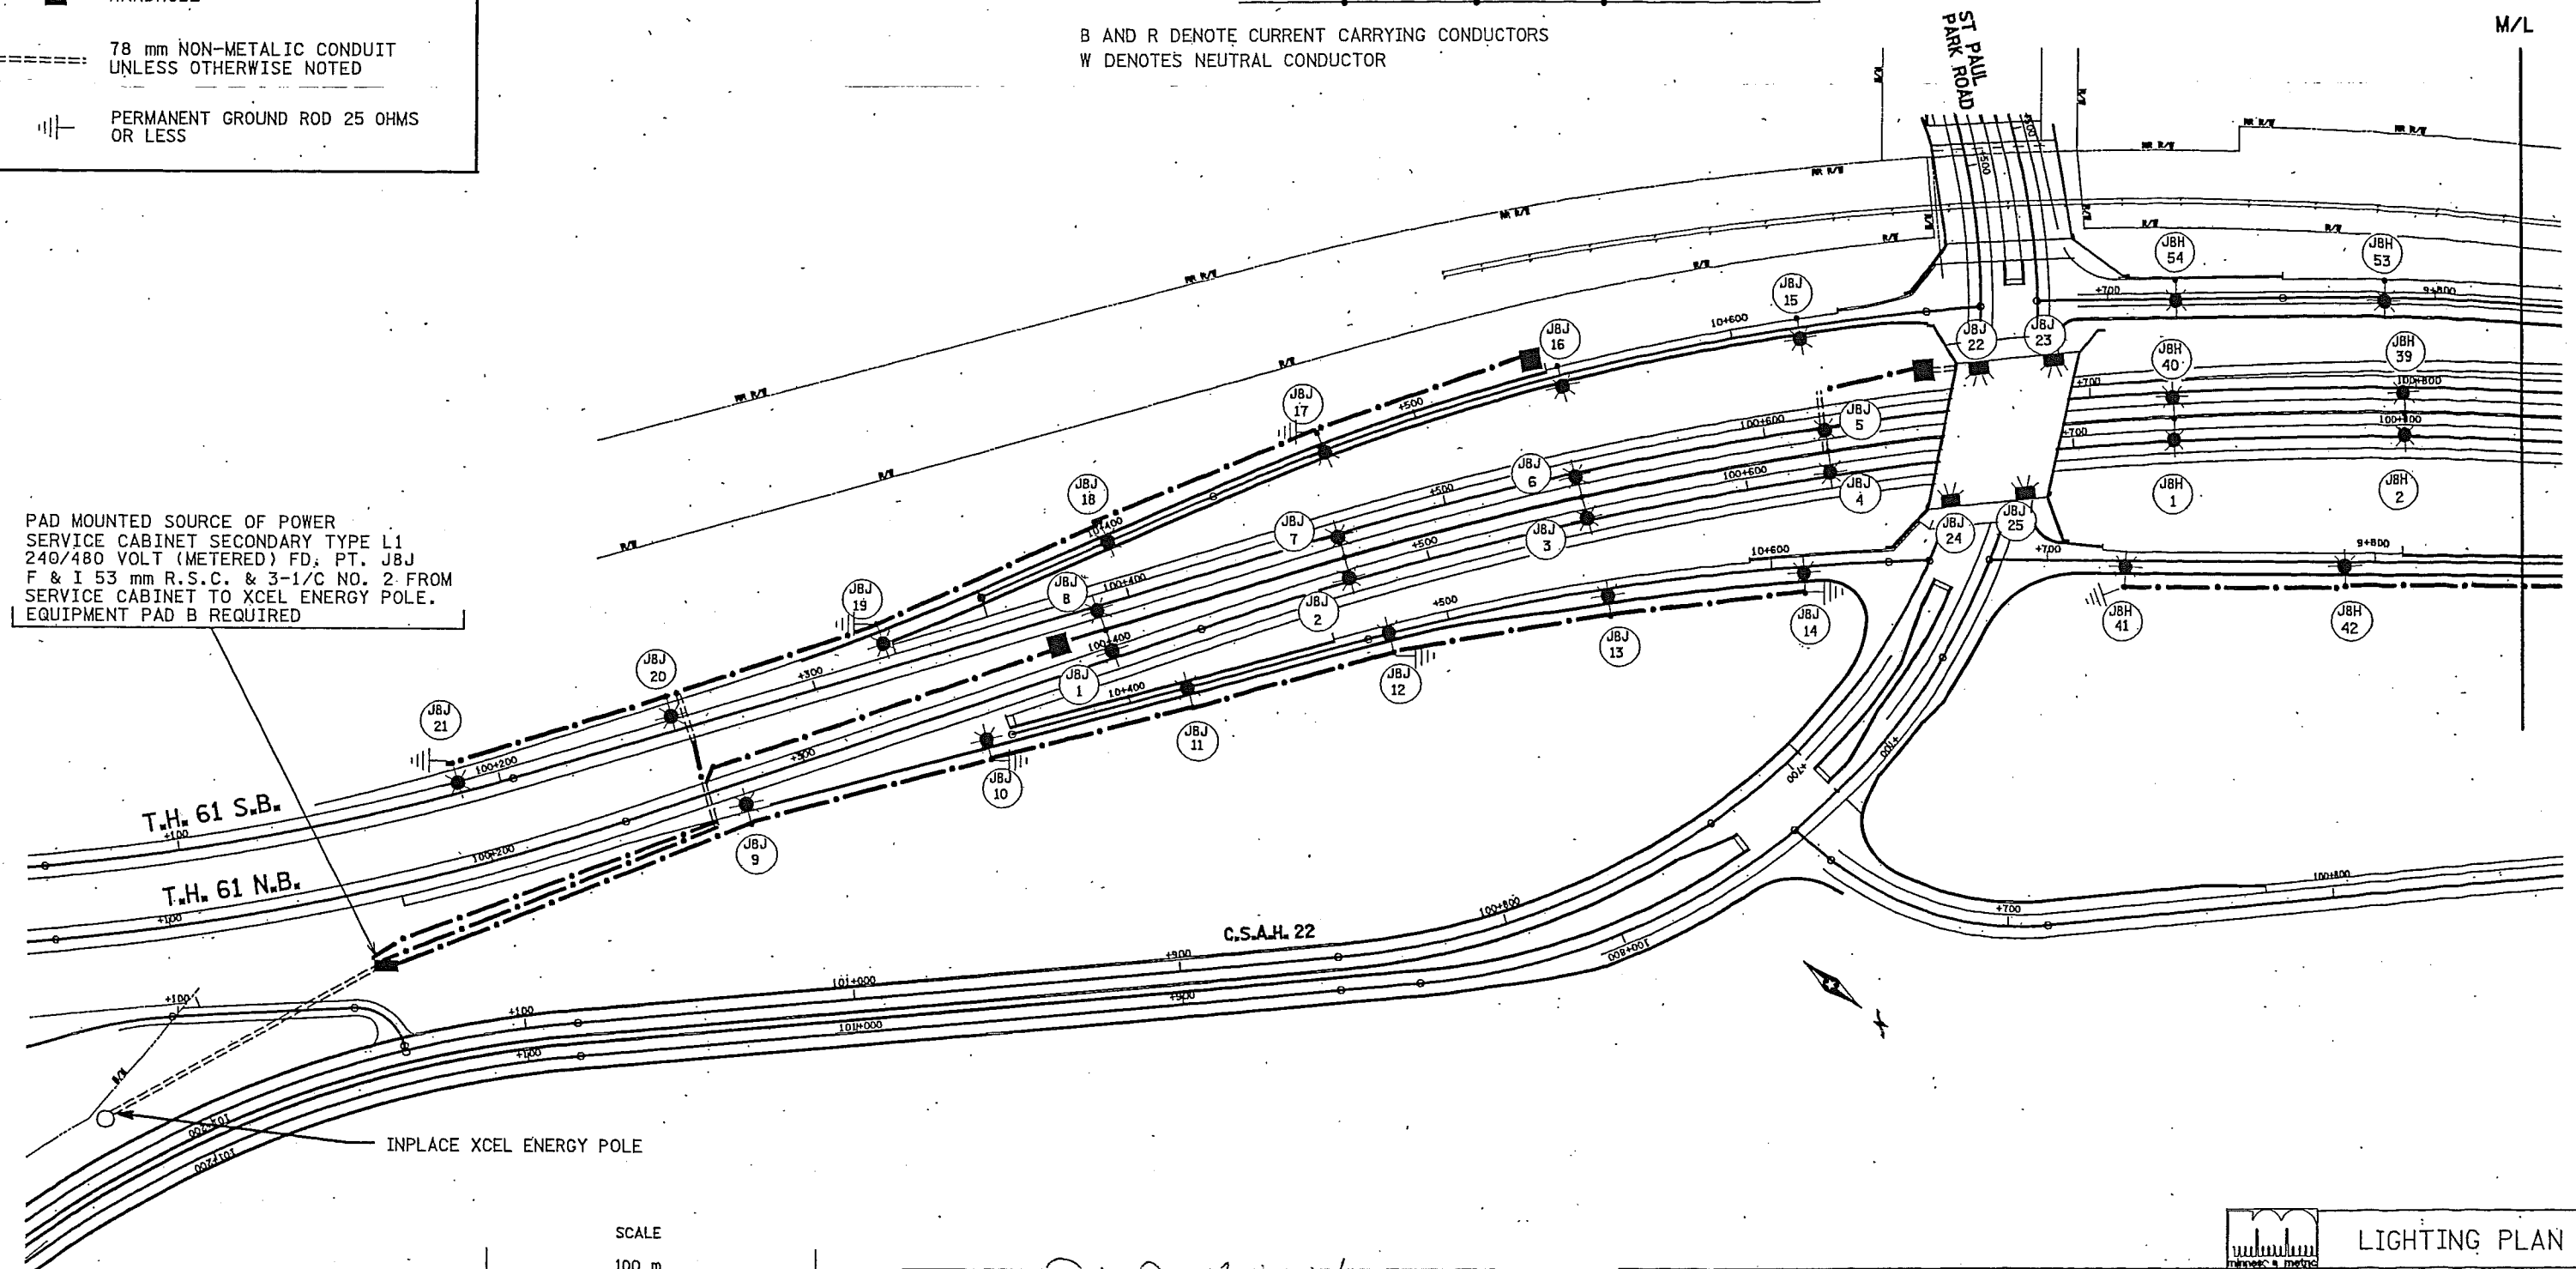

CERTIFIED BY *John A. Krawiec* LIC. NO. 23084

State Proj. No. B205-100 (T.H. 61)



LIGHTING PLAN

Sheet No. 362 of 443 Sheets