

B & R DENOTE CURRENT CARRYING CONDUCTORS
W DENOTES NEUTRAL CONDUCTOR
DASHED LINES DENOTE BY OTHERS

FD. PT. N1C, 240/480 V.
EQUIPMENT PAD INP.
F. B. I. SERVICE PANEL
SECONDARY TYPE TI-S-240

FD. PT. N1C


LIGHTING STANDARDS & BASES					
NO	STATION	LT	RT	LOCATION	TYPE
(3)(1)	1			T.H. 694 MED.	6BD-49
	16				
(1)	2				
	15				
(1)	3				
	14				
(1)	4				
	13				
(1)	5				
	12				
(1)	6				
	11				
(3)(1)	7			T.H. 694 MED.	6BD-49
	10				

(1) LIGHT ANCHORAGE BY OTHERS
(3) 250 WATT H.P.S.

LIGHTING STANDARDS & BASES					
NO	STATION	LT	RT	LOCATION	TYPE
(1)	8			T.H. 694 MED.	6BD-49(3)
	9				
(2)	17			TH 694	9-40 (4)
	18			NERFER	6-40
	19			NERFER	
	20			NERFER	
	21			NERFER	6-40
	22			NERFER	
	23			NERFER	
	24			NERFER	
	25			NERFER	
	26			NERFER	

PLACE LIGHTING UNITS TYPE 6-40 9' BEHIND CURB
(2) INSTALL SALVAGED LIGHT STANDARD & LUMINAIRE
(4) 200 WATT H.P.S.

LIGHTING UNITS ON EAST RIVER RD. NOT SHOWN ON THIS EXHIBIT ARE MAINTAINED BY CITY OF FRIDLEY

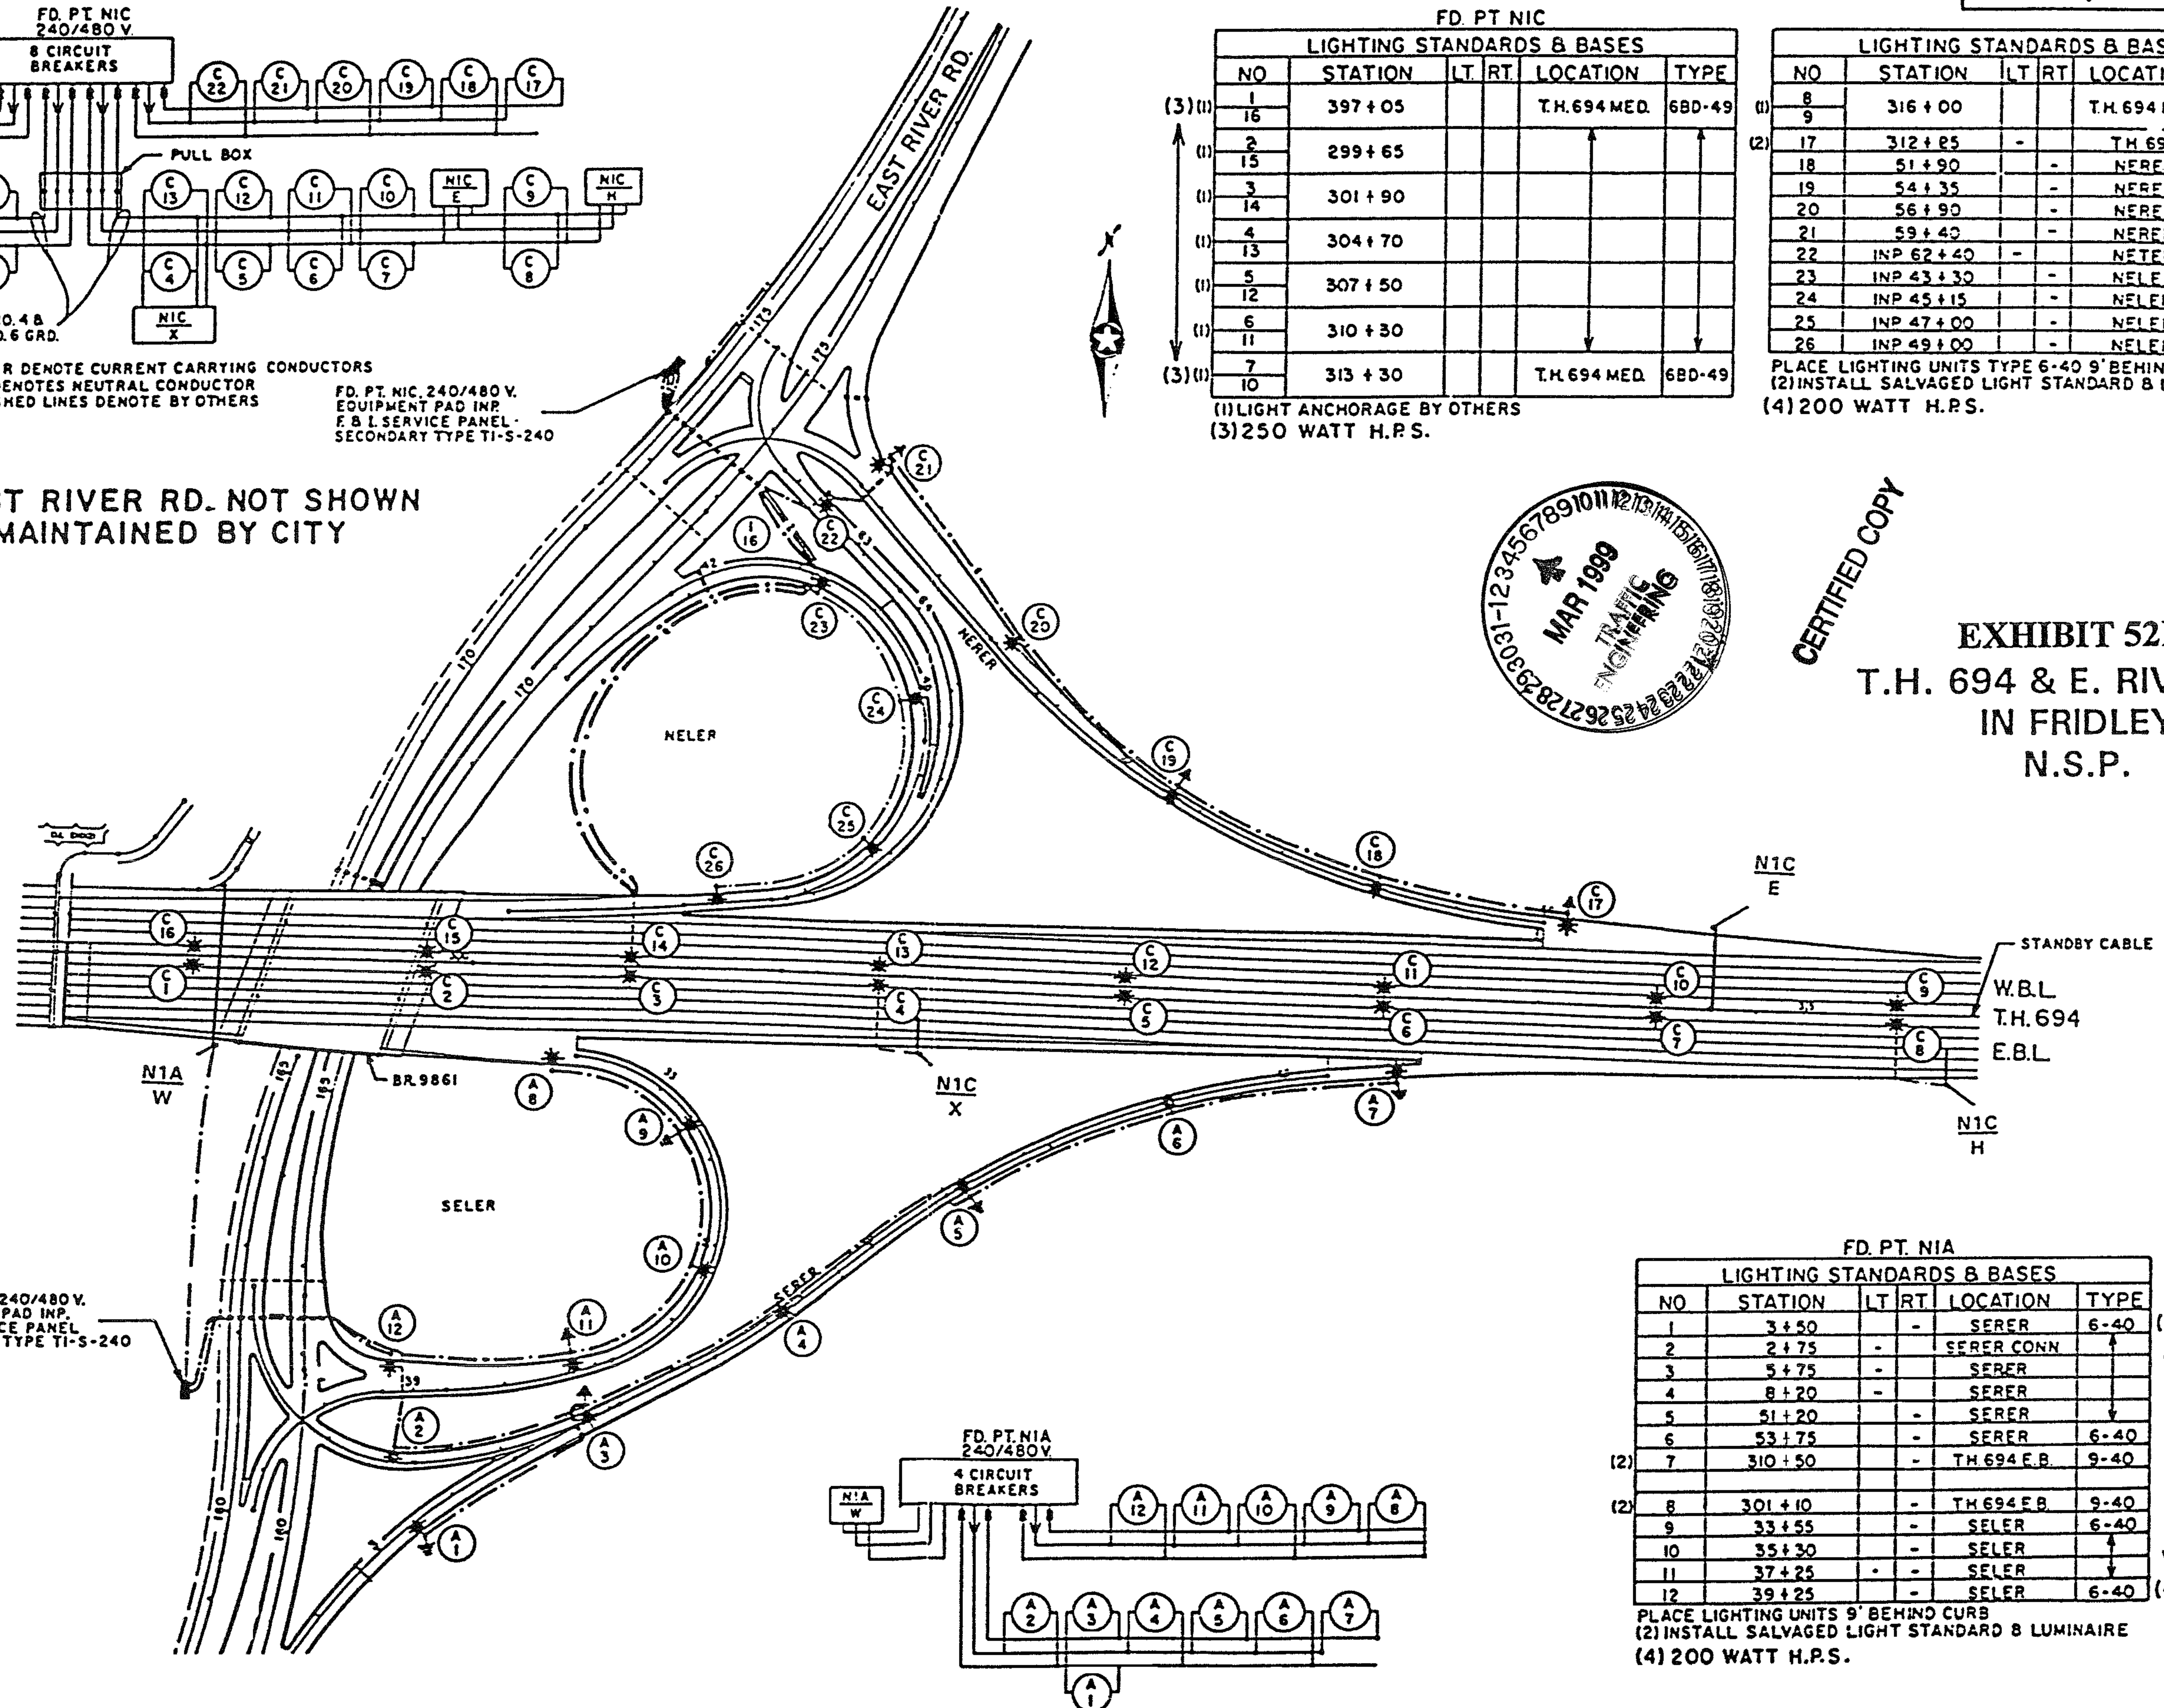

CERTIFIED COPY

EXHIBIT 52D
T.H. 694 & E. RIVER RD.
IN FRIDLEY
N.S.P.

FD. PT. N1A

LIGHTING STANDARDS & BASES					
NO	STATION	LT	RT	LOCATION	TYPE
	1			SELER	6-40 (4)
	2			SELER CONN	
	3			SELER	
	4			SELER	
	5			SELER	
	6			SELER	6-40
(2)	7			TH 694 E.B.	9-40
(2)	8			TH 694 E.B.	9-40
	9			SELER	6-40
	10			SELER	
	11			SELER	
	12			SELER	6-40 (4)

PLACE LIGHTING UNITS 9' BEHIND CURB
(2) INSTALL SALVAGED LIGHT STANDARD & LUMINAIRE
(4) 200 WATT H.P.S.

FD.PTS. N1C,N1A