
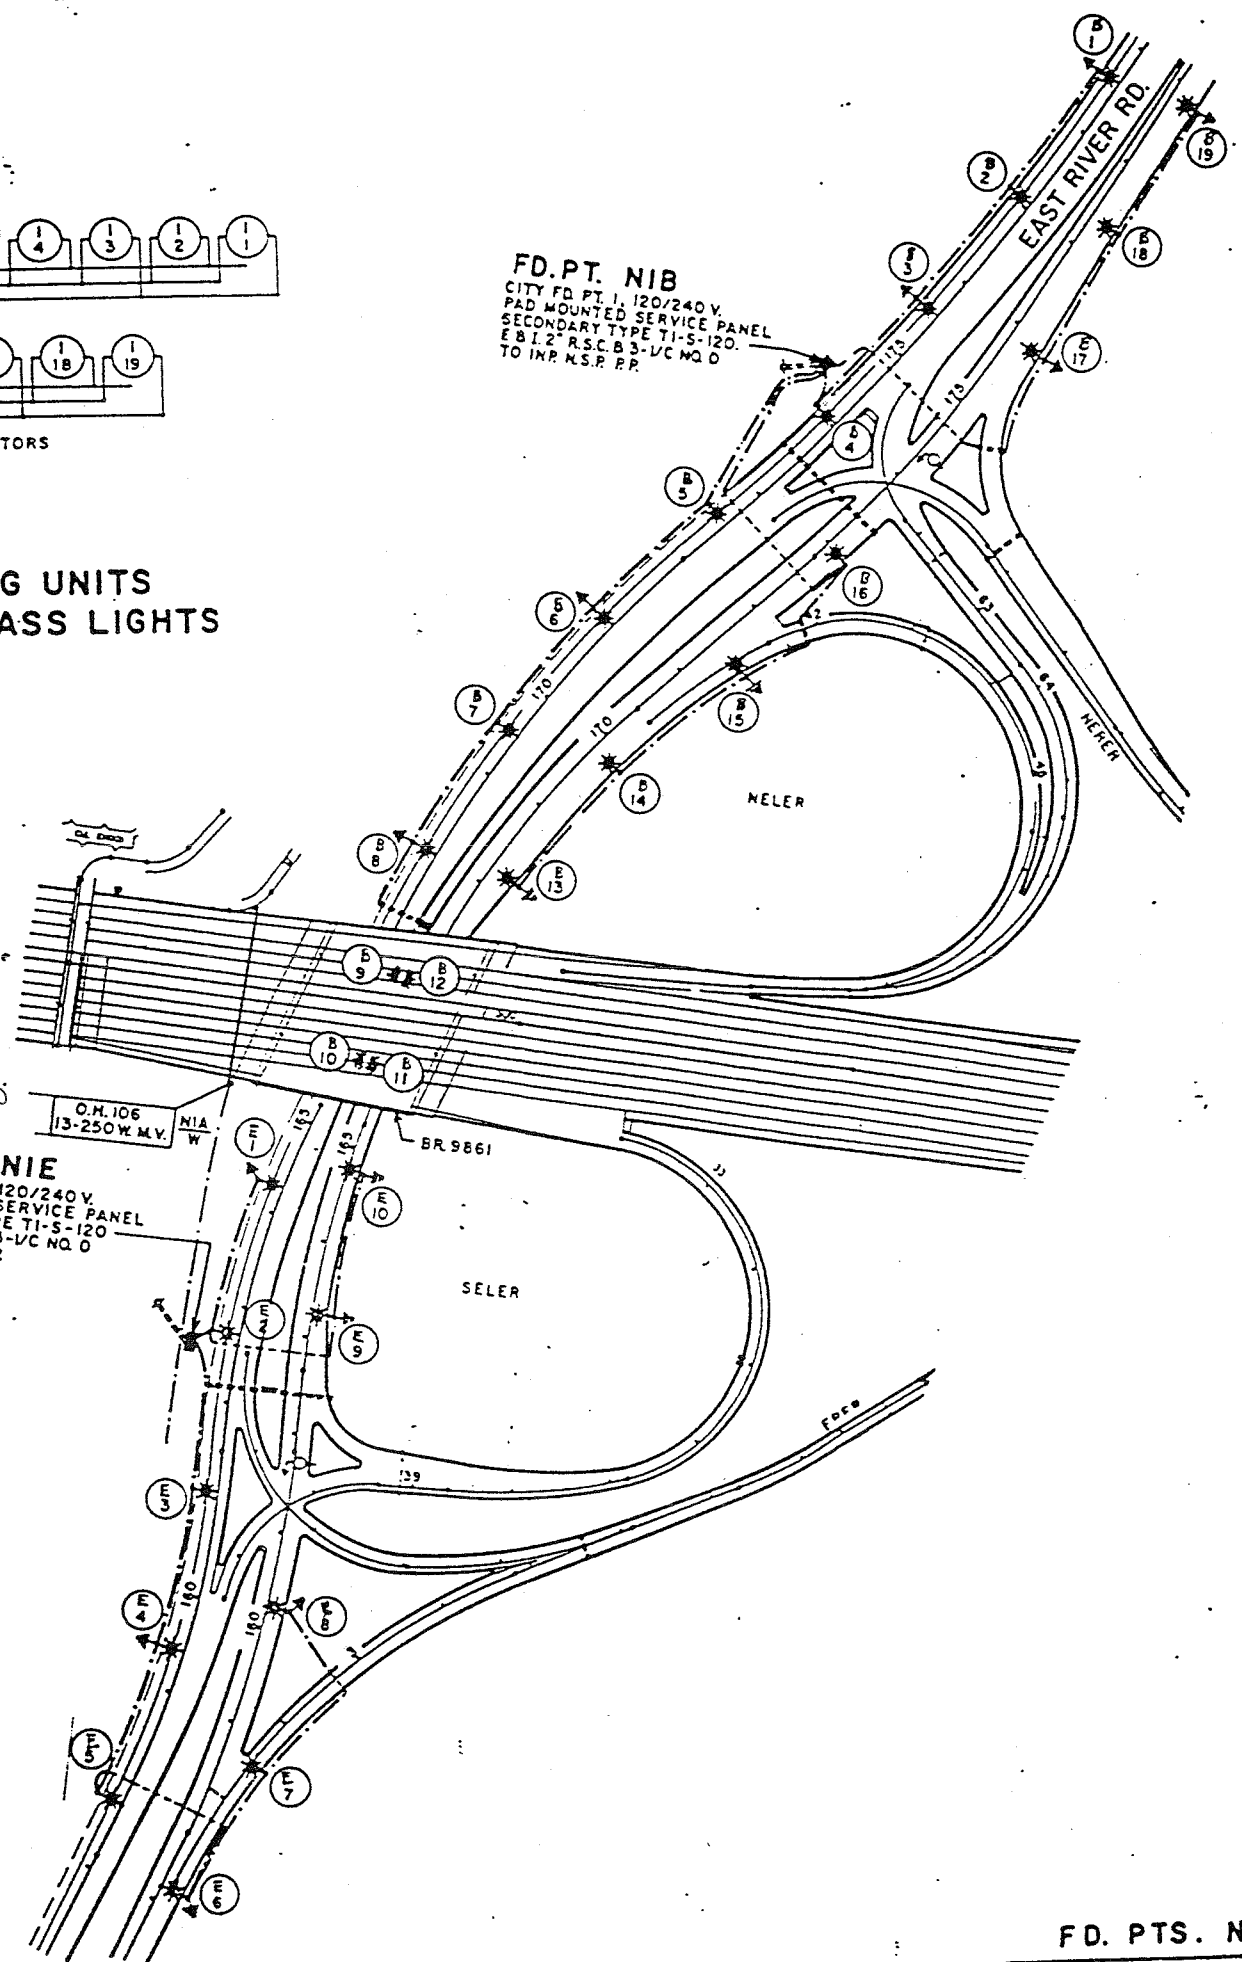


SHEET TOTAL
25-250 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
4-250 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHTS

FD. PT. NIB
CITY FD. PT. 1, 120/240V.
PAD MOUNTED SERVICE PANEL
SECONDARY TYPE T1-S-120.
E 8 1 2" R.S.C. B 3-1/2" NO. 0
TO INP. N.S.P. P.P.

FD. PT. NIE
CITY FD. PT. 2, 120/240V.
PAD MOUNTED SERVICE PANEL
SECONDARY TYPE T1-S-120
E 8 1 2" R.S.C. B 3-1/2" NO. 0
TO INP. N.S.P. P.P.

FD. PT. NIE
CITY FD. PT. 2
120/240V.
4 CIRCUIT BREAKERS

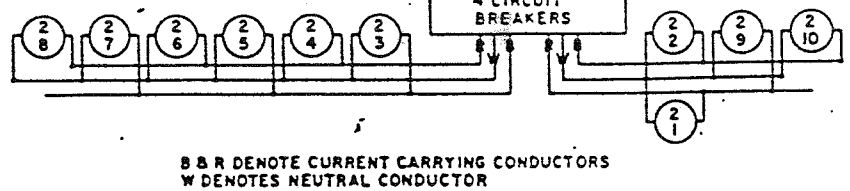

FD. PT. NIB
CITY FD. PT. 1

| LIGHTING STANDARDS & BASES | | | | | |
|----------------------------|----------|----|----|----------|-------|
| NO | STATION | LT | RT | LOCATION | TYPE |
| 1 | 178 + 50 | - | - | SB ERR | 6P-30 |
| 2 | 177 + 05 | - | - | | |
| 3 | 175 + 50 | - | - | | |
| 4 | 174 + 00 | - | - | | |
| 5 | 172 + 50 | - | - | | |
| 6 | 171 + 00 | - | - | | |
| 7 | 169 + 50 | - | - | | |
| 8 | 168 + 00 | - | - | | 6P-30 |
| (3) 9 | 166 + 70 | - | - | | |
| (3) 10 | 165 + 60 | - | - | SB ERR | L |
| (3) 11 | 165 + 85 | - | - | NB ERR | L |
| (3) 12 | 166 + 60 | - | - | | |
| 13 | 168 + 20 | - | - | | 6P-30 |
| 14 | 169 + 80 | - | - | | |
| 15 | 171 + 50 | - | - | | |
| 16 | 173 + 00 | - | - | | |
| 17 | 175 + 80 | - | - | | |
| 18 | 177 + 30 | - | - | | |
| 19 | 178 + 80 | - | - | NB ERR | 6P-30 |

PLACE LIGHTING UNITS 9' BEHIND CURB OR BIT.
SHOULDER OR AS DIRECTED BY THE ENGINEER
(3) 250 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHT

EXHIBIT A
EAST RIVER RD., UNIVERSITY
AVE. AND CENTRAL AVE. WITH
T.H. 694 IN FRIDLEY

N1B & N1E CITY OF FRIDLEY RELAMP
STATE MAINTAINS REST

FD. PT. NIE
CITY FD. PT. 2

| LIGHTING STANDARD & BASES | | | | | |
|---------------------------|----------|----|----|----------|-------|
| NO | STATION | LT | RT | LOCATION | TYPE |
| 1 | 164 + 30 | - | - | SB ERR | 6P-30 |
| 2 | 162 + 70 | - | - | | |
| 3 | 161 + 10 | - | - | | |
| 4 | 159 + 40 | - | - | | |
| 5 | 157 + 75 | - | - | SB ERR | |
| 6 | 157 + 20 | - | - | NB ERR | |
| 7 | 158 + 65 | - | - | | |
| 8 | 160 + 20 | - | - | | |
| 9 | 163 + 25 | - | - | | |
| 10 | 164 + 75 | - | - | NB ERR | 6P-30 |

PLACE LIGHTING UNITS 9' BEHIND CURB OR BIT.
SHOULDER OR AS DIRECTED BY THE ENGINEER

CERTIFIED COPY

DEC 28 1997