
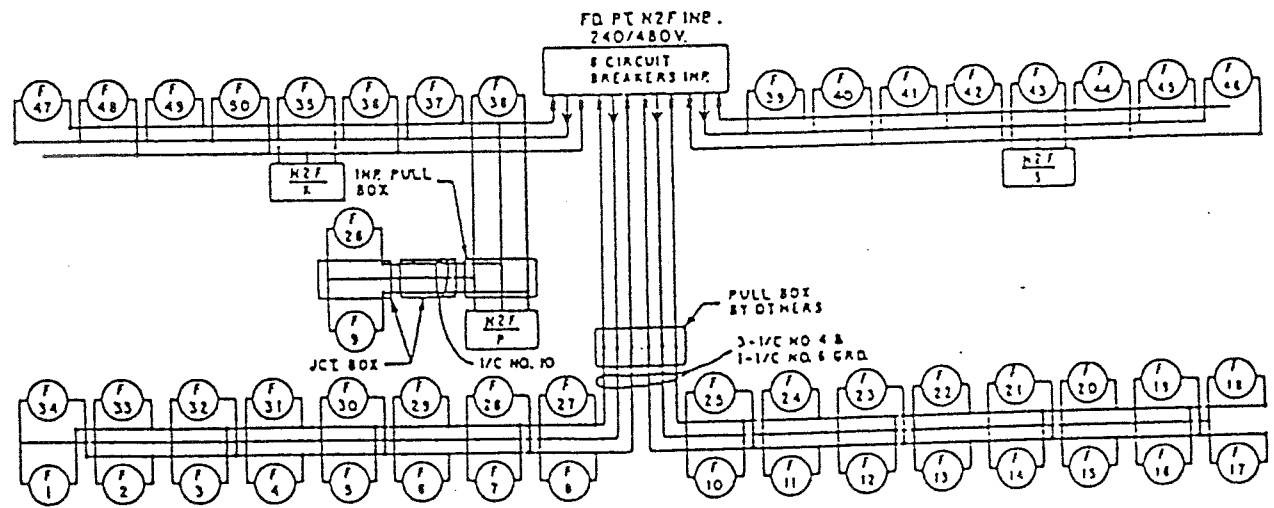
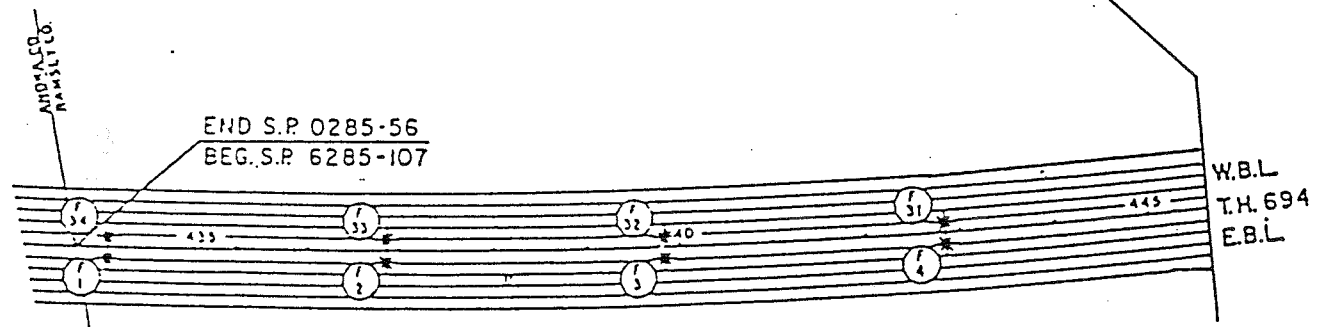


LIGHTING STANDARDS & BASES				
NO	STATION	LT RT	LOCATION	TYPE
1	434+00		T.H. 694 MED	6BD-49
2	436+85			
3	438+85			
4	442+85			
5	445+85			
6	448+85			
7	451+85			
8	454+85		T.H. 694 MED.	6BD-49
9	456+35		T.H. 694 FR	
10	458+00		T.H. 694 MED.	6BD-49
11	461+00			
12	464+00			
13	467+00		T.H. 694 MED.	6BD-49

LIGHTING STANDARDS & BASES				
NO	STATION	LT RT	LOCATION	TYPE
14	470+00		T.H. 694 MED	6BD-49 (3)
15	473+00			(3)
16	476+00			(3)
17	478+90		T.H. 694 MED.	6BD-49 (3)
18	448+05		T.H. 694 FR	9-40 (4)
19	461+35		RAMP A2	6-40
20	481+85		RAMP A2	6-40
21	511+35		RAMP A2	6-40
22	331+90		RAMP C2	6-40
23	361+40		RAMP C2	6-40
24	381+90		RAMP C2	6-40
25	455+10		T.H. 694 FR	9-40
26	464+70		T.H. 694 WB	9-40
27	521+25		RAMP D2	6-40
28	551+70		RAMP D2	6-40
29	531+25		RAMP D2	6-40
30	101+65		RAMP B2	6-40
31	81+15		RAMP B2	6-40
32	51+85		RAMP B2	6-40
33	447+90		T.H. 694 WB	9-40 (4)

(2) INSTALL SALVAGED LIGHT STANDARD & LUMINAIRE FROM S.P. 0285-55
 (4) 200 WATT HIGH PRESSURE SODIUM

(1) LIGHT ANCHORAGE BY OTHERS
 (3) 250 WATT HIGH PRESSURE SODIUM

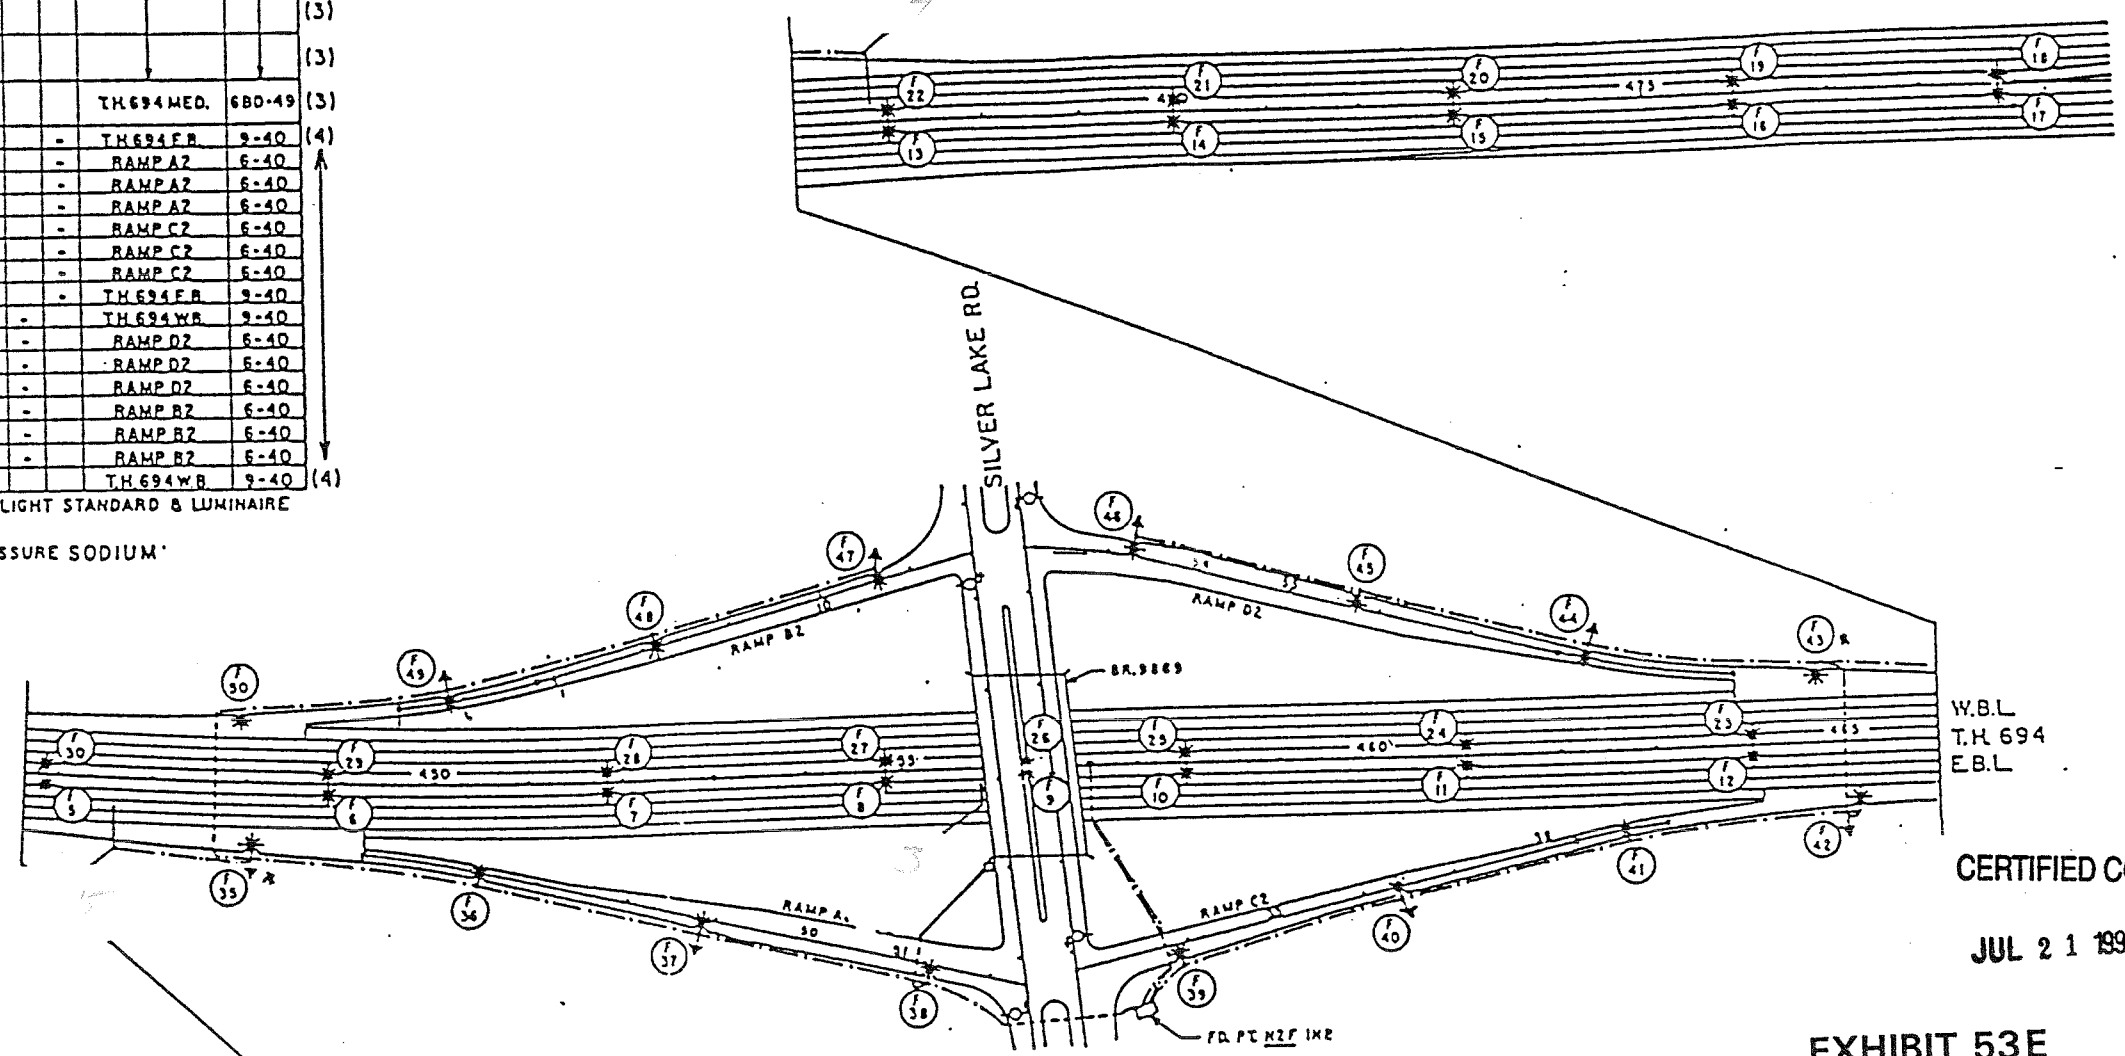

B & R DENOTE CURRENT CARRYING CONDUCTORS
 W DENOTES NEUTRAL CONDUCTOR
 DASHED LINES DENOTE IMP. OR BY OTHERS

W.B.L.
 T.H. 694
 E.B.L.
 CERTIFIED COPY
 JUL 21 1995

EXHIBIT 53E
T.H. 694 & SILVER LAKE RD.
IN NEW BRIGHTON
N.S.P.

SHEET TOTAL
 32 - 250 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
 16 - 200 WATT HIGH PRESSURE SODIUM LIGHTING UNITS
 2 - 200 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHTS