



FD. PT. S4J

LIGHTING STANDARDS AND BASES					
NO.	STATION	LT.	RT.	LOCATION	TYPE
1	272+70		65'	T.H. 494 EBL	3-100
2	282+15		85'	T.H. 494 EBL	3-100
3	291+35		70'	T.H. 494 EBL	3-100
4	300+60		80'	T.H. 494 EBL	3-100
5	55+80		70'	WBD	3-100
6	64+30		50'	WBD	3-100
7	277+35	50'		T.H. 494 WBL	3-100
17	INPLACE			PRAIRIE CEN. DR.	6-40
18	INPLACE			PRAIRIE CEN. DR.	6-40

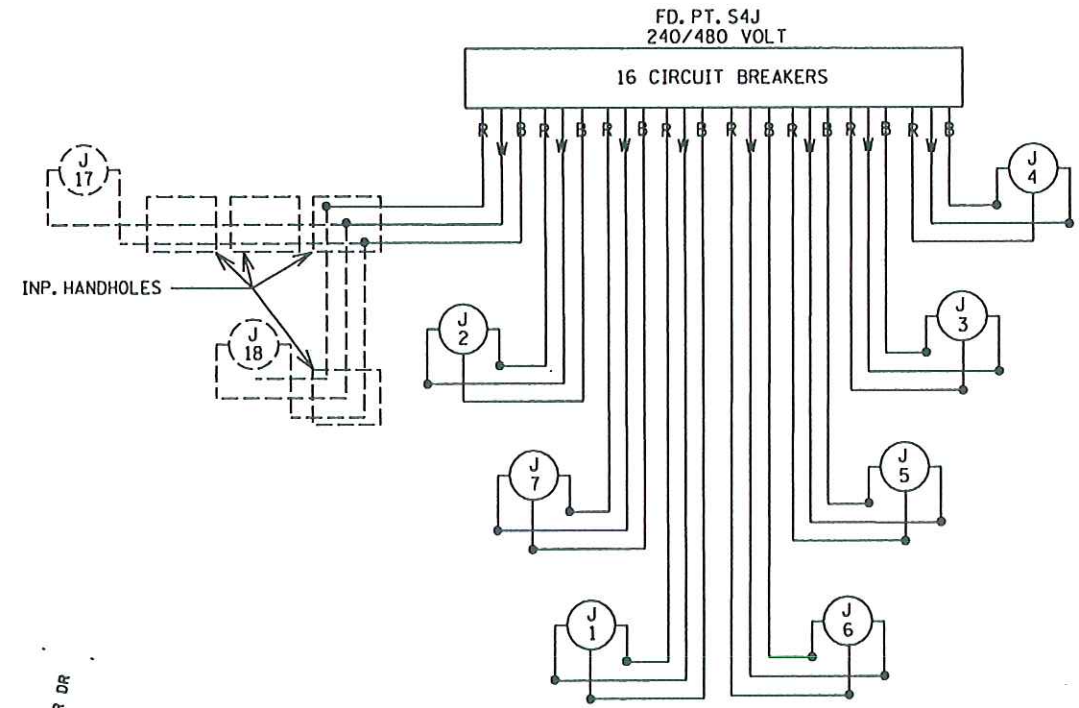

B AND R DENOTE CURRENT CARRYING CONDUCTORS
 W DENOTES NEUTRAL CONDUCTOR
 SOLID LINES DENOTE F. & I.
 DASHED LINES DENOTE INPLACE

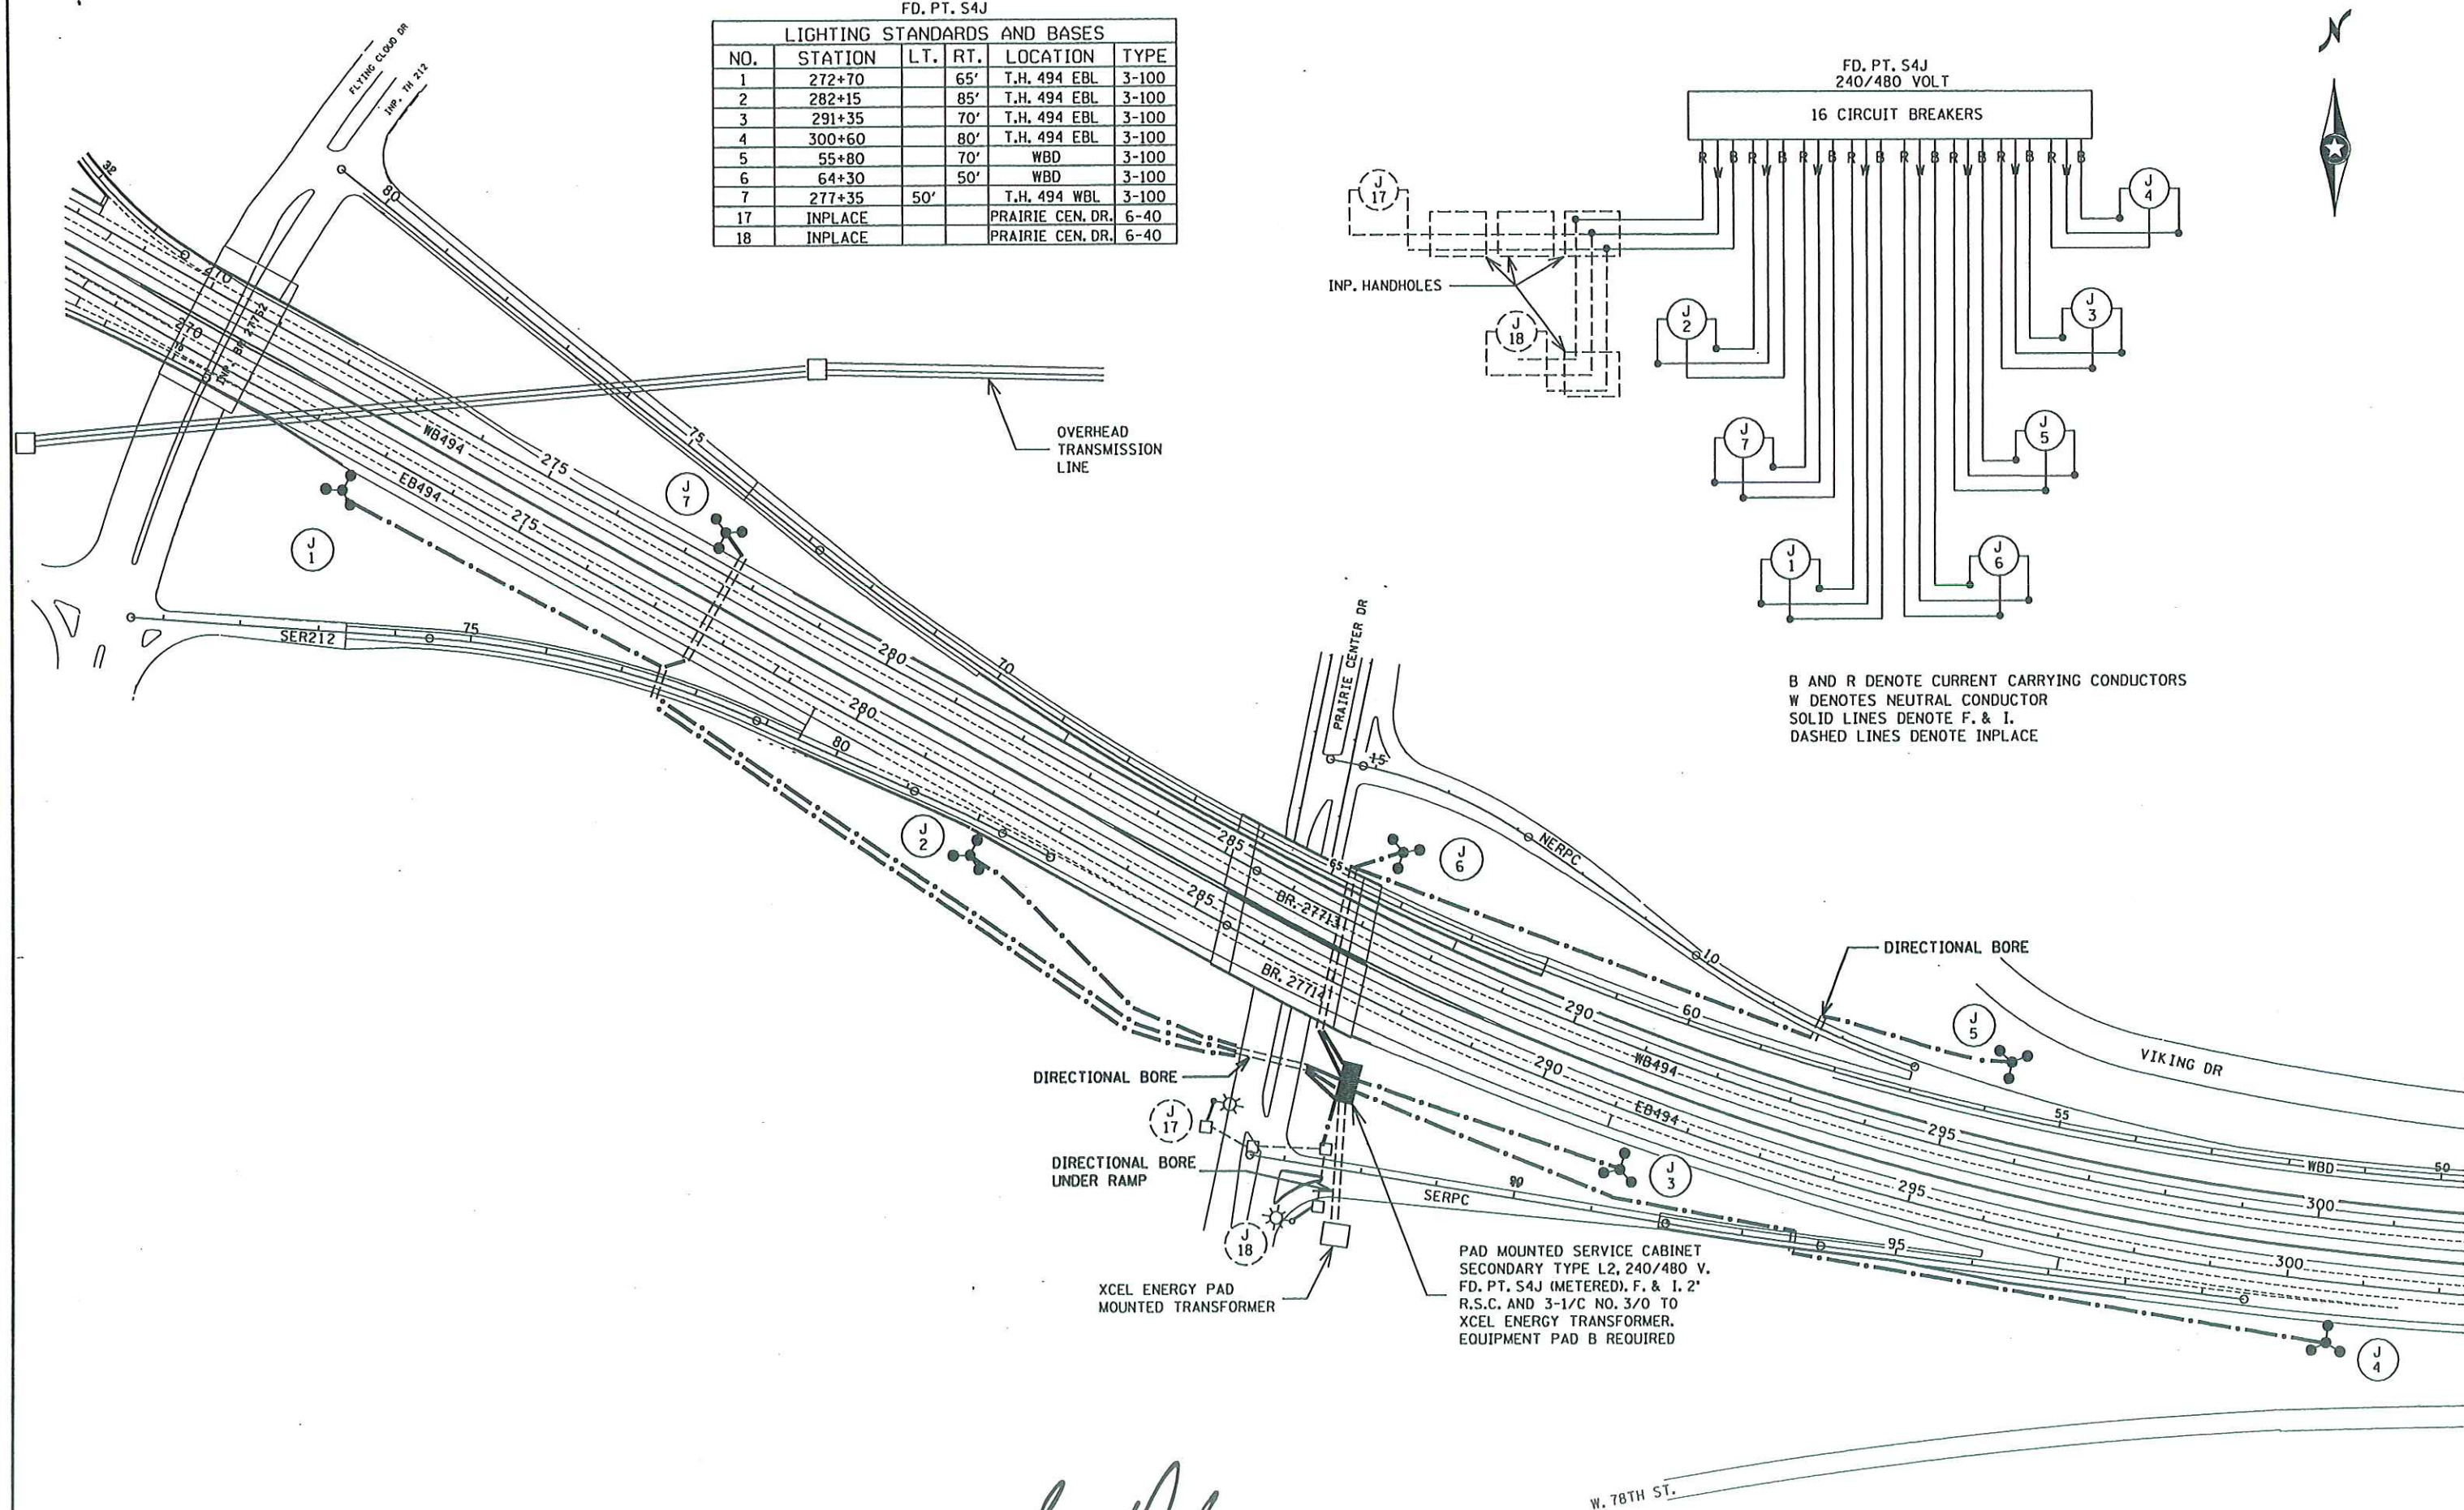