


LEGEND

- INPLACE PAD MOUNTED SOURCE OF POWER (240/480V.)
- ⊙ INPLACE HIGH MAST LIGHTING UNIT
- ⊠ INPLACE UNDERPASS LIGHTING UNIT
- ⊛ F. & I. 250 WATT HIGH PRESSURE SODIUM LIGHTING UNIT
- INPLACE HANDHOLE
- INPLACE CONDUIT
- === 3' RIGID NON-METALLIC CONDUIT (DIRECTIONAL BORE)
- .-.- INPLACE ARMORED CABLE
- DIRECT BURIED POWER CABLE 3 CONDUCTOR NO. 4 AWG ARMORED CABLE SPEC NO. 3815
- ⊥ PERMANENT GROUND ROD (25 OHMS OR LESS)

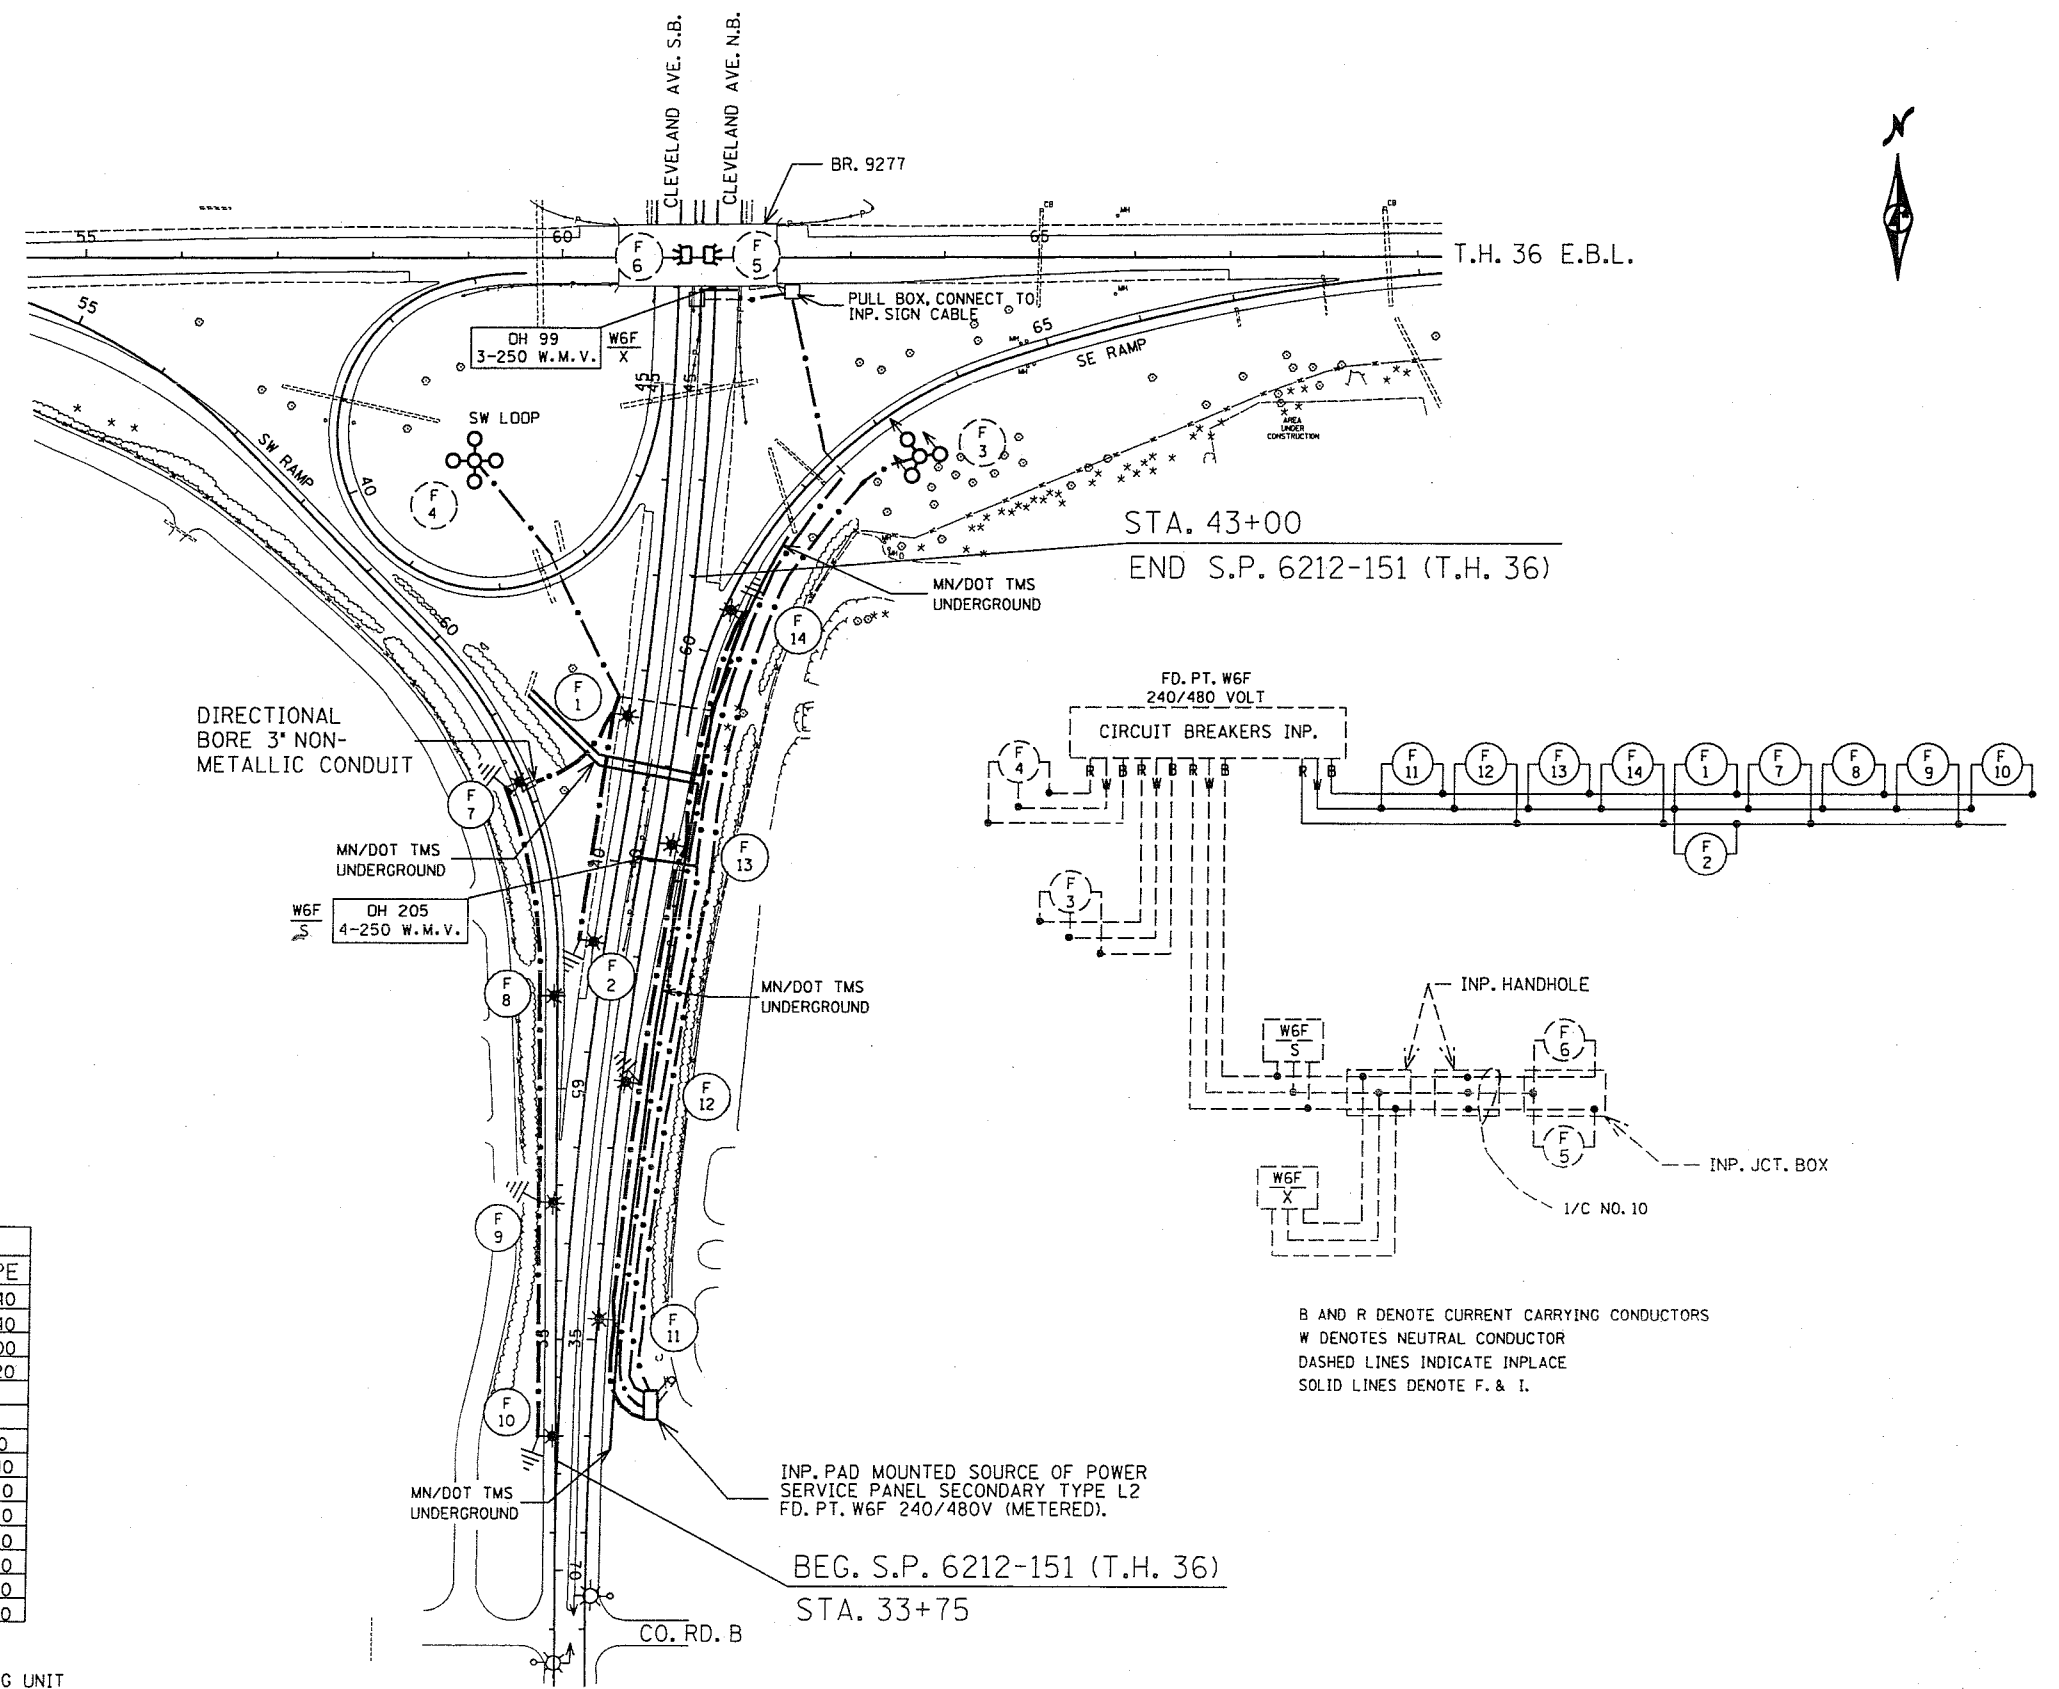

FD. PT. W6F

LIGHTING STANDARDS AND BASES				
NO.	STATION	LT.	RT.	LOCATION TYPE
(4)	1	41+50	-	CLEVELAND S.B. 12-40
(4)	2	39+15	- 40'	CLEVELAND S.B. 12-40
(1)	3	INP. 63+50	42'	S.E. RAMP 3-100
(2)	4	INP. 59+10	215'	S.W. LOOP 4-120
(3)	5	INP. 46+35	-	CLEVELAND N.B. L
(3)	6	INP. 46+35	-	CLEVELAND S.B. L
(4)	7	61+75	-	S.W. RAMP 9-40
(4)	8	64+05	-	S.W. RAMP 12-40
(4)	9	36+40	-	CLEVELAND S.B. 12-40
(4)	10	34+00	-	CLEVELAND S.B. 12-40
(4)	11	35+20	-	CLEVELAND N.B. 12-40
(4)	12	37+70	-	CLEVELAND N.B. 12-40
(4)	13	40+20	-	CLEVELAND N.B. 12-40
(4)	14	42+70	-	CLEVELAND N.B. 12-40

- (1) ASYMETRIC LUMINAIRES
- (2) SYMETRICAL LUMINAIRES
- (3) 200 WATT HIGH PRESSURE SODIUM UNDERPASS LIGHTING UNIT
- (4) 250 WATT HIGH PRESSURE SODIUM LIGHTING UNIT

B AND R DENOTE CURRENT CARRYING CONDUCTORS
 W DENOTES NEUTRAL CONDUCTOR
 DASHED LINES INDICATE INPLACE
 SOLID LINES DENOTE F. & I.

Sam Dehner
 LICENSED PROFESSIONAL ENGINEER